



Vincent Saplenza, P.E.
Commissioner

Paul V. Rush, P.E.
Deputy Commissioner
Bureau of Water Supply
prush@dep.nyc.gov

59-17 Junction Boulevard
Flushing, NY 11373
T: (845) 340-7800
F: (845) 334-7175

February 10, 2020

Li Huang, P.E.
New York City Department of Health and Mental Hygiene
Environmental Sciences & Engineering
42-09 28th Street, 14th Floor CN# 56
Long Island City, NY 11101

Patrick Palmer
New York State Department of Health
Bureau of Water Supply Protection, NYC Watershed Section
Empire State Plaza, Corning Tower, Room 1198
Albany, NY 12237

Katie Lynch
United States Environmental Protection Agency
Clean Water Division - New York City Water Supply Protection Program
290 Broadway, 24th Floor
New York, New York 10007-1866

RE: Monthly Water Quality Report for January 2020

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **January 2020**. There was no well pumpage to distribution in the Groundwater System this month. Croton water was feeding into distribution for the month of December 2019. In addition to the following list of compliance reports, a disc of electronic files containing compliance and non-compliance data for this month is enclosed with this report.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
 - Summary
 - Positive Samples
 - Resamples
- Chlorine Residual Reports
 - Entry Point Online
 - Entry Point Daily Minimum
 - Heterotrophic Plate Count
 - Monthly Summary
- Distribution Turbidity Reports
 - Distribution Turbidity Report
 - Source Water > 1.49 NTU Table
- Color Entry Point Report
- Fluoride Reports

- Fluoride Entry Point Report
- Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

FAD REQUIREMENTS

1. Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):

Requirements met. The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from August 1, 2019 to January 31, 2020. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 0.00% for the Catskill/Delaware System for this time period.

2. Raw Water Turbidity (Section 141.71(a)(2)):

Requirements met. The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest reported turbidity value was 1.1 NTU on the Catskill/Delaware System for the month.

3. Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):

Requirements met. As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual value for entry point readings for the Catskill/Delaware System from sites 1S03 (Tunnel 1) was 0.41 mg/L, 1S03A (Tunnel 2) was 0.71 mg/L, and 1S03B (Tunnel 3) was 0.52 mg/L.

The Croton Filtration Plant was offline and thus there was no operational Croton entry point for the month of January.

4. Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):

Requirements met. All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.01 mg/L.

A total of 1338 distribution samples were tested for free chlorine residual this month. For all monthly distribution sites free chlorine residual ranged from 0.01 to 0.99 mg/L, and averaged 0.58 mg/L.

Please note there was an error in this section of the Monthly Water Quality Report for December 2019 cover letter. The corrected statement for this section of the December 2019 cover letter follows:

All free chlorine residuals measured at compliance sites within the distribution system during the month [of December 2019] were greater than or equal to 0.01 mg/L except for one (1) sample that equaled 0.0 mg/L.

A total of 1337 distribution samples were tested for free chlorine residual this month [December 2019]. For all monthly distribution sites free chlorine residual ranged from 0.00 to 1.15 mg/L, and averaged 0.67 mg/L.

The fourth quarter of 2019 chlorine residual Running Annual Average was 0.57 mg/L. This meets the MRDL of 4 mg/L for the quarterly running annual average of all system samples.

5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):

Requirements met. The results for the fourth quarter of 2019 were included in the report dated December 10, 2019 (for the November 2019 reporting period).

6. Total Coliform Monitoring (Section 141.71(b)(5)):

Requirements met. The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 816 compliance samples were tested for total coliform during this period. HPC were all ≤ 500 CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC > 500 CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, there were no samples that tested positive for total coliform, and all samples were negative for *E. coli*.

OTHER WATER QUALITY MONITORING

7. Microbiological Monitoring:

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity > 1.49 NTU, was not required this month, but all of these samples were negative for total coliform and *E. coli*.

The analyses of 525 distribution Operational samples resulted in no samples testing positive for total coliform. No *E. coli* were detected.

The analyses of 248 Pre-Finished samples resulted in one (1) sample testing positive for total coliform. No *E. coli* were detected.

The analyses of 492 Autosampler Pre-finished samples resulted in no samples testing positive for total coliform. No *E. coli* were detected.

8. Distribution Turbidity Monitoring:

For distribution sites, turbidity ranged from 0.45 to 8.04 NTU and averaged 0.70 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

9. Color Monitoring:

The MCL of 15 units for color was met at each Catskill/Delaware entry point for the month. Daily analyses of entry point samples (93 samples in total), produced monthly average color value of seven (7) units for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), and 1S03B (Tunnel 3).

10. Volatile Organic/TTHM/HAA5 Monitoring:

Monthly Results: Twenty-two (22) distribution and three (3) entry point samples were analyzed for volatile organic contaminants (VOC). All VOC samples from distribution sites and entry points were below detection. Twenty-two (22) TTHM distribution samples were analyzed ranging from 16 µg/L to 34 µg/L. Three (3) TTHM entry point samples were analyzed ranging from 15 µg/L to 22 µg/L. Twenty-two (22) HAA5 distribution samples were analyzed ranging from 24 µg/L to 54 µg/L. Three (3) HAA5 entry point samples were analyzed ranging from 22 µg/L to 32 µg/L.

11. Semivolatile and Other Organic Chemicals/parameters:

EPA Method 525.3 monitoring for 112 compounds of specified and unspecified organic parameters was conducted on January 13, 2020 at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the Croton Low Service entry point (1SCL1) and Croton High Service entry point (1SCH3) which represented distribution Catskill/Delaware water, and six (6) distribution points. All semi-volatile organic contaminant samples from distribution sites and entry points were below detection limits.

Monitoring for Method 505 organohalide pesticides was conducted on January 27, 2020 at three Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), and at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3) which represented distribution Catskill/Delaware water. All results were below detection.

12. Fluoride Monitoring:


Daily analyses of entry point samples (93 samples in total), produced monthly average fluoride level of 0.70 mg/L for sites 1S03 (Tunnel 1) and 1S03B (Tunnel 3), and 0.71 mg/L for site 1S03A (Tunnel 2). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

13. Other Monitoring:

Monitoring for Taste and Odor (T&O) compounds Geosmin and 2-Methylisoborneol (MIB) was conducted in January on nine (9) samples from the Delaware Aqueduct inflow to Kensico Reservoir (DEL17), Delaware Aqueduct outflow from Kensico Reservoir (DEL18DT), New Croton Reservoir, and Jerome Park Reservoir. Catskill/Delaware water samples were ND for both Geosmin and MIB. Croton water samples were ND for Geosmin, and ranged from 14 ng/L to 66 ng/L for MIB. Contract laboratory reports of available data are included as pdf files on the disc of electronic files enclosed with this report.

Please feel free to contact me at (845) 340-7701 if you would like to discuss any of this information in greater detail.

Sincerely,

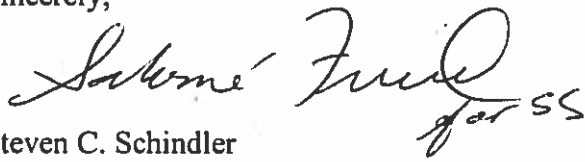A handwritten signature in black ink, appearing to read "Steven C. Schindler". The signature is written in a cursive style and includes a small mark that looks like "for SS" at the bottom right.

Steven C. Schindler
Director, Water Quality

Enclosure

cc:

- Mr. Andrew Brunsten, Inspector General for NYCDEP
- Mr. Kenneth Kosinski, NYSDEC
- Mr. David Kvinge, Westchester County Water Agency (by email only)
- Mr. Huan Li, NYCDOHMH
- Ms. Millie Magraw, Westchester County Water Agency (by email only)
- Mr. Trevor McProud, NYCDOHMH
- Mr. Andy Tse, NYSDOH (by email only)
- Mr. Steven Zahn, NYSDEC – Region 2

TABLE OF CONTENTS FOR CD FILES

January 2020 Monthly Water Quality Report

Microbiological Reports:

Summary of Coliform Compliance Samples
Coliform Positive Compliance Samples
Coliform Resample for Positive Compliance Samples
Summary of Coliform Operational Samples

(NYC_Micro_Summary_Compliance_202001.xls)
(NYC_Micro_Compliance_Positives_202001.xls)
(NYC_Micro_Compliance_Resamples_202001.xls)
(NYC_Micro_Operational_202001.pdf)
(NYC_Micro_Summary_Operational_202001.xls)
(NYC_Micro_Operational_202001.pdf)
(NYC_Micro_Operational_Positives_202001.xls)
(NYC_Micro_Operational_202001.pdf)
(NYC_Micro_Operational_Resamples_202001.xls)
(NYC_EP_Coliform_For_Source_Turb_GT_149_202001.snp)
(NYC_Monthly_Alldata_202001.xls|Micro)

Coliform Positive Operational Samples

Coliform Resample for Positive Distribution Operational Samples

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU
All Microbiological Results

Free Chlorine Residual (FCR) Reports:

Entry Point FCR On-Line Monitoring Results
Daily Minimum FCR at Entry Points

(Entry_Shaft_C12_Onln_202001_Fig.pdf)
(Entry_Shaft_C12_Onln_202001_Tbl.pdf)
(Croton_Entry_Point_C12_Onln_202001_Tbl.pdf)
(NYC_Micro_Summary_FCR_&_HPC_Compliance_202001.xls)
(NYC_Micro_Summary_FCR_&_HPC_Operational_202001.xls)
(NYC_Micro_Operational_202001.pdf)
(NYC_FCR_Monthly_Summary_202001.xls)
(NYC_FCR_Monthly_Alldata_202001.xls)

FCR and Heterotrophic Plate Count (HPC) Compliance Samples
FCR and HPC of Operational Samples

Summary of FCR of Distribution Samples (Monthly)
FCR of all Distribution Sites

Turbidity Reports:

Summary of Turbidity of Distribution Samples
Turbidity of all Distribution Sites

(NYC_Turbidity_Monthly_Summary_202001.xls)
(NYC_Turbidity_Monthly_Alldata_202001.xls)

Color Reports:

Color for Entry Point Samples

(Entry_Point_Color_Monthly_202001.xls)

Fluoridation Reports:

Summary of Fluoride Levels of Distribution Samples
Fluoride Daily Entry Point Report for Surface Water Systems
Fluoride of all Distribution Sites

(NYC_Fluoride_Monthly_Summary_202001.xls)
(Entry_Point_Fluoride_Monthly_202001.xls)
(NYC_Fluoride_Monthly_Alldata_202001.xls)

Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP)

Reports:

Total Trihalomethanes (TTHM) & VOC Monthly Report
Semivolatiles of EPA Method 525 Report
Organohalide Pesticides EPA Method 505 Quarterly Report
Haloacetic Acids (HAA5) Monthly Report

(NYC_TTHM_&_VOC_Rpt_202001.xls)
(NYC_SOC_Rpt_202001.xls)
(NYC_505_Qtrly_Rpt_2020Q1.xls)
(NYC_HAA5_Monthly_Rpt_202001.xls)
(847503_T&O_Sample_20200106.pdf, 848305_T&O_Sample_20200108.pdf, 848998_T&O_Sample_20200113.pdf, 850482_T&O_Sample_20200121.pdf, 851964_T&O_Sample_20200127.pdf, 846849_T&O_Sample_20191230.pdf)
(NYC_VOC_HAA5_Rpt_202001.pdf)

Taste & Odor Sampling Reports from EEA Lab

Summary of EPA Organic Method Reports

Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:

All parameters for January 2020

(NYC_Monthly_Alldata_202001.xls)

RAW WATER FECAL COLIFORM CONCENTRATIONS
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Catskill/Delaware System Raw Water Fecal Coliform Compliance Report

Hawthorne Laboratory, ELAP Lab ID No. 10771
 15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
 914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water **Period: 11/17 To: 01/20**

Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
11-17	30	0	0.00	0.00
12-17	31	0	0.00	0.00
1-18	31	0	0.00	0.00
2-18	28	1	3.57	0.83
3-18	31	0	0.00	0.66
4-18	30	0	0.00	0.55
5-18	31	0	0.00	0.55
6-18	30	0	0.00	0.55
7-18	31	0	0.00	0.55
8-18	31	0	0.00	0.00
9-18	30	2	6.67	1.09
10-18	31	2	6.45	2.17
11-18	30	0	0.00	2.19
12-18	31	0	0.00	2.17
1-19	31	0	0.00	2.17
2-19	28	0	0.00	2.21
3-19	31	0	0.00	1.10
4-19	30	0	0.00	0.00
5-19	31	0	0.00	0.00
6-19	30	0	0.00	0.00
7-19	31	0	0.00	0.00
8-19	31	0	0.00	0.00
9-19	30	0	0.00	0.00
10-19	31	0	0.00	0.00
11-19	30	0	0.00	0.00
12-19	31	0	0.00	0.00
1-20	31	0	0.00	0.00

David Robinson

2/3/20

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

2/3/2020

RAW WATER TURBIDITY
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water Period: January, 2020

Date	Turbidity (NTU)						Total Coliform (Colonies per 100 mL)	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM		
1/1/20	0.70	0.65	0.70	0.70	0.70	0.70	E5	E1
1/2/20	0.65	0.65	0.70	0.75	0.75	0.70	E15	E1
1/3/20	0.70	0.70	0.70	0.65	0.65	0.70	E5	E5
1/4/20	0.75	0.70	0.65	0.70	0.75	0.75	E15	<1
1/5/20	0.75	0.75	0.65	0.70	0.70	0.75	E25	<1
1/6/20	0.70	0.70	0.70	0.75	0.70	0.65	E100	E5
1/7/20	0.65	0.65	0.70	0.70	0.65	0.70	E30	E1
1/8/20	0.60	0.65	0.65	0.65	0.75	0.75	E10	E3
1/9/20	0.70	0.70	0.75	0.60	0.65	0.65	E10	<1
1/10/20	0.65	0.65	0.65	0.60	0.65	0.60	E10	E7
1/11/20	0.65	0.60	0.60	0.65	0.70	0.70	E8	<1
1/12/20	0.60	0.65	0.70	0.65	0.70	0.75	E10	E1
1/13/20	0.75	0.55	0.60	0.65	0.65	0.65	E16	<1
1/14/20	0.65	0.65	0.60	0.60	0.60	0.60	E10	E1
1/15/20	0.60	0.60	0.60	0.60	0.60	0.60	E26	E3
1/16/20	0.50	0.55	0.60	0.70	0.65	0.65	E14	<1
1/17/20	0.60	0.60	0.65	0.55	0.55	0.55	E4	E2
1/18/20	0.55	0.55	0.55	0.60	0.60	0.60	E5	E2
1/19/20	0.60	0.65	0.70	0.65	0.65	0.65	E4	E4
1/20/20	0.75	0.65	0.70	0.70	0.75	0.75	E18	E6
1/21/20	0.70	0.70	0.70	0.70	0.70	0.60	E10	E2
1/22/20	0.60	0.60	0.60	0.60	0.60	0.60	E10	E2
1/23/20	0.55	0.50	0.70	0.60	0.60	0.60	E12	E2
1/24/20	0.75	0.60	0.65	0.70	0.80	0.75	E2	E4
1/25/20	0.80	0.85	0.80	1.0	1.1	0.85	E4	<1
1/26/20	0.85	0.80	0.70	0.85	0.75	0.80	E10	E3
1/27/20	0.75	0.75	0.70	0.75	0.80	0.80	E16	E4
1/28/20	0.85	0.80	0.75	0.80	0.75	0.80	E4	E4
1/29/20	0.80	0.75	0.80	0.75	0.75	0.75	E16	<1
1/30/20	0.70	0.65	0.70	0.60	0.65	0.70	E10	E1
1/31/20	0.70	0.75	0.65	0.70	0.65	0.70	E6	<1

.: Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error, E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with dilution based value

- Does a raw water turbidity M & R violation exist? Yes No
- Does the turbidity reading exceed 5 NTU at any time? Yes No
If yes, check for MCL violation, and notify state by the end of the next business day.
- Minimum number of microbiological samples required per week: 5
- A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

David Robinson

2/3/20

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

2/3/2020

All results that fall within the scope of the NELAP program meet that program's requirements unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 02/03/2020 11:55 am



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Data Qualifiers and Additional Notes Period: January, 2020

Date/Time	Site	Analytes Affected	Qualifier
1/13/20 09:21	DEL18DT	Total Coliform	The duplicate analysis was not within the control limits.
1/10/20 09:43	DEL18DT	Fecal Coliform	The duplicate analysis was not within the control limits.


Analytical Methods

- Coliform, Fecal - SM 9222D (2006)
- Coliform, Total - SM 9222B (2006)
- Turbidity - SM 2130B (01)


ENTRY POINT CHLORINE RESIDUAL
(FAD Requirement)

City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results


Chlorine Levels at City Tunnel No.1 Entry Point, January 2020

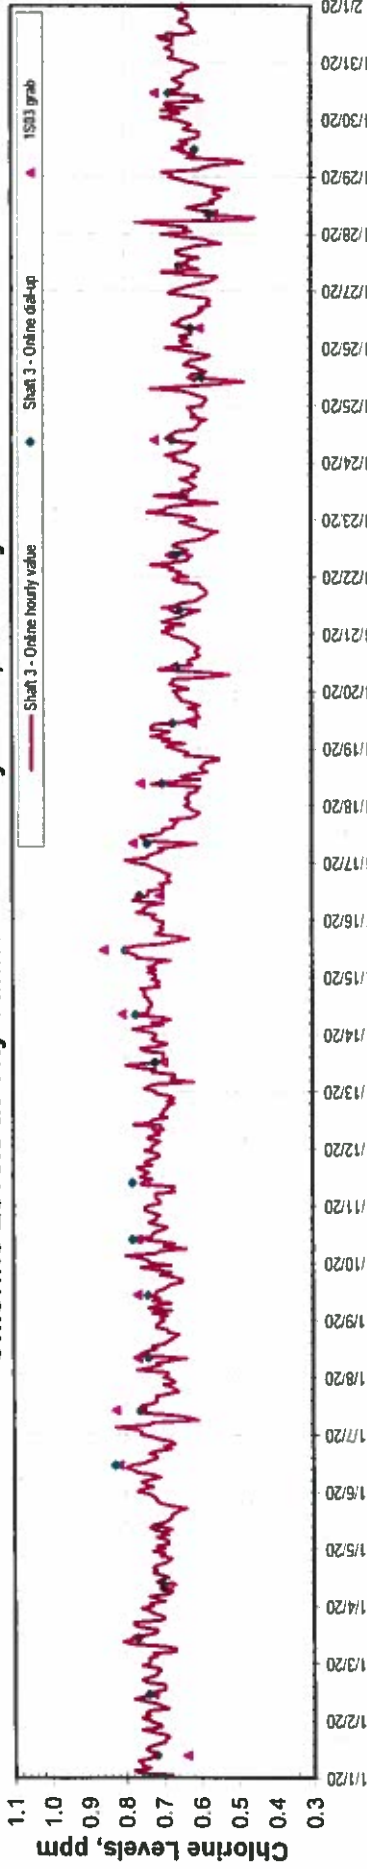

Chlorine Levels at City Tunnel No.2 Entry Point, January 2020

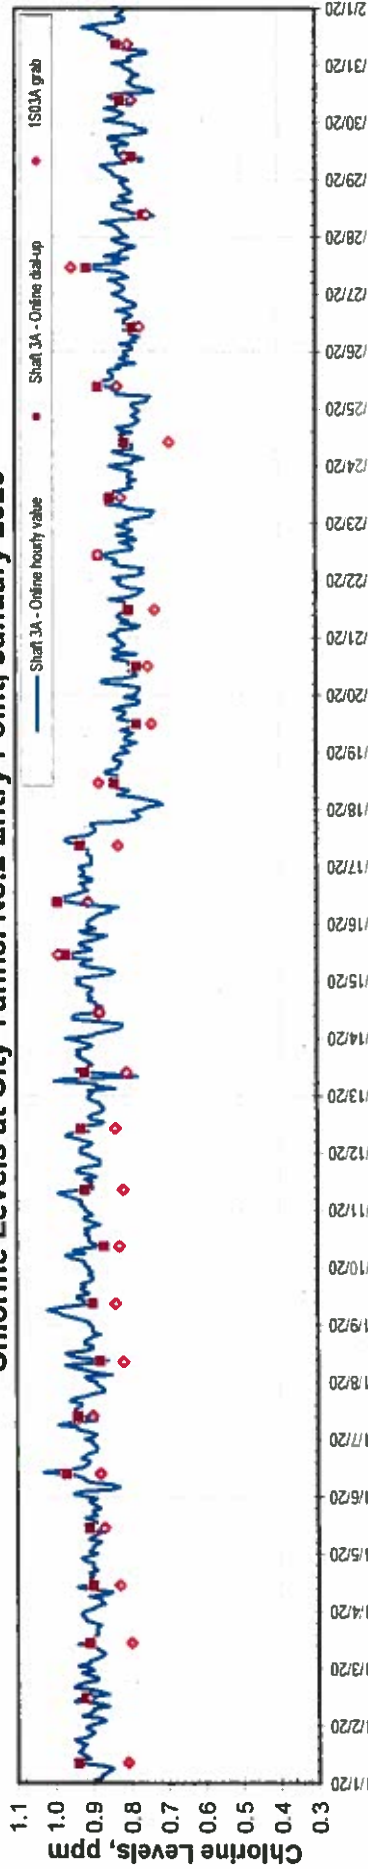

Chlorine Levels at City Tunnel No.3 Entry Point, January 2020

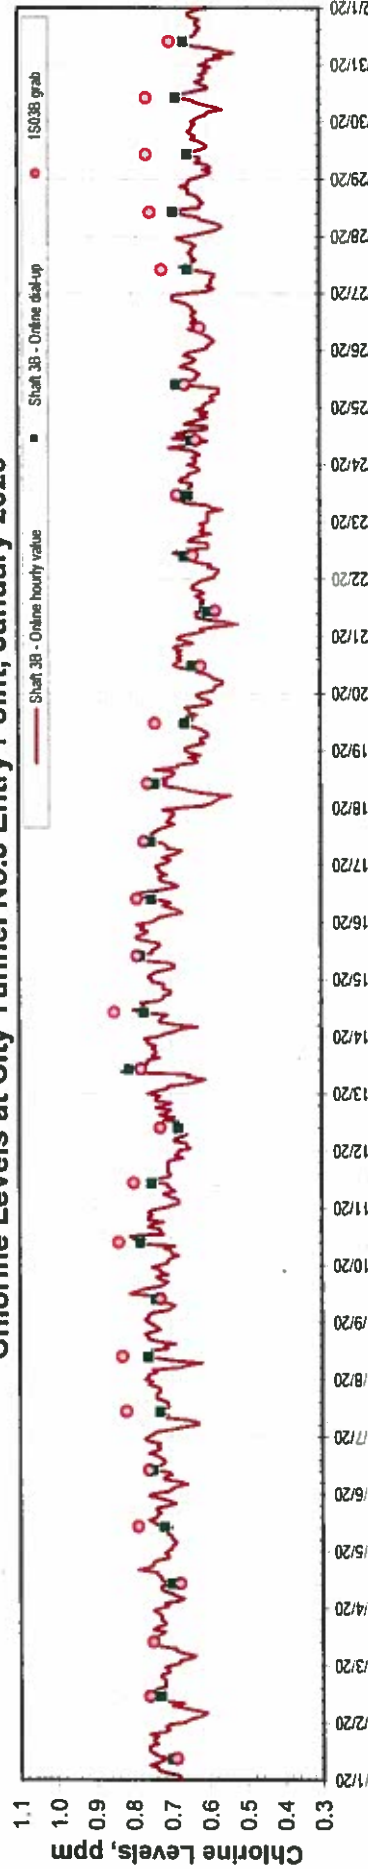

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 11/3/19, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System

Tunnel No.1 (Catskill) at Shaft 3			Tunnel No.2 (Delaware) at Shaft 3A			Tunnel No.3 (Cat/Del) at Shaft 3B		
Date	MinCl 1DL	Remark 1	Date	MinCl 2DL	Remark 2	Date	MinCl 3DL	Remark 3
01/01/20	0.66		01/01/20	0.85		01/01/20	0.67	
01/02/20	0.66		01/02/20	0.84		01/02/20	0.61	
01/03/20	0.64		01/03/20	0.86		01/03/20	0.63	
01/04/20	0.66		01/04/20	0.85		01/04/20	0.67	
01/05/20	0.64		01/05/20	0.85		01/05/20	0.68	
01/06/20	0.65		01/06/20	0.83		01/06/20	0.66	
01/07/20	0.60		01/07/20	0.86		01/07/20	0.62	
01/08/20	0.63		01/08/20	0.85		01/08/20	0.62	
01/09/20	0.64		01/09/20	0.89		01/09/20	0.69	
01/10/20	0.61		01/10/20	0.86		01/10/20	0.68	
01/11/20	0.65		01/11/20	0.86		01/11/20	0.67	
01/12/20	0.66		01/12/20	0.85		01/12/20	0.65	
01/13/20	0.61		01/13/20	0.76		01/13/20	0.60	
01/14/20	0.67		01/14/20	0.81		01/14/20	0.63	
01/15/20	0.63		01/15/20	0.84		01/15/20	0.68	
01/16/20	0.66		01/16/20	0.81		01/16/20	0.67	
01/17/20	0.60		01/17/20	0.75		01/17/20	0.67	
01/18/20	0.54		01/18/20	0.71		01/18/20	0.52	
01/19/20	0.58		01/19/20	0.76		01/19/20	0.59	
01/20/20	0.52		01/20/20	0.75		01/20/20	0.55	
01/21/20	0.57		01/21/20	0.76		01/21/20	0.52	
01/22/20	0.56		01/22/20	0.76		01/22/20	0.57	
01/23/20	0.52		01/23/20	0.72		01/23/20	0.55	
01/24/20	0.57		01/24/20	0.75		01/24/20	0.59	
01/25/20	0.44		01/25/20	0.72		01/25/20	0.55	
01/26/20	0.56		01/26/20	0.76		01/26/20	0.58	
01/27/20	0.52		01/27/20	0.77		01/27/20	0.57	
01/28/20	0.41		01/28/20	0.74		01/28/20	0.56	
01/29/20	0.48		01/29/20	0.74		01/29/20	0.59	
01/30/20	0.57		01/30/20	0.72		01/30/20	0.56	
01/31/20	0.58		01/31/20	0.73		01/31/20	0.52	

Legend: MinCl_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.
 MinCl_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.
 MinCl_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points

Low Service		High Service	
Date	MinCl_1SCL1	Date	MinCl_1SCH3
Remark 1		Remark 2	
01/01/20		01/01/20	
01/02/20		01/02/20	
01/03/20		01/03/20	
01/04/20		01/04/20	
01/05/20		01/05/20	
01/06/20		01/06/20	
01/07/20		01/07/20	
01/08/20		01/08/20	
01/09/20		01/09/20	
01/10/20		01/10/20	
01/11/20		01/11/20	
01/12/20		01/12/20	
01/13/20		01/13/20	
01/14/20		01/14/20	
01/15/20		01/15/20	
01/16/20	No Croton water.	01/16/20	No Croton water.
01/17/20		01/17/20	
01/18/20		01/18/20	
01/19/20		01/19/20	
01/20/20		01/20/20	
01/21/20		01/21/20	
01/22/20		01/22/20	
01/23/20		01/23/20	
01/24/20		01/24/20	
01/25/20		01/25/20	
01/26/20		01/26/20	
01/27/20		01/27/20	
01/28/20		01/28/20	
01/29/20		01/29/20	
01/30/20		01/30/20	
01/31/20		01/31/20	

Legend: MinCl_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.

MinCl_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.

Note: Croton water fed to High Service time period was determined by specific conductance greater than 150 uS/cm.

DISTRIBUTION SYSTEM DISINFECTION RESIDUAL
(FAD Requirement)

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

Residual Chlorine (mg/L) Distribution Samples

January 2020

All Distribution Sites			
Samples	Min	Max	Average
1338	0.01	0.99	0.58

Hach DPD Method (analyte is not ELAP certified)

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	RESIDUAL CHLORINE	COMMENT
1502	1/15/20	1S03A	Sub	0.99	Max
1331	1/14/20	34700	Reg Stop	0.01	Min

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

TOTAL COLIFORM MONITORING
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Summary of Results for Microbiological Quality
 Compliance Samples
 1/1/2020 to 1/31/2020

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	135	135	0	0	0.0%
Brooklyn	70	202	202	0	0	0.0%
Manhattan	57	168	168	0	0	0.0%
Queens ***	79	228	228	0	0	0.0%
Staten Island	29	83	83	0	0	0.0%
Ground Water Supply ****	-	-	-	-	-	-
Total	281	816	816	0	0	0.0%

* As determined by Colilert Quanti-Tray-18 Method (SM 9223 B).

** If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.

*** There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Fallen gg Date: 2/6/2020

Director: ATh Date: 2/6/2020

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality
Free Chlorine Residual and Heterotrophic Plate Count
Compliance Samples

1/1/2020 to 1/31/2020

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 ***	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	135	135	90	0	0	--	0	0.0%
Brooklyn	70	202	201	136	0	0	--	0	0.0%
Manhattan	57	168	168	115	0	0	--	0	0.0%
Queens †	79	228	227	157	4	0	--	0	0.0%
Staten Island	29	83	83	56	0	0	--	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	--	-	-
Total	281	816	814 ^a	554	4	0	--	0	0.0%

- * Free chlorine residual is determined by Hach DPD Method (analyte is not ELAP certified).
- ** Heterotrophic plate count is determined by method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result \leq 500 CFU/mL is equivalent to a measurable FCR.
- *** No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.
- ^a One sample on 1/7/2020 from site 21750 was unmeasurable due to color interference, and one result was missing on 1/6/2020 from site 40250 due to instrument issue.

† There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: faller Date: 2/6/2020
 Director: [Signature] Date: 2/6/2020

MICROBIOLOGICAL MONITORING

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Coliform Monitoring Results at Sample Sites near the First Service Connection
When Source Water Turbidity Exceeds 1.49 NTU**

January 2020

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform *	E.coli *

No official four-hour turbidity readings from Cat-Del source water were greater than 1.5 NTU this month.

* As determined by Colifert Quanti-Tray-18 Method (SM 9223B). Results expressed in "MPN /100mL."

DISTRIBUTION TURBIDITY MONITORING

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

Turbidity (NTU) Distribution Samples

January 2020

All Distribution Sites			
Samples	Min	Max	Average
1341	0.45	8.04	0.70

Analytical Method SM 2130 B

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	TURBIDITY	COMMENT
581	1/7/20	21750	Reg Stop	8.04	Max
1331	1/14/20	34700	Reg Stop	0.45	Min

The monthly average of all distribution samples is not to exceed 5 NTU.

COLOR MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points

January 2020

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Catskill/Delaware 1S03 (Tunnel 1)	7	8	7	7	7	6	7	6	7	7	7	7	7	6	6	6	7	7	7	6	7	7	7	6	5	6	6	7	7	6	7
Catskill/Delaware 1S03A (Tunnel 2)	8	8	7	7	6	6	7	7	7	7	7	8	7	7	6	6	7	7	6	7	7	7	7	6	7	6	7	6	7	7	8
Catskill/Delaware 1S03B (Tunnel 3)	7	7	7	7	7	6	6	7	6	7	7	8	7	6	6	6	6	6	7	6	6	6	6	6	8	7	7	7	7	7	7
Croton System 1SCL1 (a)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Croton System 1SCH3 (b)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Analytical Method SM 2120 B. Apparent color.

The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.

(a) Croton System offline as of 12/24/19 at 1SCL1.

(b) Croton System offline as of 12/4/19 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	31	5	8	7
Catskill/Delaware 1S03A (Tunnel 2)	31	6	8	7
Catskill/Delaware 1S03B (Tunnel 3)	31	6	8	7
Croton System 1SCL1 (a)	-	-	-	-
Croton System 1SCH3 (b)	-	-	-	-

Supervisor  Date 02/05/20

Director  Date 2/16/2020

FLUORIDE MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points

January 2020

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Catskill/Delaware 1S03 (Tunnel 1)	0.70	0.70	0.70	0.69	0.71	0.69	0.69	0.68	0.70	0.71	0.70	0.69	0.69	0.71	0.69	0.70	0.69	0.69	0.69	0.70	0.68	0.72	0.70	0.70	0.71	0.72	0.72	0.72	0.71	0.74	0.74	
Catskill/Delaware 1S03A (Tunnel 2)	0.70	0.70	0.71	0.69	0.70	0.69	0.69	0.69	0.70	0.72	0.70	0.69	0.69	0.71	0.69	0.70	0.69	0.70	0.69	0.71	0.68	0.76	0.71	0.72	0.72	0.72	0.73	0.72	0.73	0.74	0.74	
Catskill/Delaware 1S03B (Tunnel 3)	0.70	0.70	0.69	0.69	0.71	0.69	0.69	0.69	0.70	0.71	0.70	0.69	0.70	0.71	0.69	0.69	0.69	0.69	0.69	0.71	0.68	0.73	0.70	0.70	0.72	0.72	0.73	0.73	0.72	0.73	0.73	
Croton System 1SCL1 (a)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Croton System 1SCH3 (b)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System offline as of 12/24/19 at 1SCL1.

(b) Croton System offline as of 12/4/19 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	31	0.68	0.74	0.70
Catskill/Delaware 1S03A (Tunnel 2)	31	0.68	0.76	0.71
Catskill/Delaware 1S03B (Tunnel 3)	31	0.68	0.73	0.70
Croton System 1SCL1 (a)	-	-	-	-
Croton System 1SCH3 (b)	-	-	-	-

Supervisor



Date 02/06/20

Director



Date 2/6/2020