



Vincent Sapienza, P.E.  
Commissioner

Paul V. Rush, P.E.  
Deputy Commissioner  
Bureau of Water Supply  
prush@dep.nyc.gov

59-17 Junction Boulevard  
Flushing, NY 11373  
T: (845) 340-7800  
F: (845) 334-7175

May 10, 2021

Li Huang, P.E.  
New York City Department of Health and Mental Hygiene  
Environmental Sciences & Engineering  
42-09 28<sup>th</sup> Street, 14<sup>th</sup> Floor CN# 56  
Long Island City, NY 11101

Patrick Palmer  
New York State Department of Health  
Bureau of Water Supply Protection, NYC Watershed Section  
Empire State Plaza, Corning Tower, Room 1198  
Albany, NY 12237

Katie Lynch  
United States Environmental Protection Agency  
Clean Water Division - New York City Water Supply Protection Program  
290 Broadway, 24<sup>th</sup> Floor  
New York, New York 10007-1866

**RE: Monthly Water Quality Report for April 2021**

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **April 2021**. There was no well pumpage to distribution in the Groundwater System this month. Croton water was feeding into distribution for the month of April. In addition to the following list of compliance reports, electronic files containing compliance and non-compliance data for this month are being emailed to you.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
  - Summary
  - Positive Samples
  - Resamples
- Chlorine Residual Reports
  - Entry Point Online
  - Entry Point Daily Minimum
  - Heterotrophic Plate Count
  - Monthly Summary
- Distribution Turbidity Reports
  - Distribution Turbidity Report
  - Source Water > 1.49 NTU Table
- Color Entry Point Report

- Fluoride Reports
  - Fluoride Entry Point Report
  - Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

## FAD REQUIREMENTS

### **1. Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):**

**Requirements met.** The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from November 1, 2020 to April 30, 2021. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 0.00% for the Catskill/Delaware System for this time period.

### **2. Raw Water Turbidity (Section 141.71(a)(2)):**

**Requirements met.** The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest reported turbidity value was 1.1 NTU on the Catskill/Delaware System for the month.

### **3. Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):**

**Requirements met.** As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual values for Catskill/Delaware System entry points from site 1S03 (Tunnel 1) was 0.48 mg/L, 1S03A (Tunnel 2) was 0.67 mg/L, and 1S03B (Tunnel 3) was 0.56 mg/L.

The Croton Filtration Plant was online throughout the month of April. The minimum daily free chlorine residual value for Croton entry points from site 1SCL1 (Low Service) was 0.54 mg/L and 1SCH3 (High Service) was 0.33 mg/L.

### **4. Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):**

**Requirements met.** All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.03 mg/L.

A total of 1247 distribution samples were tested for free chlorine residual during the month. For all monthly distribution sites free chlorine residual ranged from 0.03 to 1.25 mg/L, and averaged 0.53 mg/L.

### **5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):**

**Requirements met.** The results for the first quarter of 2021 were included in the report dated March 10, 2021 (For the February 2021 reporting period).

**6. Total Coliform Monitoring (Section 141.71(b)(5)):**

**Requirements met.** The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 805 compliance samples were tested for total coliform during this period. HPC were all  $\leq 500$  CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC  $> 500$  CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, one (1) sample collected on 4/10/2021 tested positive for total coliform and negative for *E. coli*.

- A sample collected on 4/10/2021 from Site 77850 (sample station, north side 90<sup>th</sup> Ave, between 179<sup>th</sup> and 180<sup>th</sup> Street, Queens) was positive for total coliform. Resampling on 4/12/2021 was coliform negative at all locations.

**OTHER WATER QUALITY MONITORING**

**7. Microbiological Monitoring:**

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity  $> 1.49$  NTU, was not required this month, but all of these samples were negative for total coliform and *E. coli*.

The analyses of 442 distribution Operational samples resulted in no samples testing positive for total coliform and no *E. coli* were detected.

The analyses of 239 Pre-Finished samples resulted in no samples testing positive for total coliform and no *E. coli* were detected.

The analyses of 360 Autosampler Pre-finished samples resulted in seven (7) samples testing positive for total coliform. No *E. coli* were detected.

**8. Distribution Turbidity Monitoring:**

For distribution sites, turbidity ranged from  $< 0.10$  to 2.20 NTU and averaged 0.76 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

**9. Color Monitoring:**

The MCL of 15 units for color was met for the month. Daily analyses of entry point samples (150 samples in total), produced monthly average color values of 6 units for site 1S03 (Tunnel 1), 7 units for sites 1S03A (Tunnel 2) and 1S03B (Tunnel 3), and 4 units for sites 1SCL1 (Croton Low Service) and 1SCH3 (Croton High Service).

**10. Volatile Organic/TTHM/HAA5 Monitoring:**

**Monthly Results:** Twenty (20) distribution and five (5) entry point samples were collected for volatile organic contaminant (VOC) analysis. All VOC samples from distribution sites and entry points were below detection. Twenty (20) TTHM distribution samples were collected ranging from 9.7  $\mu\text{g/L}$  to 40  $\mu\text{g/L}$ . Five (5) TTHM entry point samples were collected ranging from 5.4  $\mu\text{g/L}$  to 38  $\mu\text{g/L}$ . Twenty (20) HAA5 distribution samples were collected ranging from 8.2  $\mu\text{g/L}$  to 66  $\mu\text{g/L}$ . Five (5) HAA5 entry point samples were collected ranging from 6.0  $\mu\text{g/L}$  to 59  $\mu\text{g/L}$ .

**11. Semivolatile and Other Organic Chemicals/parameters:**

EPA Method 525.3 monitoring for 112 compounds of specified and unspecified organic parameters was conducted on April 12, 2021 at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the Croton Low Service entry point (1SCL1) and Croton High Service entry point (1SCH3), and six (6) distribution points. All semi-volatile organic contaminant samples were below detection limits.

Monitoring for Method 505 organohalide pesticides was conducted on April 26, 2021 at three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), and at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3). All results were below detection.

Quarterly monitoring for the two compounds 1,2-Dibromo-3-chloropropane and 1,2-Dibromoethane by EPA Method 524.3 SIM, determination of micro extractables, was conducted at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3), and one (1) distribution sampling site (50250) on April 13, 2021. All sample results were below detection.

**12. Fluoride Monitoring:**

Daily analyses of entry point samples (150 samples in total), produced monthly average fluoride levels of 0.70 mg/L for sites 1S03 (Tunnel 1) and 1S03B (Tunnel 3), 0.69 mg/L for site 1S03A (Tunnel 2), 0.75 mg/L for site 1SCL1 (Croton Low Service), and 0.80 mg/L for site 1SCH3 (Croton High Service). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

**13. Other Monitoring:**

Monitoring for Taste and Odor (T&O) compounds was conducted in April on 20 samples from New Croton Reservoir, Jerome Park Reservoir, and the Croton Filtration Plant by our contract laboratory. Results for Geosmin ranged from ND to 4.3 ng/L, and for 2-Methylisoborneol (MIB) from ND to 18 ng/L. Contract laboratory reports of available data are included as pdf files with the other electronic files for this report. Going forward, Kingston Laboratory will be analyzing samples for Geosmin and MIB, and the data will be distributed separately via email.

Please feel free to contact me at (718) 595-5367 or [sfreud@dep.nyc.gov](mailto:sfreud@dep.nyc.gov) if you would like to discuss any of this information in greater detail.

Sincerely,



Salome Freud  
Deputy Director of Water Quality & Innovation

**Enclosure**

*Monthly Water Quality Report – April 2021*

cc:

by email

Mr. Andrew Brunsten, Inspector General for NYCDEP

Mr. Kenneth Kosinski, NYSDEC

Mr. David Kvinge, Westchester County Water Agency

Mr. Huan Li, NYCDOHMH

Ms. Millie Magraw, Westchester County Water Agency

Mr. Trevor McProud, NYCDOHMH

Mr. Andy Tse, NYSDOH

Mr. Steven Zahn, NYSDEC – Region 2

***TABLE OF CONTENTS FOR DATA FILES***

## April 2021 Monthly Water Quality Report

### Microbiological Reports:

Summary of Coliform Compliance Samples

Coliform Positive Compliance Samples

Coliform Resample for Positive Compliance Samples

Summary of Coliform Operational Samples

Coliform Positive Operational Samples

Coliform Resample for Positive Distribution Operational Samples

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU

All Microbiological Results

### Free Chlorine Residual (FCR) Reports:

Entry Point FCR On-Line Monitoring Results

Daily Minimum FCR at Entry Points

FCR and Heterotrophic Plate Count (HPC) Compliance Samples

FCR and HPC of Operational Samples

Summary of FCR of Distribution Samples (Monthly)

FCR of all Distribution Sites

### Turbidity Reports:

Summary of Turbidity of Distribution Samples

Turbidity of all Distribution Sites

### Color Reports:

Color for Entry Point Samples

### Fluoridation Reports:

Summary of Fluoride Levels of Distribution Samples

Fluoride Daily Entry Point Report for Surface Water Systems

Fluoride of all Distribution Sites

### Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP) Reports:

Total Trihalomethanes (TTHM) & VOC Monthly Report

Organohalide Pesticides EPA Method 505 Quarterly Report

Microextractables of EPA Method 524.3/SIM Report

Semivolatile of EPA Method 525 Monthly Report

Haloacetic Acids (HAA5) Monthly Report

Taste & Odor Sampling Reports from EEA Lab

Summary of EPA Organic Method Reports

### Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:

All parameters for April 2021

(NYC\_Micro\_Summary\_Compliance\_202104.xls)

(NYC\_Micro\_Compliance\_Positives\_202104.xls)

(NYC\_Micro\_Compliance\_Resamples\_202104.xls)

(NYC\_Micro\_Operational\_202104.pdf)

(NYC\_Micro\_Summary\_Operational\_202104.xls)

(NYC\_Micro\_Operational\_202104.pdf)

(NYC\_Micro\_Operational\_Positives\_202104.xls)

(NYC\_Micro\_Operational\_202104.pdf)

(NYC\_Micro\_Operational\_Resamples\_202104.xls)

(NYC\_EP\_Coliform\_For\_Source\_Turb\_GT\_149\_202104.snp)

(NYC\_Monthly\_Alldata\_202104.xls\Micro)

(Entry\_Shaft\_Ci2\_Online\_202104\_Fig.pdf)

(Croton\_Entry\_Shaft\_Ci2\_Online\_202104\_Fig.pdf)

(Entry\_Shaft\_Ci2\_Online\_202104\_Tbl.pdf)

(Croton\_Entry\_Shaft\_Ci2\_Online\_202104\_Tbl.pdf)

(NYC\_Micro\_Summary\_FCR\_&\_HPC\_Compliance\_202104.xls)

(NYC\_Micro\_Summary\_FCR\_&\_HPC\_Operational\_202104.xls)

(NYC\_Micro\_Operational\_202104.pdf)

(NYC\_FCR\_Monthly\_Summary\_202104.xls)

(NYC\_FCR\_Monthly\_Alldata\_202104.xls)

(NYC\_Turbidity\_Monthly\_Summary\_202104.xls)

(NYC\_Turbidity\_Monthly\_Alldata\_202104.xls)

(Entry\_Point\_Color\_Monthly\_202104.xls)

(NYC\_Fluoride\_Monthly\_Summary\_202104.xls)

(Entry\_Point\_Fluoride\_Monthly\_202104.xls)

(NYC\_Fluoride\_Monthly\_Alldata\_202104.xls)

(NYC\_TTHM\_&\_VOC\_Rpt\_202104.xls)

(NYC\_505\_Quarterly\_Rpt\_2021Q2.xls)

(NYC\_524\_3-SIM\_Rpt\_202104.xls)

(NYC\_SOC\_Rpt\_202104.xls)

(NYC\_HAA5\_Monthly\_Rpt\_202104.xls)

(927398\_T&O\_Sample\_20210405.pdf, 927441\_T&O\_Sample\_20210405.pdf,

928930\_T&O\_Sample\_20210412.pdf, 928937\_T&O\_Sample\_20210412.pdf)

(NYC\_VOC\_HAA5\_525\_Rpt\_202104.pdf)

(NYC\_Monthly\_Alldata\_202104.xls)

***RAW WATER FECAL COLIFORM CONCENTRATIONS***  
***(FAD Requirement)***





**NYCDEP Division of Watershed Water Quality Operations**  
**Catskill/Delaware System Raw Water Fecal Coliform Compliance Report**

Hawthorne Laboratory, ELAP Lab ID No. 10771  
 15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson  
 914-345-4973

**Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water** **Period: 02/19 To: 04/21**

Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
2-19	28	0	0.00	0.00
3-19	31	0	0.00	0.00
4-19	30	0	0.00	0.00
5-19	31	0	0.00	0.00
6-19	30	0	0.00	0.00
7-19	31	0	0.00	0.00
8-19	31	0	0.00	0.00
9-19	30	0	0.00	0.00
10-19	31	0	0.00	0.00
11-19	30	0	0.00	0.00
12-19	31	0	0.00	0.00
1-20	31	0	0.00	0.00
2-20	29	0	0.00	0.00
3-20	31	0	0.00	0.00
4-20	30	0	0.00	0.00
5-20	31	0	0.00	0.00
6-20	30	0	0.00	0.00
7-20	31	0	0.00	0.00
8-20	31	1	3.23	0.54
9-20	30	1	3.33	1.09
10-20	31	0	0.00	1.09
11-20	30	0	0.00	1.09
12-20	31	0	0.00	1.09
1-21	31	0	0.00	1.09
2-21	28	0	0.00	0.55
3-21	31	0	0.00	0.00
4-21	30	0	0.00	0.00

*D. W. Robinson*

5/4/21

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations 5/4/2021

***RAW WATER TURBIDITY***  
***(FAD Requirement)***



# NYCDEP Division of Watershed Water Quality Operations

## Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771  
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson  
914-345-4973

**Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water** Period: April, 2021

Date	Turbidity (NTU)						Total Coliform (Colonies per 100 mL)	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM		
4/1/21	0.90	0.90	1.0	0.90	1.0	0.95	E3	<1
4/2/21	0.90	1.0	1.0	0.90	0.85	0.85	E6	<1
4/3/21	0.85	0.85	0.90	0.90	0.90	0.90	E3	E1
4/4/21	0.90	0.90	0.95	0.90	0.85	0.90	E1	<1
4/5/21	0.85	0.90	0.85	0.80	0.85	0.85	E2	<1
4/6/21	0.85	0.95	0.90	0.85	0.85	0.85	E12	<1
4/7/21	0.85	0.85	0.85	1.0	0.90	0.90	E8	<1
4/8/21	0.90	0.85	0.85	1.0	0.85	0.85	E8	<1
4/9/21	0.80	0.90	0.85	0.85	0.90	0.90	E5	<1
4/10/21	0.85	0.90	0.90	0.85	0.85	0.90	E6	<1
4/11/21	0.85	0.85	0.85	0.90	0.90	0.85	<1	<1
4/12/21	1.0	0.85	1.1	0.75	0.80	0.80	E6	<1
4/13/21	0.75	0.80	0.80	0.80	0.85	0.90	E15	<1
4/14/21	0.85	0.80	0.80	0.70	0.75	0.75	E4	<1
4/15/21	0.70	0.80	0.80	0.70	0.70	0.70	E3	<1
4/16/21	0.75	0.75	0.75	0.75	0.80	0.80	E17	E8
4/17/21	0.80	0.80	0.80	0.80	0.80	0.75	E5	E1
4/18/21	0.75	0.75	0.70	0.75	0.80	0.80	E10	E1
4/19/21	0.75	0.75	0.75	0.75	0.70	0.75	E2	<1
4/20/21	0.75	0.75	0.80	0.80	0.80	0.80	E5	<1
4/21/21	0.85	0.80	0.80	0.75	0.70	0.70	E12	<1
4/22/21	0.70	0.65	0.85	0.75	0.80	0.75	E3	<1
4/23/21	0.80	0.80	0.80	0.70	0.75	0.70	23	<1
4/24/21	0.80	0.70	0.75	0.70	0.75	0.75	E2	<1
4/25/21	0.75	0.75	0.70	0.75	0.65	0.75	E12	<1
4/26/21	0.70	0.75	0.65	0.75	0.70	0.70	E8	E1
4/27/21	0.75	0.70	0.65	0.80	0.75	0.80	E6	<1
4/28/21	0.85	0.75	0.70	0.65	0.75	0.70	E5	<1
4/29/21	0.75	0.65	0.65	0.75	0.75	0.70	E2	<1
4/30/21	0.70	0.80	0.80	0.75	0.70	0.85	E11	<1

∴ Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error,  
E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with dilution based value

1. Does a raw water turbidity M & R violation exist?  Yes  No
2. Does the turbidity reading exceed 5 NTU at any time?  Yes  No  
*If yes, check for MCL violation, and notify state by the end of the next business day.*
3. Minimum number of microbiological samples required per week: 5
4. A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

*D.W. Robins*

*5/4/21*

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

5/4/2021

All results that fall within the scope of the NELAP program meet that program's requirements unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 05/04/2021 9:41 am



# NYCDEP Division of Watershed Water Quality Operations

## Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771  
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson  
914-345-4973

### Data Qualifiers and Additional Notes

Period: April 2021

Date/Time	Site	Analytes Affected	Qualifier
4/8/21 11:55	DEL18DT	Turbidity	The duplicate analysis was not within the control limits.

### Analytical Methods

Coliform, Fecal	-	SM 9222D (2006)
Coliform, Total	-	SM 9222B (2006)
Turbidity	-	SM 2130B (01)

***ENTRY POINT CHLORINE RESIDUAL***  
***(FAD Requirement)***

**Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System**

Tunnel No.1 (Catskill) at Shaft 3			Tunnel No.2 (Delaware) at Shaft 3A			Tunnel No.3 (Cat/Del) at Shaft 3B		
Date	MinCl_1DL	Remark 1	Date	MinCl_2DL	Remark 2	Date	MinCl_3DL	Remark 3
04/01/21	0.64		04/01/21	0.76		04/01/21	0.69	
04/02/21	0.64		04/02/21	0.71		04/02/21	0.58	
04/03/21	0.66		04/03/21	0.76		04/03/21	0.61	
04/04/21	0.64		04/04/21	0.73		04/04/21	0.63	
04/05/21	0.64		04/05/21	0.74		04/05/21	0.64	
04/06/21	0.62		04/06/21	0.77		04/06/21	0.64	
04/07/21	0.57		04/07/21	0.72		04/07/21	0.65	
04/08/21	0.66		04/08/21	0.78		04/08/21	0.67	
04/09/21	0.66		04/09/21	0.74		04/09/21	0.56	
04/10/21	0.66		04/10/21	0.74		04/10/21	0.67	
04/11/21	0.67		04/11/21	0.75		04/11/21	0.64	
04/12/21	0.59		04/12/21	0.72		04/12/21	0.67	
04/13/21	0.58		04/13/21	0.77		04/13/21	0.65	
04/14/21	0.64		04/14/21	0.67		04/14/21	0.65	
04/15/21	0.65		04/15/21	0.72		04/15/21	0.66	
04/16/21	0.64		04/16/21	0.69		04/16/21	0.62	
04/17/21	0.61		04/17/21	0.70		04/17/21	0.58	
04/18/21	0.63		04/18/21	0.74		04/18/21	0.59	
04/19/21	0.65		04/19/21	0.77		04/19/21	0.66	
04/20/21	0.60		04/20/21	0.76		04/20/21	0.61	
04/21/21	0.62		04/21/21	0.78		04/21/21	0.66	
04/22/21	0.53		04/22/21	0.77		04/22/21	0.64	
04/23/21	0.60		04/23/21	0.74		04/23/21	0.60	
04/24/21	0.63		04/24/21	0.74		04/24/21	0.64	
04/25/21	0.67		04/25/21	0.76		04/25/21	0.66	
04/26/21	0.48		04/26/21	0.78		04/26/21	0.62	
04/27/21	0.62		04/27/21	0.78		04/27/21	0.68	
04/28/21	0.64		04/28/21	0.70		04/28/21	0.71	
04/29/21	0.58		04/29/21	0.72		04/29/21	0.60	
04/30/21	0.56		04/30/21	0.76		04/30/21	0.64	




Legend: MinCl\_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

MinCl\_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

MinCl\_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.



New York City Department of Environmental Protection  
 Bureau of Water Supply  
**City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results**

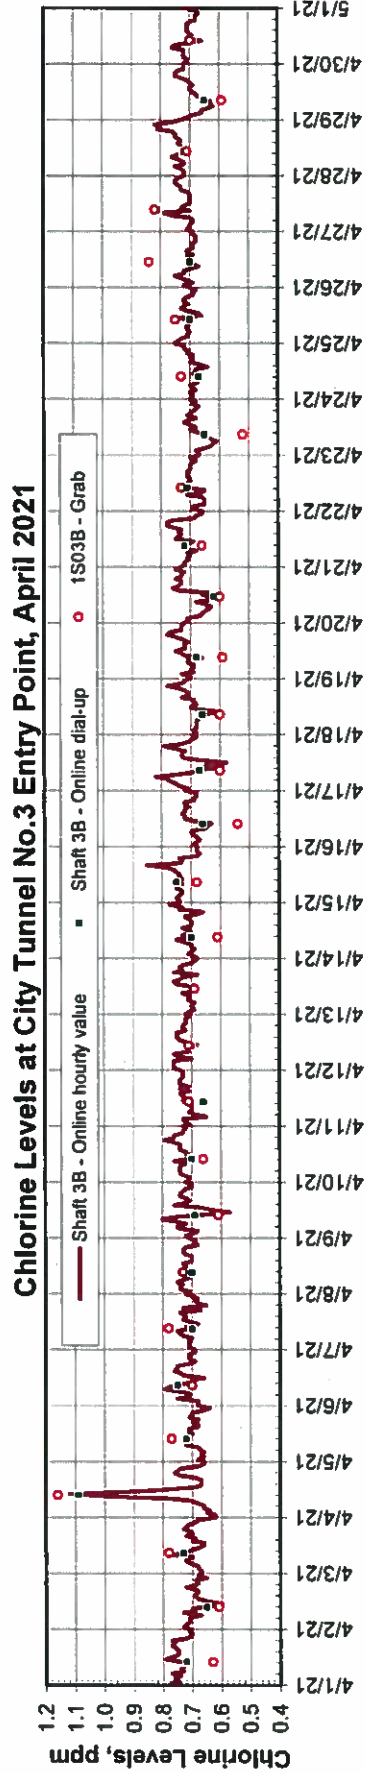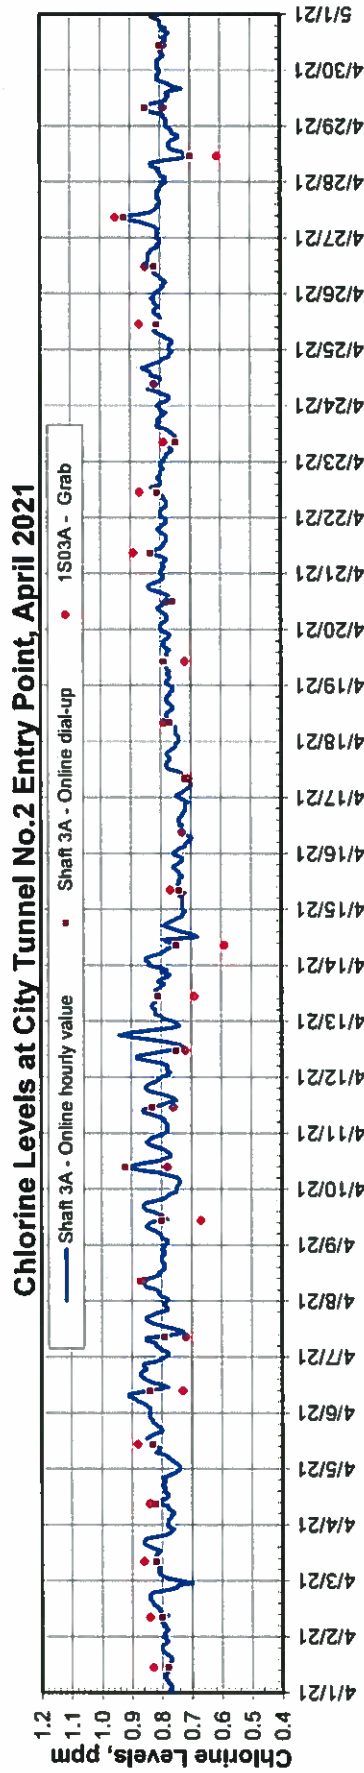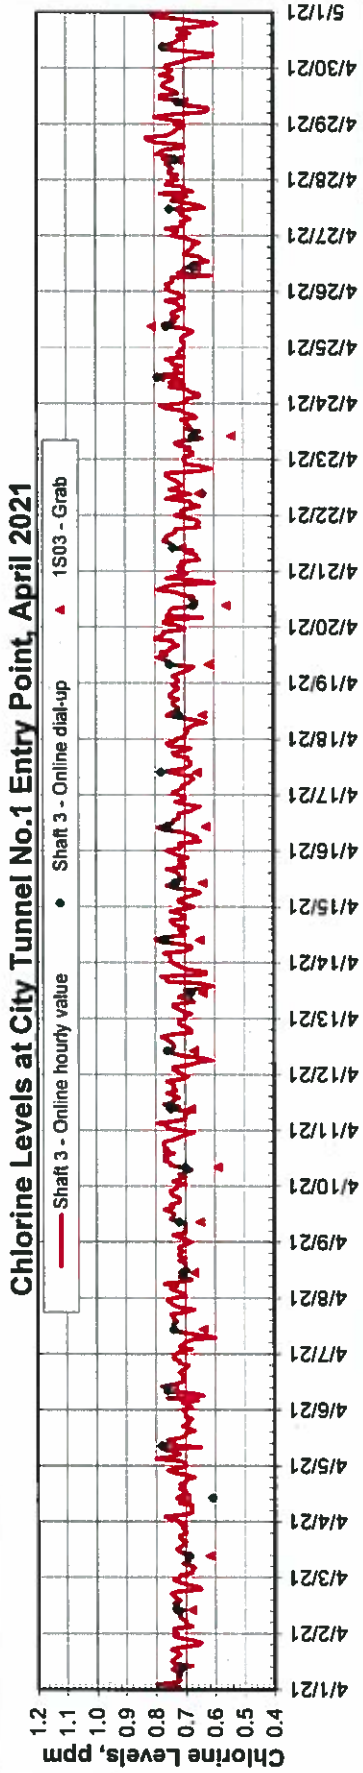

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained above 0.2 ppm at all times. Since 3/14/2021 grab and online dial-up readings were recorded in Eastern Daylight Time.

### Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points

Low Service			High Service		
Date	MinCl_1SCL1	Remark 1	Date	MinCl_1SCH3	Remark 2
04/01/21	0.69		04/01/21	0.56	
04/02/21	0.69		04/02/21	0.57	
04/03/21	0.71		04/03/21	0.57	
04/04/21	0.71		04/04/21	0.58	
04/05/21	0.67		04/05/21	0.60	
04/06/21	0.58		04/06/21	0.58	
04/07/21	0.62		04/07/21	0.54	
04/08/21	0.61		04/08/21	0.46	
04/09/21	0.64		04/09/21	0.42	
04/10/21	0.62		04/10/21	0.46	
04/11/21	0.56		04/11/21	0.46	
04/12/21	0.60		04/12/21	0.41	
04/13/21	0.62		04/13/21	0.44	
04/14/21	0.62		04/14/21	0.46	
04/15/21	0.58		04/15/21	0.33	
04/16/21	0.60		04/16/21	0.36	
04/17/21	0.60		04/17/21	0.56	
04/18/21	0.54		04/18/21	0.56	
04/19/21	0.58		04/19/21	0.51	
04/20/21	0.61		04/20/21	0.53	
04/21/21	0.62		04/21/21	0.54	
04/22/21	0.60		04/22/21	0.54	
04/23/21	0.62		04/23/21	0.52	
04/24/21	0.61		04/24/21	0.56	
04/25/21	0.62		04/25/21	0.54	
04/26/21	0.55		04/26/21	0.53	
04/27/21	0.64		04/27/21	0.51	
04/28/21	0.60		04/28/21	0.52	
04/29/21	0.62		04/29/21	0.56	
04/30/21	0.60		04/30/21	0.53	

Legend: MinCl\_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.

MinCl\_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.


Note: Croton water fed to High Service was determined by specific conductance greater than 150 µS/cm.




New York City Department of Environmental Protection  
Bureau of Water Supply

**Croton Distribution Entry Point Residual Chlorine Continuous Monitoring Results**

**Croton Low Service Entry Point Chlorine Levels, April 2021**

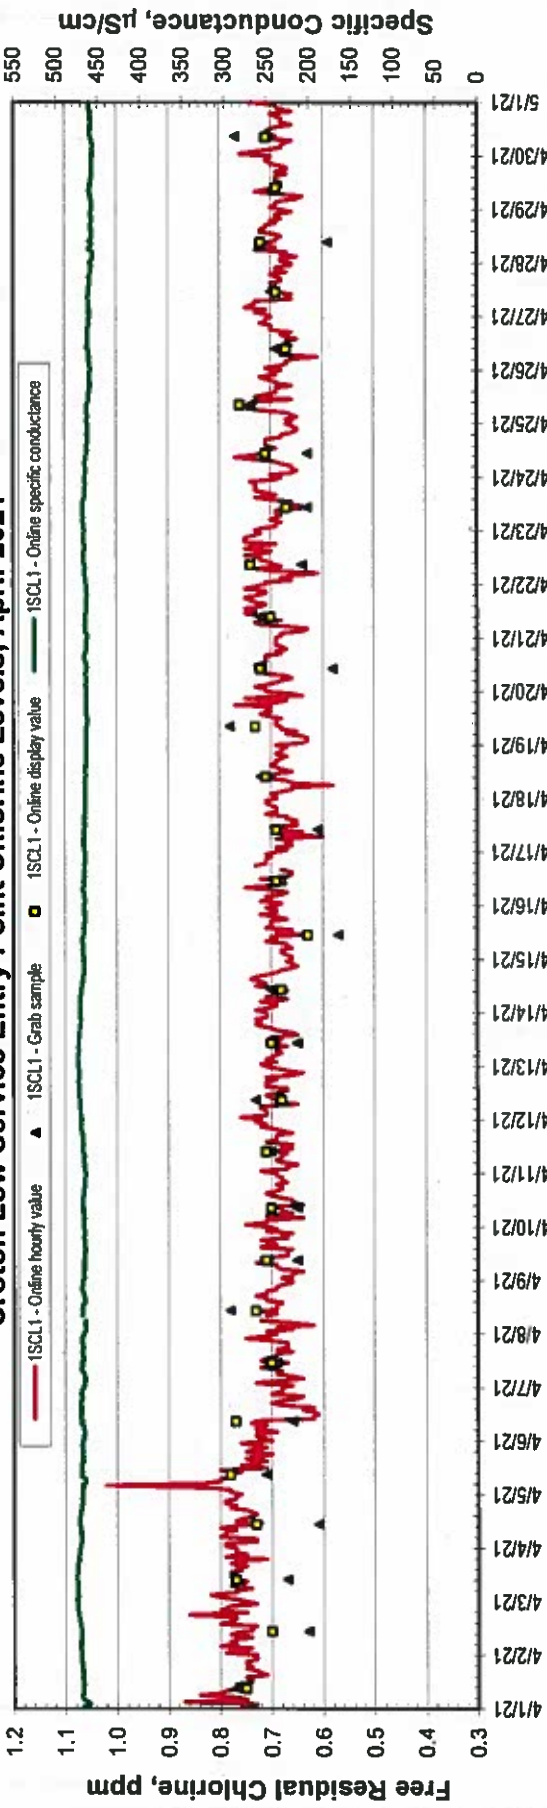

**Croton High Service Entry Point Chlorine Levels, April 2021**

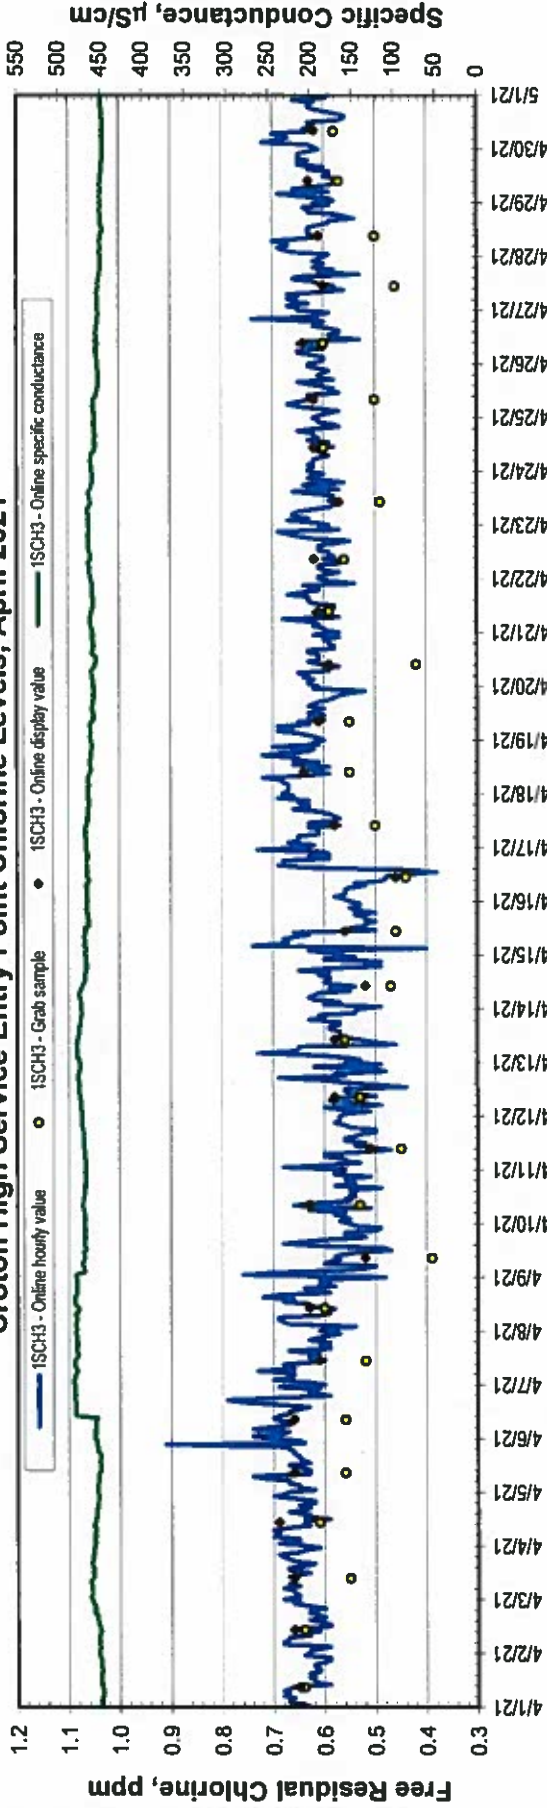

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 3/14/21, all grab and online display readings were recorded in Eastern Daylight Saving Time.

***DISTRIBUTION SYSTEM DISINFECTION RESIDUAL***  
***(FAD Requirement)***

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Residual Chlorine (mg/L) Distribution Samples**

April 2021

All Distribution Sites			
Samples	Min	Max	Average
1247	0.03	1.25	0.53

Hach DPD Method (analyte is not ELAP certified)

Sample Number	Sample Date	Sample Site Index	Location Type	Residual Chlorine	Comment
13315	4/28/21	1SCL1	Reg Stop	1.25	Max
11931	4/16/21	43900	Reg Stop	0.03	Min

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

**TOTAL COLIFORM MONITORING**  
*(FAD Requirement)*

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Summary of Results for Microbiological Quality  
Compliance Samples**

4/1/2021 to 4/30/2021

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	131	131	0	0	0.0%
Brooklyn	70	195	195	0	0	0.0%
Manhattan	57	163	163	0	0	0.0%
Queens ***	79	229	229	1	0	0.4%
Staten Island	29	87	87	0	0	0.0%
Ground Water Supply ***	-	-	-	-	-	-
<b>Total</b>	<b>281</b>	<b>805</b>	<b>805</b>	<b>1</b>	<b>0</b>	<b>0.1%</b>

\* As determined by Colliert Quanti-Tray-18 Method (SM 9223 B).

\*\* If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.

\*\*\* There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: *Laura J. Ford* Date: 05/05/2021

Director: *[Signature]* Date: 05/05/2021





REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality  
Free Chlorine Residual and Heterotrophic Plate Count  
Compliance Samples

4/1/2021 to 4/30/2021

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 CFU/mL ***	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 CFU/mL ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	131	131	97	0	0	-	0	0.0%
Brooklyn	70	195	195	143	1	0	-	0	0.0%
Manhattan	57	163	163	120	1	0	-	0	0.0%
Queens †	79	229	229	172	18	0	-	0	0.0%
Staten Island	29	87	87	66	7	0	-	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	-	-	-
Total	281	805	805	598	27	0	-	0	0.0%

\* Free chlorine residual is determined by Hach DPD Method (analyte is not ELAP certified).

\*\* Heterotrophic plate count is determined by method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result ≤ 500 CFU/mL is equivalent to a measurable FCR.

\*\*\* No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.

† There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: *Lupe J. Ford* Date: 05/05/2021

Director: *ATM* Date: 5/5/2021



***MICROBIOLOGICAL MONITORING***

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Coliform Monitoring Results at Sample Sites near the First Service Connection  
When Source Water Turbidity Exceeds 1.49 NTU**

**April 2021**

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform *	E.coli *

**No official four-hour turbidity readings from Cat-Del source water were greater than 1.5 NTU this month.**

**\* As determined by Colifert Quanti-Tray-18 Method (SM 9223B). Results expressed in "MPN /100mL."**

***DISTRIBUTION TURBIDITY MONITORING***

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Turbidity (NTU) Distribution Samples**

**April 2021**

All Distribution Sites			
Samples	Min	Max	Average
1247	<0.10	2.20	0.76

Analytical Method SM 2130 B

Sample Number	Sample Date	Sample Site Index	Location Type	Turbidity	Comment
12727	4/23/21	11350	Reg Stop	2.20	Max
11148	4/9/21	1SCH3	Reg Stop	<0.10	Min
11243	4/10/21	1SCH3	Reg Stop	<0.10	Min

The monthly average of all distribution samples is not to exceed 5 NTU.

***COLOR MONITORING***

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION  
 BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points

April 2020

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
Catskill/Delaware 1S03 (Tunnel 1)	7	6	6	6	7	8	6	6	7	6	7	7	7	6	6	6	5	6	7	7	6	7	7	7	6	6	6	7	7	6
Catskill/Delaware 1S03A (Tunnel 2)	7	6	6	7	7	7	7	6	7	7	6	7	7	7	6	7	7	7	7	7	6	7	7	6	6	6	6	7	7	6
Catskill/Delaware 1S03B (Tunnel 3)	7	7	7	6	7	8	7	6	7	7	6	7	7	6	6	6	7	7	7	7	7	7	7	7	6	6	7	7	7	6
Croton System 1SCL1 (a)	3	4	4	4	4	3	4	4	4	4	4	4	4	4	4	4	3	3	4	3	4	3	3	4	4	4	4	3	4	4
Croton System 1SCH3 (b)	3	4	4	4	3	3	4	4	4	4	4	4	4	4	4	4	3	3	4	3	3	3	3	4	4	4	4	3	4	4

Analytical Method SM 2120 B, Apparent color.

The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.

(a) Croton System online as of 10/27/20 at 1SCL1.

(b) Croton System online as of 3/17/21 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	30	5	8	6
Catskill/Delaware 1S03A (Tunnel 2)	30	6	7	7
Catskill/Delaware 1S03B (Tunnel 3)	30	6	8	7
Croton System 1SCL1 (a)	30	3	4	4
Croton System 1SCH3 (b)	30	3	4	4

Supervisor  Date 05/05/2021

Director  Date 5/6/2021

***FLUORIDE MONITORING***

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points

April 2021

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
Catskill/Delaware 1S03 (Tunnel 1)	0.73	0.72	0.72	0.70	0.70	0.72	0.72	0.72	0.72	0.72	0.72	0.70	0.70	0.70	0.71	0.69	0.69	0.56	0.66	0.66	0.65	0.68	0.67	0.70	0.72	0.71	0.74	0.75	0.75	0.74
Catskill/Delaware 1S03A (Tunnel 2)	0.73	0.71	0.71	0.70	0.70	0.72	0.72	0.72	0.72	0.72	0.67	0.69	0.73	0.70	0.67	0.67	0.66	<0.30	0.71	0.75	0.69	0.67	0.73	0.74	0.74	0.72	0.75	0.75	0.75	0.74
Catskill/Delaware 1S03B (Tunnel 3)	0.74	0.71	0.72	0.70	0.70	0.72	0.71	0.73	0.72	0.72	0.68	0.70	0.70	0.70	0.68	0.67	0.67	0.33	0.68	0.68	0.69	0.68	0.73	0.73	0.74	0.72	0.74	0.74	0.75	0.75
Croton System 1SCL1 (a)	0.80	0.76	0.80	0.75	0.74	0.75	0.77	0.74	0.77	0.76	0.74	0.77	0.74	0.73	0.75	0.74	0.73	0.75	0.74	0.75	0.72	0.79	0.76	0.75	0.71	0.74	0.73	0.72	0.74	0.76
Croton System 1SCH3 (b)	0.81	0.81	0.80	0.80	0.80	0.80	0.81	0.79	0.80	0.79	0.81	0.84	0.77	0.78	0.83	0.82	0.78	0.77	0.79	0.81	0.80	0.79	0.79	0.79	0.80	0.77	0.78	0.75	0.78	0.80

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System online as of 10/27/20 at 1SCL1.

(b) Croton System online as of 3/17/21 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	30	0.56	0.75	0.70
Catskill/Delaware 1S03A (Tunnel 2)	30	<0.30	0.75	0.69
Catskill/Delaware 1S03B (Tunnel 3)	30	0.33	0.75	0.70
Croton System 1SCL1 (a)	30	0.71	0.80	0.75
Croton System 1SCH3 (b)	30	0.75	0.84	0.80

Supervisor 

Date 05/05/2021

Director 

Date 5/6/2021