



Vincent Sapienza, P.E.
Commissioner

Paul V. Rush, P.E.
Deputy Commissioner
Bureau of Water Supply
prush@dep.nyc.gov

59-17 Junction Boulevard
Flushing, NY 11373
T: (845) 340-7800
F: (845) 334-7175

February 9, 2021

Li Huang, P.E.
New York City Department of Health and Mental Hygiene
Environmental Sciences & Engineering
42-09 28th Street, 14th Floor CN# 56
Long Island City, NY 11101

Patrick Palmer
New York State Department of Health
Bureau of Water Supply Protection, NYC Watershed Section
Empire State Plaza, Corning Tower, Room 1198
Albany, NY 12237

Katie Lynch
United States Environmental Protection Agency
Clean Water Division - New York City Water Supply Protection Program
290 Broadway, 24th Floor
New York, New York 10007-1866

RE: Monthly Water Quality Report for January 2021

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **January 2021**. There was no well pumpage to distribution in the Groundwater System this month. Croton water was feeding into distribution for the month of January. In addition to the following list of compliance reports, electronic files containing compliance and non-compliance data for this month are being emailed to you.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
 - Summary
 - Positive Samples
 - Resamples
- Chlorine Residual Reports
 - Entry Point Online
 - Entry Point Daily Minimum
 - Heterotrophic Plate Count
 - Monthly Summary
- Distribution Turbidity Reports
 - Distribution Turbidity Report
 - Source Water > 1.49 NTU Table
- Color Entry Point Report

Monthly Water Quality Report – January 2021

- Fluoride Reports
 - Fluoride Entry Point Report
 - Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

FAD REQUIREMENTS

1. Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):

Requirements met. The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from August 1, 2020 to January 31, 2020. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 1.09% for the Catskill/Delaware System for this time period.

2. Raw Water Turbidity (Section 141.71(a)(2)):

Requirements met. The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest reported turbidity value was 1.1 NTU on the Catskill/Delaware System for the month.

3. Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):

Requirements met. As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual value for entry point readings for the Catskill/Delaware System from sites 1S03 (Tunnel 1) was 0.59 mg/L, 1S03A (Tunnel 2) was 0.69 mg/L, and 1S03B (Tunnel 3) was 0.62 mg/L.

The Croton Filtration Plant was online and continuously feeding the Croton Low Service and High Service entry points for the month of January. The minimum daily free chlorine residual value for Croton entry point reading from site 1SCL1 (Low Service) was 0.45 mg/L and from site 1SCH3 (High Service) was 0.43 mg/L.

4. Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):

Requirements met. All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.03 mg/L.

A total of 1312 distribution samples were tested for free chlorine residual this month. For all monthly distribution sites free chlorine residual ranged from 0.03 to 1.03 mg/L, and averaged 0.59 mg/L.

Monthly Water Quality Report – January 2021

5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):

Requirements met. The results for the fourth quarter of 2020 were included in the report dated December 10, 2020 (for the November 2020 reporting period).

6. Total Coliform Monitoring (Section 141.71(b)(5)):

Requirements met. The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 823 compliance samples were tested for total coliform during this period. HPC were all ≤ 500 CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC > 500 CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, no samples tested positive for total coliform, and all samples were negative for *E. coli*.

OTHER WATER QUALITY MONITORING

7. Microbiological Monitoring:

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity > 1.49 NTU, was not required this month, but all of these samples were negative for total coliform and *E. coli*.

The analyses of 489 distribution Operational samples resulted in no samples testing positive for total coliform and no *E. coli* were detected.

The analyses of 248 Pre-Finished samples resulted in no samples testing positive for total coliform and no *E. coli* were detected.

The analyses of 490 Autosampler Pre-finished samples resulted in one (1) sample testing positive for total coliform. No *E. coli* were detected.

8. Distribution Turbidity Monitoring:

For distribution sites, turbidity ranged from < 0.10 to 3.29 NTU and averaged 0.63 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

9. Color Monitoring:

The MCL of 15 units for color was met for the month. Daily analyses of entry point samples (155 samples in total), produced monthly average color values of 6 units for sites 1S03 (Tunnel 1), 7 units for sites 1S03A (Tunnel 2) and 1S03B (Tunnel 3), and 4 units for sites 1SCL1 (Croton Low Service) and 1SCH3 (Croton High Service).

10. Volatile Organic/TTHM/HAA5 Monitoring:

Monthly Results: Twenty (20) distribution and five (5) entry point samples were collected for volatile organic contaminant (VOC) analysis. All VOC samples from distribution sites and entry points were below detection. Twenty (20) TTHM distribution samples were collected ranging from 9.4 $\mu\text{g/L}$ to 30 $\mu\text{g/L}$. Five (5) TTHM entry point samples were collected ranging from 5.6 $\mu\text{g/L}$ to 17 $\mu\text{g/L}$. Twenty (20) HAA5 distribution samples were collected ranging from 8.2 $\mu\text{g/L}$ to 41 $\mu\text{g/L}$. Five (5) HAA5 entry point samples were collected ranging from 6.6 $\mu\text{g/L}$ to 27 $\mu\text{g/L}$.

Monthly Water Quality Report – January 2021

11. Semivolatile and Other Organic Chemicals/parameters:

Quarterly monitoring for the two compounds 1,2-Dibromo-3-chloropropane and 1,2-Dibromoethane by EPA Method 524.3 SIM, determination of micro extractables, was conducted at the four (4) Catskill/Delaware entry points (1S07, 1S03A, 1S03B, and 1S03), at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3), and one (1) distribution sampling site (50250) on January 19, 2021. All sample results were below detection.

Monitoring for Method 505 organohalide pesticides was conducted on January 25, 2021 at three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), and at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3). All results were below detection.

12. Fluoride Monitoring:

Daily analyses of entry point samples (155 samples in total), produced monthly average fluoride levels of 0.71 mg/L for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), and 1S03B (Tunnel 3), 0.76 mg/L for site 1SCL1 (Croton Low Service), and 0.79 mg/L for site 1SCH3 (Croton High Service). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

13. Other Monitoring:

Monitoring for Taste and Odor (T&O) compounds was conducted in January on 55 samples from New Croton Reservoir, Jerome Park reservoir, and the Croton Filtration Plant. Results ranged from ND to 4.3 ng/L for Geosmin, and from ND to 42 ng/L for 2-Methylisoborneol (MIB). Contract laboratory reports of available data are included as pdf files with the electronic files enclosed with this report.

Please feel free to contact me at (718) 595-5367 if you would like to discuss any of this information in greater detail.

Sincerely,



Salome Freud

Deputy Director of Distribution Water Quality Operations

Enclosure

cc:

by email

Mr. Andrew Brunsten, Inspector General for NYCDEP

Mr. Kenneth Kosinski, NYSDEC

Mr. David Kvinge, Westchester County Water Agency

Mr. Huan Li, NYCDOHMH

Ms. Millie Magraw, Westchester County Water Agency

Mr. Trevor McProud, NYCDOHMH

Mr. Andy Tse, NYSDOH

Mr. Steven Zahn, NYSDEC – Region 2

TABLE OF CONTENTS FOR DATA FILES

January 2021 Monthly Water Quality Report

Microbiological Reports:

Summary of Coliform Compliance Samples
Coliform Positive Compliance Samples
Coliform Resample for Positive Compliance Samples
Summary of Coliform Operational Samples

(NYC_Micro_Summary_Compliance_202101.xls)
(NYC_Micro_Compliance_Positives_202101.xls)
(NYC_Micro_Compliance_Resamples_202101.xls)
(NYC_Micro_Operational_202101.pdf)
(NYC_Micro_Summary_Operational_202101.xls)
(NYC_Micro_Operational_202101.pdf)
(NYC_Micro_Operational_Positives_202101.xls)
(NYC_Micro_Operational_202101.pdf)
(NYC_Micro_Operational_Resamples_202101.xls)
(NYC_EP_Coliform_For_Source_Turb_GT_149_202101.snp)
(NYC_Monthly_Alldata_202101.xls;Micro)

Coliform Positive Operational Samples

Coliform Resample for Positive Distribution Operational Samples

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU
All Microbiological Results

Free Chlorine Residual (FCR) Reports:

Entry Point FCR On-Line Monitoring Results

(Entry_Shaft_C12_Online_202101_Fig.pdf)
(Croton_Entry_Shaft_C12_Online_202101_Fig.pdf)
(Entry_Shaft_C12_Online_202101_Tbl.pdf)
(Croton_Entry_Shaft_C12_Online_202101_Tbl.pdf)

Daily Minimum FCR at Entry Points

FCR and Heterotrophic Plate Count (HPC) Compliance Samples
FCR and HPC of Operational Samples

(NYC_Micro_Summary_FCR_HPC_Compliance_202101.xls)
(NYC_Micro_Summary_FCR_HPC_Operational_202101.xls)
(NYC_Micro_Operational_202101.pdf)
(NYC_FCR_Monthly_Summary_202101.xls)
(NYC_FCR_Monthly_Alldata_202101.xls)

Summary of FCR of Distribution Samples (Monthly)
FCR of all Distribution Sites

Turbidity Reports:

Summary of Turbidity of Distribution Samples
Turbidity of all Distribution Sites

(NYC_Turbidity_Monthly_Summary_202101.xls)
(NYC_Turbidity_Monthly_Alldata_202101.xls)

Color Reports:

Color for Entry Point Samples

(Entry_Point_Color_Monthly_202101.xls)

Fluoridation Reports:

Summary of Fluoride Levels of Distribution Samples
Fluoride Daily Entry Point Report for Surface Water Systems
Fluoride of all Distribution Sites

(NYC_Fluoride_Monthly_Summary_202101.xls)
(Entry_Point_Fluoride_Monthly_202101.xls)
(NYC_Fluoride_Monthly_Alldata_202101.xls)

Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP)

Reports:

Total Trihalomethanes (TTHM) & VOC Monthly Report
Organohalide Pesticides EPA Method 505 Quarterly Report
Microextractables of EPA Method 524.3/SIM Report
Haloacetic Acids (HAA5) Monthly Report

(NYC_TTHM_VOC_Rpt_202101.xls)
(NYC_505_Ortlly_Rpt_2021Q1.xls)
(NYC_524_3-SIM_Rpt_202101.xls)
(NYC_HAA5_Monthly_Rpt_202101.xls)
(911228_T&O_Sample_20210104.pdf, 911251_T&O_Sample_20210104.pdf,
912466_T&O_Sample_20210111.pdf, 912489_T&O_Sample_20210111.pdf,
913636_T&O_Sample_20210114.pdf, 913778_T&O_Sample_20210118.pdf,
914188_T&O_Sample_20210119.pdf, 914661_T&O_Sample_20210121.pdf,
914684_T&O_Sample_20210121.pdf, 915026_T&O_Sample_20210125.pdf,
915095_T&O_Sample_20210125.pdf, 914418_T&O_Sample_20210120.pdf)
(NYC_VOC_HAA5_505_Rpt_202101.pdf)

Taste & Odor Sampling Reports from EEA Lab

Summary of EPA Organic Method Reports

Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:

All parameters for January 2021

(NYC_Monthly_Alldata_202101.xls)

RAW WATER FECAL COLIFORM CONCENTRATIONS
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Catskill/Delaware System Raw Water Fecal Coliform Compliance Report

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water				Period: 11/18 To: 01/21
Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
11-18	30	0	0.00	0.00
12-18	31	0	0.00	0.00
1-19	31	0	0.00	0.00
2-19	28	0	0.00	0.00
3-19	31	0	0.00	0.00
4-19	30	0	0.00	0.00
5-19	31	0	0.00	0.00
6-19	30	0	0.00	0.00
7-19	31	0	0.00	0.00
8-19	31	0	0.00	0.00
9-19	30	0	0.00	0.00
10-19	31	0	0.00	0.00
11-19	30	0	0.00	0.00
12-19	31	0	0.00	0.00
1-20	31	0	0.00	0.00
2-20	29	0	0.00	0.00
3-20	31	0	0.00	0.00
4-20	30	0	0.00	0.00
5-20	31	0	0.00	0.00
6-20	30	0	0.00	0.00
7-20	31	0	0.00	0.00
8-20	31	1	3.23	0.54
9-20	30	1	3.33	1.09
10-20	31	0	0.00	1.09
11-20	30	0	0.00	1.09
12-20	31	0	0.00	1.09
1-21	31	0	0.00	1.09

D.W. Robinson

2/3/21

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

2/2/2021

RAW WATER TURBIDITY
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water Period: January, 2021

Date	Turbidity (NTU)						Total Coliform (Colonies per 100 mL)	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM		
1/1/21	0.65	0.65	0.65	0.65	0.55	0.60	E6	E4
1/2/21	0.60	0.65	0.65	0.55	0.60	0.60	E6	<1
1/3/21	0.55	0.55	0.55	0.50	0.55	0.60	E6	E4
1/4/21	0.55	0.55	0.55	0.55	0.60	0.60	E8	E3
1/5/21	0.55	0.55	0.55	0.65	0.60	0.55	E6	E1
1/6/21	0.55	0.55	0.55	0.65	0.60	0.65	E2	E3
1/7/21	0.60	0.60	0.60	0.55	0.55	0.55	E6	E1
1/8/21	0.55	0.60	0.60	0.50	0.55	0.55	E4	E1
1/9/21	0.50	0.55	0.60	0.50	0.50	0.50	E4	<1
1/10/21	0.55	0.55	0.55	0.65	0.65	0.65	E36	E2
1/11/21	0.60	0.60	0.65	0.95	0.85	0.95	E10	<1
1/12/21	1.0	0.95	0.95	1.1	1.0	1.0	E18	<1
1/13/21	1.0	1.0	1.0	0.95	0.85	0.85	E12	<1
1/14/21	0.85	0.80	1.0	0.85	0.75	0.75	E10	<1
1/15/21	0.85	0.75	0.85	0.80	0.90	0.90	E6	<1
1/16/21	1.0	1.0	1.0	0.90	0.95	0.90	E10	E1
1/17/21	0.85	0.90	0.90	0.85	0.90	0.85	E4	<1
1/18/21	0.80	0.80	0.90	0.80	0.80	0.85	E6	E3
1/19/21	0.85	0.85	0.85	0.80	0.80	0.85	E4	E1
1/20/21	0.80	0.85	0.85	0.75	0.85	0.90	E18	E1
1/21/21	0.90	0.90	0.90	0.90	0.80	0.80	E8	<1
1/22/21	0.85	0.80	0.90	0.80	0.80	0.80	E8	<1
1/23/21	0.75	0.85	0.85	0.90	0.85	0.85	E8	<1
1/24/21	0.95	0.85	0.90	0.90	0.90	0.90	E8	E1
1/25/21	0.85	0.80	0.95	0.85	0.80	0.80	E28	<1
1/26/21	0.75	0.80	0.80	0.85	0.90	0.85	E20	<1
1/27/21	0.90	0.90	0.80	0.85	1.0	0.85	E6	E2
1/28/21	0.85	0.80	0.90	0.75	0.80	0.85	E8	<1
1/29/21	0.90	0.85	0.80	0.90	0.90	0.85	E10	E2
1/30/21	0.85	0.85	0.85	0.80	0.80	0.85	E4	<1
1/31/21	0.85	0.80	0.85	0.80	0.85	0.85	E4	E3

.: Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error, E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with dilution based value

1. Does a raw water turbidity M & R violation exist? Yes No
2. Does the turbidity reading exceed 5 NTU at any time? Yes No
If yes, check for MCL violation, and notify state by the end of the next business day.
3. Minimum number of microbiological samples required per week: 5
4. A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

D.W. Robison 2/3/21

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations 2/2/2021



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Data Qualifiers and Additional Notes Period: January 2021

Date/Time	Site	Analytes Affected	Qualifier
1/28/21 11:55	DEL18DT	Turbidity	The duplicate analysis was not within the control limits.

Analytical Methods

- Coliform, Fecal - SM 9222D (2006)
- Coliform, Total - SM 9222B (2006)
- Turbidity - SM 2130B (01)

ENTRY POINT CHLORINE RESIDUAL
(FAD Requirement)

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System

Tunnel No.1 (Catskill) at Shaft 3			Tunnel No.2 (Delaware) at Shaft 3A			Tunnel No.3 (Cat/Del) at Shaft 3B		
Date	MinCl_1DL	Remark 1	Date	MinCl_2DL	Remark 2	Date	MinCl_3DL	Remark 3
01/01/21	0.64		01/01/21	0.76		01/01/21	0.69	
01/02/21	0.60		01/02/21	0.72		01/02/21	0.65	
01/03/21	0.66		01/03/21	0.78		01/03/21	0.62	
01/04/21	0.66		01/04/21	0.69		01/04/21	0.67	
01/05/21	0.63		01/05/21	0.77		01/05/21	0.68	
01/06/21	0.64		01/06/21	0.76		01/06/21	0.67	
01/07/21	0.63		01/07/21	0.76		01/07/21	0.68	
01/08/21	0.65		01/08/21	0.76		01/08/21	0.68	
01/09/21	0.63		01/09/21	0.77		01/09/21	0.66	
01/10/21	0.63		01/10/21	0.77		01/10/21	0.68	
01/11/21	0.65		01/11/21	0.79		01/11/21	0.68	
01/12/21	0.59		01/12/21	0.70		01/12/21	0.66	
01/13/21	0.64		01/13/21	0.76		01/13/21	0.67	
01/14/21	0.66		01/14/21	0.73		01/14/21	0.67	
01/15/21	0.65		01/15/21	0.77		01/15/21	0.68	
01/16/21	0.70		01/16/21	0.75		01/16/21	0.70	
01/17/21	0.64		01/17/21	0.75		01/17/21	0.68	
01/18/21	0.64		01/18/21	0.78		01/18/21	0.64	
01/19/21	0.64		01/19/21	0.77		01/19/21	0.66	
01/20/21	0.64		01/20/21	0.76		01/20/21	0.65	
01/21/21	0.62		01/21/21	0.76		01/21/21	0.68	
01/22/21	0.62		01/22/21	0.72		01/22/21	0.68	
01/23/21	0.63		01/23/21	0.79		01/23/21	0.62	
01/24/21	0.63		01/24/21	0.78		01/24/21	0.63	
01/25/21	0.65		01/25/21	0.74		01/25/21	0.66	
01/26/21	0.63		01/26/21	0.73		01/26/21	0.67	
01/27/21	0.67		01/27/21	0.79		01/27/21	0.66	
01/28/21	0.64		01/28/21	0.78		01/28/21	0.65	
01/29/21	0.66		01/29/21	0.78		01/29/21	0.64	
01/30/21	0.63		01/30/21	0.77		01/30/21	0.62	
01/31/21	0.63		01/31/21	0.76		01/31/21	0.69	

Legend: MinCl_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.
MinCl_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.
MinCl_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points

Low Service			High Service		
Date	MinCl_1SCL1	Remark 1	Date	MinCl_1SCH3	Remark 2
01/01/21	0.58		01/01/21	0.53	
01/02/21	0.62		01/02/21	0.52	
01/03/21	0.62		01/03/21	0.53	
01/04/21	0.61		01/04/21	0.54	
01/05/21	0.62		01/05/21	0.53	
01/06/21	0.54		01/06/21	0.52	
01/07/21	0.49		01/07/21	0.52	
01/08/21	0.62		01/08/21	0.52	
01/09/21	0.62		01/09/21	0.50	
01/10/21	0.60		01/10/21	0.52	
01/11/21	0.59		01/11/21	0.50	
01/12/21	0.59		01/12/21	0.50	
01/13/21	0.62		01/13/21	0.50	
01/14/21	0.59		01/14/21	0.50	
01/15/21	0.62		01/15/21	0.51	
01/16/21	0.56		01/16/21	0.54	
01/17/21	0.58		01/17/21	0.53	
01/18/21	0.58		01/18/21	0.53	
01/19/21	0.63		01/19/21	0.53	
01/20/21	0.62		01/20/21	0.44	
01/21/21	0.61		01/21/21	0.48	
01/22/21	0.60		01/22/21	0.46	
01/23/21	0.60		01/23/21	0.46	
01/24/21	0.45		01/24/21	0.44	
01/25/21	0.63		01/25/21	0.43	
01/26/21	0.60		01/26/21	0.44	
01/27/21	0.61		01/27/21	0.45	
01/28/21	0.61		01/28/21	0.43	
01/29/21	0.63		01/29/21	0.43	
01/30/21	0.62		01/30/21	0.44	
01/31/21	0.63		01/31/21	0.50	

Legend: MinCl_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.


MinCl_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.

Note: Croton water fed to High Service time period was determined by specific conductance greater than 150 µS/cm.


New York City Department of Environmental Protection
Bureau of Water Supply

City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results


Chlorine Levels at City Tunnel No.1 Entry Point, January 2021

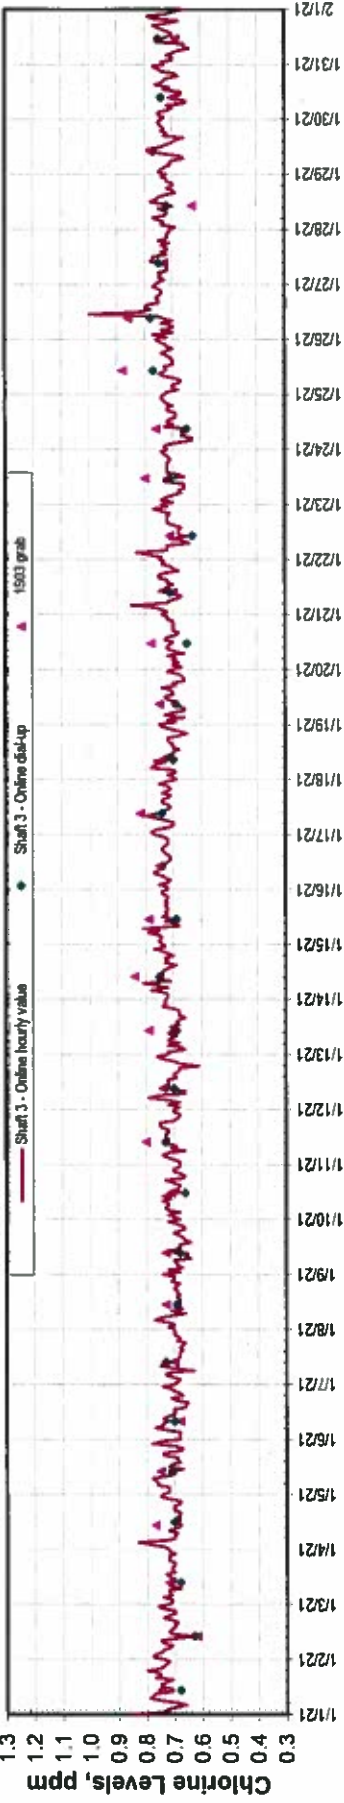

Chlorine Levels at City Tunnel No.2 Entry Point, January 2021

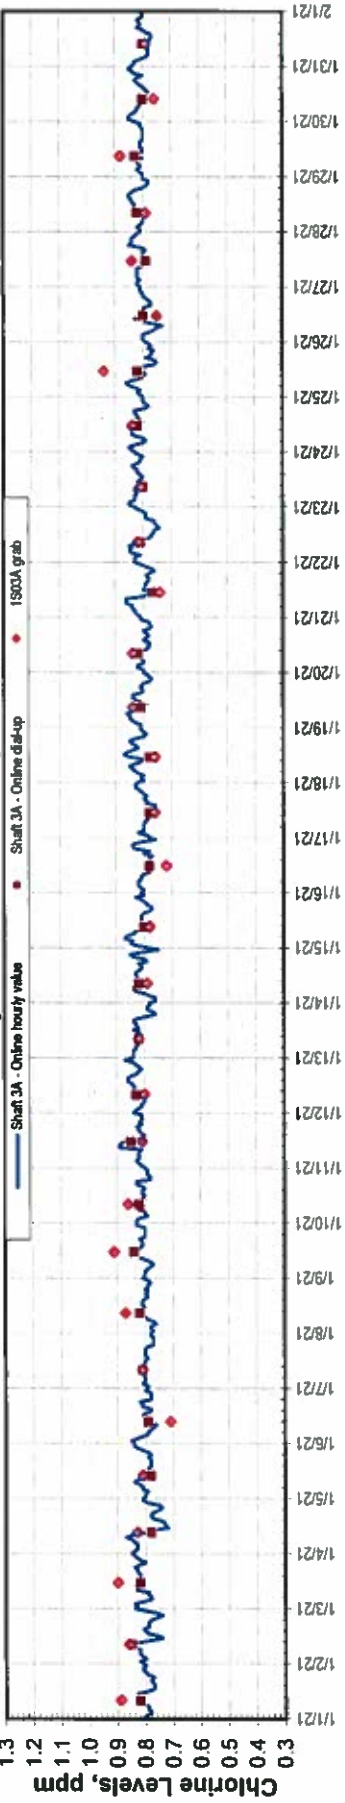

Chlorine Levels at City Tunnel No.3 Entry Point, January 2021

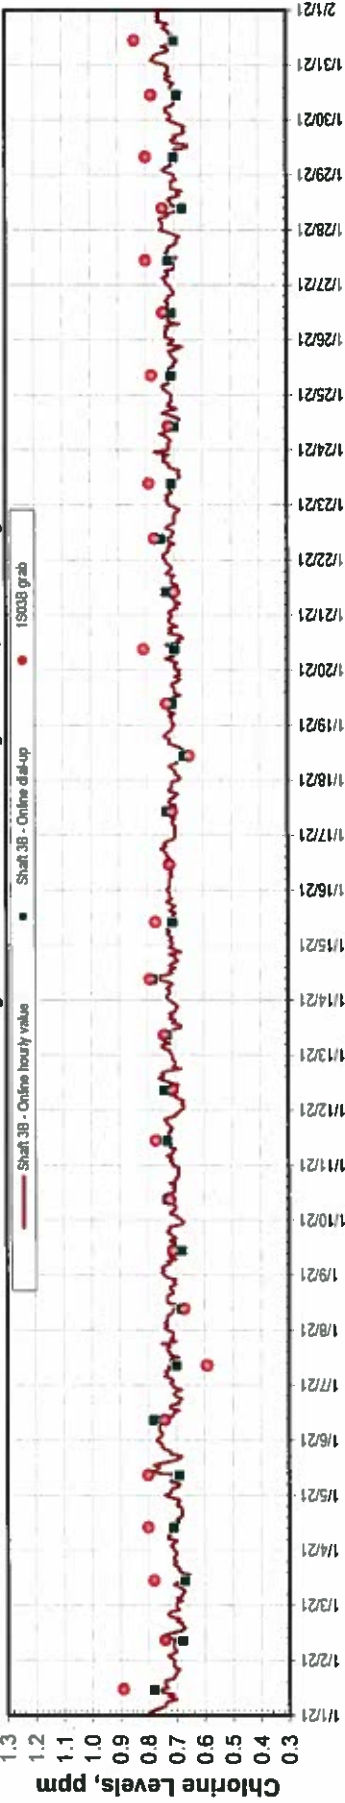


Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 11/1/20, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.


New York City Department of Environmental Protection
Bureau of Water Supply

Croton Distribution Entry Point Residual Chlorine Continuous Monitoring Results

Croton Low Service Entry Point Chlorine Levels, January 2021

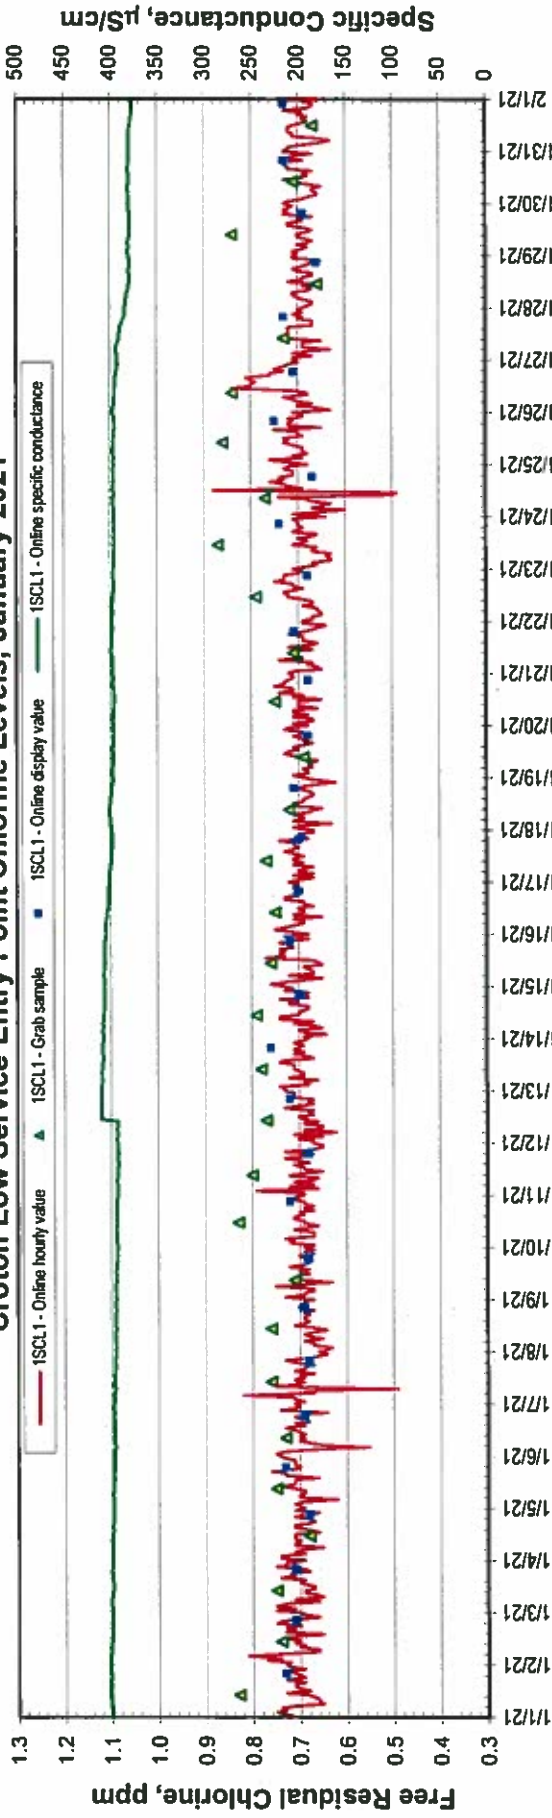

Croton High Service Entry Point Chlorine Levels, January 2021

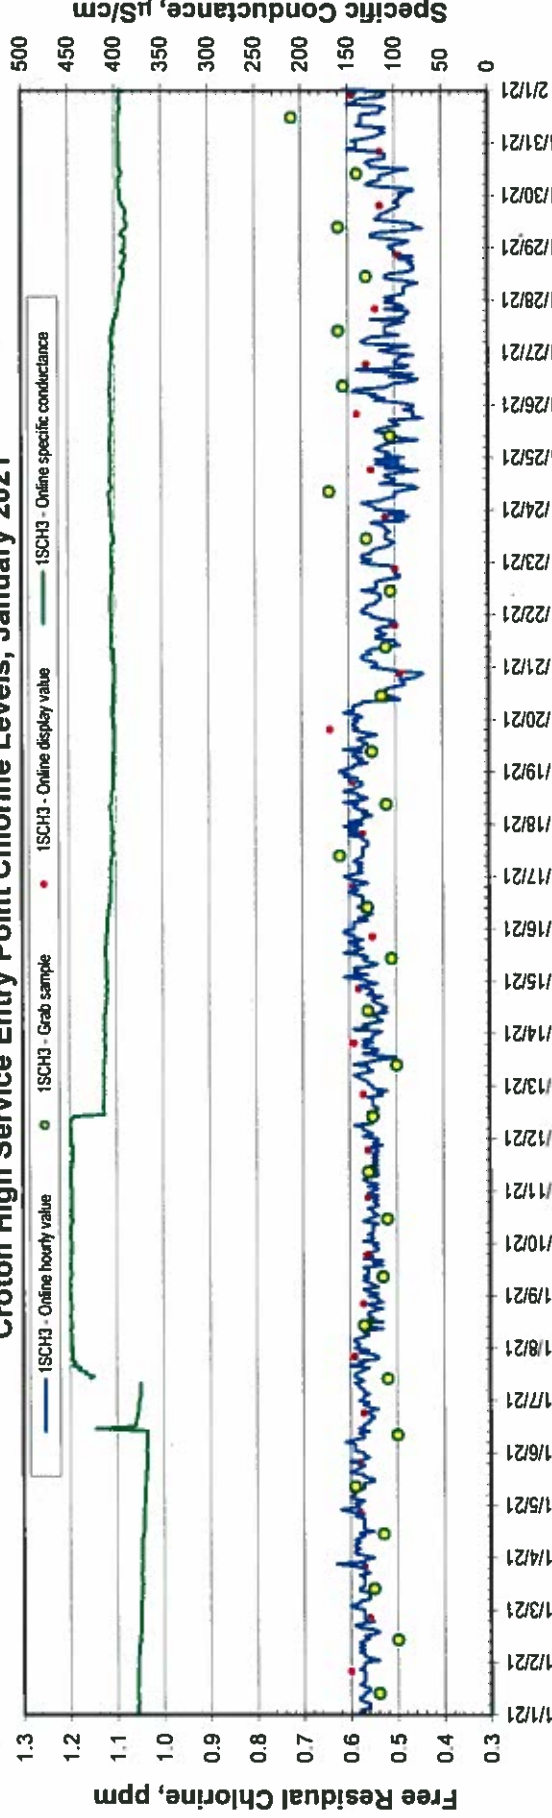

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 11/1/20, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.

DISTRIBUTION SYSTEM DISINFECTION RESIDUAL
(FAD Requirement)

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

Residual Chlorine (mg/L) Distribution Samples

January 2021

All Distribution Sites			
Samples	Min	Max	Average
1312	0.03	1.03	0.59

Hach DPD Method (analyte is not ELAP certified)

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	RESIDUAL CHLORINE	COMMENT
2002	1/19/21	50300	Reg Stop	1.03	Max
2916	1/26/21	76300	Reg Stop	0.03	Min

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

TOTAL COLIFORM MONITORING
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Summary of Results for Microbiological Quality
 Compliance Samples

1/1/2021 to 1/31/2021

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	135	135	0	0	0.0%
Brooklyn	70	200	200	0	0	0.0%
Manhattan	57	171	171	0	0	0.0%
Queens ***	79	230	230	0	0	0.0%
Staten Island	29	87	87	0	0	0.0%
Ground Water Supply ***	-	-	-	-	-	-
Total	281	823	823	0	0	0.0%

* As determined by Colilert Quanti-Tray-18 Method (SM 9223 B).
 ** If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.
 *** There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupes Agnew Date: 02/05/21

Director: [Signature] Date: 2/8/2021

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality
 Positive Compliance Samples

1/1/2021 to 1/31/2021

Date	Time	Site Number	Boro	Location	Coliform *	E. coli *	Chlorine Residual (mg/L) **	Remarks

No positive sample this month.

* As determined by Colliert Quanti-Tray-18 Method (SM 9223 B). Results expressed in "MPN/100 mL."
 ** As determined by Hach DPD Method (analyte is not ELAP certified).

Supervisor: Russ Agnew Date: 02/05/21

Director: [Signature] Date: 2/8/2024

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality
Resamples for Positive Compliance Samples

1/1/2021 to 1/31/2021

Date	Time	Site Number	Boro	Location	Coliform *	E. coli *	Chlorine Residual (mg/L) **	Remarks
				No positive sample this month.				

* As determined by Colliert Quanti-Tray-18 Method (SM 9223 B). Results expressed in "MPN/100 mL."
 ** As determined by Hach DPD Method (analyte is not ELAP certified).

Supervisor: Rupa Agarwal Date: 02/05/21
 Director: [Signature] Date: 2/8/2021

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality
Free Chlorine Residual and Heterotrophic Plate Count
Compliance Samples

1/1/2021 to 1/31/2021

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 ***	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	135	135	83	0	0	-	0	0.0%
Brooklyn	70	200	200	123	0	0	--	0	0.0%
Manhattan	57	171	171	105	0	0	-	0	0.0%
Queens †	79	230	230	141	2	0	--	0	0.0%
Staten Island	29	87	87	55	1	0	-	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	-	-	-
Total	281	823	823	507	3	0	-	0	0.0%

- * Free chlorine residual is determined by Hach DPD Method (analyte is not ELAP certified).
- ** Heterotrophic plate count is determined by method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result ≤ 500 CFU/mL is equivalent to a measurable FCR.
- *** No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.

† There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupe Agnew Date: 02/05/21

Director: [Signature] Date: 2/8/21

MICROBIOLOGICAL MONITORING

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYS DOH ELAP #10770; USEPA #NY01351)**

**Coliform Monitoring Results at Sample Sites near the First Service Connection
When Source Water Turbidity Exceeds 1.49 NTU**

January 2021

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform *	E.coli *

No official four-hour turbidity readings from Cat-Del source water were greater than 1.5 NTU this month.

* As determined by Collert Quanti-Tray-18 Method (SM 9223B). Results expressed in "MPN /100mL."

DISTRIBUTION TURBIDITY MONITORING

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

Turbidity (NTU) Distribution Samples

January 2021

All Distribution Sites			
Samples	Min	Max	Average
1312	<0.10	3.29	0.63

Analytical Method SM 2130 B

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	TURBIDITY	COMMENT
571	1/6/21	22050	Reg Stop	3.29	Max
1570	1/15/21	1SCH3	Reg Stop	<0.10	Min

The monthly average of all distribution samples is not to exceed 5 NTU.

COLOR MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points
 January 2021

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31					
Catskill/Delaware 1S03 (Tunnel 1)	8	6	6	6	6	7	7	6	6	7	7	6	6	6	6	6	7	7	6	7	6	7	7	6	6	7	6	6	7	6	7	6				
Catskill/Delaware 1S03A (Tunnel 2)	7	6	6	7	7	7	7	6	6	7	7	7	7	6	6	7	6	7	6	7	6	7	7	7	6	7	6	6	8	7	6	7	6			
Catskill/Delaware 1S03B (Tunnel 3)	7	6	6	7	6	7	7	7	6	6	7	7	6	6	7	6	6	7	6	7	6	7	7	6	6	7	7	6	6	8	8	7	6	7		
Croton System 1SCL1 (a)	3	4	4	3	4	4	3	4	4	4	3	3	4	4	4	3	4	3	4	3	4	4	4	4	4	4	3	4	4	4	3	4	4	3	4	
Croton System 1SCH3 (b)	3	3	4	4	4	4	3	4	4	4	3	3	4	4	3	3	4	3	4	3	4	4	4	4	4	4	4	4	4	4	4	4	4	3	4	4

Analytical Method SM 2120 B. Apparent color.

The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.

(a) Croton System online as of 10/27/20 at 1SCL1.

(b) Croton System online as of 11/19/20 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	31	6	8	6
Catskill/Delaware 1S03A (Tunnel 2)	31	6	8	7
Catskill/Delaware 1S03B (Tunnel 3)	31	6	8	7
Croton System 1SCL1 (a)	31	3	4	4
Croton System 1SCH3 (b)	31	3	4	4

Supervisor  Date 02/03/2021

Director  Date 3/14/2021

FLUORIDE MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points
 January 2021

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Catskill/Delaware 1S03 (Tunnel 1)	0.70	0.69	0.70	0.70	0.70	0.70	0.71	0.71	0.72	0.71	0.69	0.71	0.71	0.72	0.70	0.71	0.71	0.71	0.70	0.70	0.70	0.70	0.72	0.71	0.70	0.71	0.71	0.73	0.72	0.71	0.72
Catskill/Delaware 1S03A (Tunnel 2)	0.70	0.69	0.69	0.71	0.71	0.71	0.71	0.72	0.72	0.71	0.69	0.71	0.72	0.71	0.70	0.71	0.71	0.70	0.70	0.70	0.70	0.70	0.72	0.71	0.71	0.71	0.72	0.73	0.72	0.71	0.72
Catskill/Delaware 1S03B (Tunnel 3)	0.69	0.70	0.70	0.71	0.71	0.71	0.71	0.72	0.72	0.71	0.70	0.72	0.72	0.72	0.69	0.71	0.71	0.71	0.70	0.70	0.70	0.70	0.72	0.70	0.71	0.71	0.72	0.73	0.72	0.71	0.72
Croton System 1SCL1 (a)	0.78	0.76	0.78	0.80	0.78	0.76	0.77	0.78	0.78	0.77	0.76	0.78	0.77	0.78	0.76	0.78	0.79	0.77	0.76	0.78	0.75	0.74	0.74	0.74	0.76	0.74	0.74	0.75	0.72	0.71	0.72
Croton System 1SCH3 (b)	0.77	0.77	0.78	0.80	0.78	0.76	0.76	0.78	0.79	0.77	0.76	0.78	0.76	0.78	0.76	0.78	0.79	0.77	0.77	0.79	0.79	0.77	0.82	0.80	0.80	0.79	0.82	0.85	0.83	0.80	0.82

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System online as of 10/27/20 at 1SCL1.

(b) Croton System online as of 11/19/20 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	31	0.69	0.73	0.71
Catskill/Delaware 1S03A (Tunnel 2)	31	0.69	0.73	0.71
Catskill/Delaware 1S03B (Tunnel 3)	31	0.69	0.73	0.71
Croton System 1SCL1 (a)	31	0.71	0.80	0.76
Croton System 1SCH3 (b)	31	0.76	0.85	0.79

Supervisor  Date 02/03/2021

Director  Date 3/4/2021