



Vincent Sapienza, P.E.  
Commissioner

Paul V. Rush, P.E.  
Deputy Commissioner  
Bureau of Water Supply  
prush@dep.nyc.gov

59-17 Junction Blvd.  
Flushing, NY 11373  
T: (845) 340-7800  
F: (845) 334-7175

January 10, 2019

Li Huang, P.E.  
New York City Department of Health and Mental Hygiene  
Environmental Sciences & Engineering  
42-09 28<sup>th</sup> Street, 14<sup>th</sup> Floor CN# 56  
Long Island City, NY 11101

Patrick Palmer  
New York State Department of Health  
Bureau of Water Supply Protection, NYC Watershed Section  
Empire State Plaza, Corning Tower, Room 1198  
Albany, NY 12237

Katie Lynch  
United States Environmental Protection Agency  
Clean Water Division - New York City Water Supply Protection Program  
290 Broadway, 24<sup>th</sup> Floor  
New York, New York 10007-1866

**RE: Monthly Water Quality Report for December 2018**

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **December 2018**. There was no well pumpage to distribution in the Groundwater System this month. Croton water fed into distribution from December 1 through December 31, 2018. In addition to the following list of compliance reports, a disc of electronic files containing compliance and non-compliance data for this month is enclosed with this report.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
  - Summary
  - Positive Samples
  - Resamples
- Chlorine Residual Reports
  - Entry Point Online
  - Entry Point Daily Minimum
  - Heterotrophic Plate Count
  - Monthly Summary
- Distribution Turbidity Reports
  - Distribution Turbidity Report
  - Source Water > 1.49 NTU Table
- Color Entry Point Report

- Fluoride Reports
  - Fluoride Entry Point Report
  - Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

## FAD REQUIREMENTS

### 1. *Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):*

**Requirements met.** The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from July 1, 2018 to December 31, 2018. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 2.17% for the Catskill/Delaware System for this time period.

### 2. *Raw Water Turbidity (Section 141.71(a)(2)):*

**Requirements met.** The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest turbidity value was listed at 1.4 NTU on the Catskill/Delaware System for the month.

### 3. *Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):*

**Requirements met.** As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual value for entry point readings for the Catskill/Delaware System from sites 1S03 (Tunnel 1) was 0.50 mg/L, 1S03A (Tunnel 2) was 0.79 mg/L, and 1S03B (Tunnel 3) was 0.52 mg/L for the Catskill/Delaware System.

The Croton Filtration Plant was online throughout the month except for the short period at the Croton Low Service entry point from 11:20 PM on December 27 to 7:03 AM on December 28, 2018; and the Croton High Service entry point from 10:00 PM on December 27 to 3:50 PM on December 28, 2018. When High Service Pumps are off, distribution Tunnel 3 water back feeds through the High Service tunnel to the Low Service entry point to meet the distribution demands. Croton Filtration Plant production was interrupted when it experienced a complete power loss on December 27 which lasted approximately 2 hours. The power loss was caused by an electrical fault at an electrical substation in Queens. Although production at Croton Filtration Plant stopped, there was no disruption in the delivery of water to the distribution system. Once power was restored, equipment was inspected and reset when needed, and Croton Filtration Plant resumed operations. The minimum daily free chlorine residual value for Croton entry point readings from sites 1SCL1 (Low Service) and 1SCH3 (High Service) were both 0.54 mg/L.

**4. Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):**  
**Requirements met.** All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.01 mg/L except for one sample that equaled 0.00 mg/L.

A total of 1333 distribution samples were tested for free chlorine residual this month. For all distribution sites free chlorine residual ranged from 0.00 mg/L to 1.15 mg/L and averaged 0.63 mg/L for the month.

**5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):**  
**Requirements met.** The results for the fourth quarter of 2018 were included in the report dated December 7, 2018 (For the November 2018 reporting period).

**6. Total Coliform Monitoring (Section 141.71(b)(5)):**  
**Requirements met.** The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 816 compliance samples were tested for total coliform during this period. HPC were all  $\leq 500$  CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC  $> 500$  CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, there were no samples that tested positive for total coliform, and all samples were negative for *E. coli* during the month.

## OTHER WATER QUALITY MONITORING

### **7. Microbiological Monitoring:**

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity  $> 1.49$  NTU, was not required this month, but all samples were negative for total coliform.

The analyses of 517 distribution Operational samples resulted in one (1) sample testing positive for total coliform. No *E. coli* were detected.

The analyses of 248 Pre-Finished samples resulted in one (1) sample testing positive for total coliform and for *E. coli*.

The analyses of 461 Autosampler Pre-finished samples resulted in no samples testing positive for total coliform. No *E. coli* were detected.

### **8. Distribution Turbidity Monitoring:**

For distribution sites turbidity ranged from  $< 0.10$  to 1.50 NTU and averaged 0.69 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

### **9. Color Monitoring:**

The MCL of 15 units for color was met at each Catskill/Delaware and Croton entry point for the month. Daily analyses of entry point samples (155 samples in total), produced monthly average

color values of nine (9) units for site 1S03 (Tunnel 1), ten (10) units for sites 1S03A (Tunnel 2) and 1S03B (Tunnel 3), and four (4) units for sites 1SCL1 (Croton Low Service) and 1SCH3 (Croton High Service).

**10. Volatile Organic/TTHM/HAA5 Monitoring:**

**Monthly Results:** Twenty (20) distribution site samples were collected for volatile organic contaminant (VOC) analysis and five (5) entry point samples. All VOC samples from distribution sites and entry points were below detection. Twenty (20) TTHM distribution samples were collected ranging from 20 µg/L to 42 µg/L. Five (5) TTHM entry point samples were collected ranging from 19 µg/L to 35 µg/L. Twenty (20) HAA5 distribution samples were collected ranging from 36 µg/L to 70 µg/L. Five (5) HAA5 entry point samples were collected ranging from 34 µg/L to 64 µg/L.

Please note the following corrections to the TTHM/HAA5 section of the November 2018 report. Twenty-two (22) HAA5 distribution samples were collected ranging from 35 µg/L to 62 µg/L. Four (4) HAA5 entry point samples were collected ranging from 34 µg/L to 52 µg/L

**11. Semivolatile and Other Organic Chemicals/parameters:**

EPA Method 525.3 monitoring for 112 compounds of specified and unspecified organic parameters was conducted on December 17, 2018 at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the two Croton entry points (1SCL1 and 1SCH3), and six (6) distribution points. All semi-volatile organic contaminant samples from distribution sites and entry points were below detection limits.

**12. Fluoride Monitoring:**

Daily analyses of entry point samples (155 samples in total), produced monthly average fluoride levels of 0.72 mg/L for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), and 1S03B (Tunnel 3); 0.71 mg/L for site 1SCL1 (Croton Low Service); and 0.70 mg/L for site 1SCH3 (Croton High Service). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

**13. Unregulated Contaminant Monitoring Rule:**

Pending resampling results for EPA Method 530, from the third quarter monitoring for UCMR4 Additional Chemicals, which was conducted on December 10, 2018 were received on December 28, 2018. All four (4) entry points were below detection. This concludes DEP's monitoring of Additional Chemicals for the third quarter. Contract laboratory reports of available data are included as pdfs on the disc of electronic files enclosed with this report.

Please feel free to contact me at (845) 340-7701 if you would like to discuss any of this information in greater detail.

Sincerely,

A handwritten signature in cursive script that reads "Steven C. Schindler SS".

Steven C. Schindler  
Director, Water Quality

**Enclosure**

cc:

Mr. James Flaherty, Inspector General for NYCDEP  
Mr. Kenneth Kosinski, NYSDEC  
Mr. David Kvinge, Westchester County Water Agency (by email only)  
Mr. Huan Li, NYCDOHMH  
Mr. Trevor McProud, NYCDOHMH  
Mr. Andy Tse, NYSDOH (by email only)  
Mr. Steven Zahn, NYSDEC – Region 2

bcc:

**Electronic file:**

*V. Sapienza, P.E., Commissioner*

*K. Alderisio*

*A. Bader*

*D. Borchert*

*K. Cipriano*

*K. Czarnogorski/file*

*S. Freud*

*C. Glaser*

*L. Janus, Ph.D.*

*K. Kane*

*L. Lu, Ph.D.*

*R. Levine*

*W. Melendez, P.E.*

*L. Occhiuto*

*A. Reaves*

*S. Riviere*

*D. Robinson*

*P. Rush, P.E.*

*S. Schindler (hard copy)*

*D. Warne/S. McCormack*

*M. Warne*

*V. Xu+*

***TABLE OF CONTENTS FOR CD FILES***

December 2018 Monthly Water Quality Report

**Microbiological Reports:**

Summary of Coliform Compliance Samples  
Coliform Positive Compliance Samples  
Coliform Resample for Positive Compliance Samples  
Summary of Coliform Operational Samples

(NYC\_Micro\_Summary\_Compliance\_201812.xls)  
(NYC\_Micro\_Compliance\_Positives\_201812.xls)  
(NYC\_Micro\_Compliance\_Resamples\_201812.xls)  
(NYC\_Micro\_Operational\_201812.pdf)  
(NYC\_Micro\_Summary\_Operational\_201812.xls)  
(NYC\_Micro\_Operational\_201812.pdf)  
(NYC\_Micro\_Operational\_Positives\_201812.xls)  
(NYC\_Micro\_Operational\_201812.pdf)  
(NYC\_Micro\_Operational\_Resamples\_201812.xls)  
(NYC\_Micro\_Operational\_Resamples\_201812.pdf)  
(NYC\_EP\_Coliform\_For\_Source\_Turb\_GT\_149\_201812.snp)  
(NYC\_Monthly\_Alldata\_201812.xls\Micro)

Coliform Positive Operational Samples

Coliform Resample for Positive Distribution Operational Samples

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU  
All Microbiological Results

**Free Chlorine Residual (FCR) Reports:**

Entry Point FCR On-Line Monitoring Results

(Entry\_Shaft\_Ci2\_Onln\_201812\_Fig.pdf)  
(Croton\_Entry\_Point\_Ci2\_201812\_Fig.pdf)

Daily Minimum FCR at Entry Points

(Entry\_Shaft\_Ci2\_Onln\_201812\_Tbl.pdf)

FCR and Heterotrophic Plate Count (HPC) Compliance Samples

FCR and HPC of Operational Samples

(Croton\_Entry\_Point\_Ci2\_201812\_Tbl.pdf)  
(NYC\_Micro\_Summary\_FCR\_&\_HPC\_Compliance\_201812.xls)  
(NYC\_Micro\_Summary\_FCR\_&\_HPC\_Operational\_201812.xls)

Summary of FCR of Distribution Samples (Quarterly)

Summary of FCR of Distribution Samples (Monthly)

FCR of all Distribution Sites

(NYC\_Micro\_Operational\_201812.pdf)

(NYC\_FCR\_Quarterly\_Summary\_2018Q4.xls)

(NYC\_FCR\_Monthly\_Summary\_201812.xls)

(NYC\_FCR\_Monthly\_Alldata\_201812.xls)

**Turbidity Reports:**

Summary of Turbidity of Distribution Samples

Turbidity of all Distribution Sites

(NYC\_Turbidity\_Monthly\_Summary\_201812.xls)

(NYC\_Turbidity\_Monthly\_Alldata\_201812.xls)

**Color Reports:**

Color for Entry Point Samples

(Entry\_Point\_Color\_Monthly\_201812.xls)

**Fluoridation Reports:**

Summary of Fluoride Levels of Distribution Samples

Fluoride Daily Entry Point Report for Surface Water Systems

Fluoride of all Distribution Sites

(NYC\_Fluoride\_Monthly\_Summary\_201812.xls)

(Entry\_Point\_Fluoride\_Monthly\_201812.xls)

(NYC\_Fluoride\_Monthly\_Alldata\_201812.xls)

**Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP)**

**Reports:**

Total Trihalomethanes (TTHM) & VOC Monthly Report

Summary of EPA Method 525 Report

Haloacetic Acids (HAA5) Monthly Report

Unregulated Contaminant Monitoring Rule 4 (UCMR4) Report

Summary of EPA Organic Method Reports

(NYC\_TTHM\_&\_VOC\_Rpt\_201812.xls)

(NYC\_SOC\_Rpt\_201812.xls)

(NYC\_HAA5\_Monthly\_Rpt\_201812.xls)

(777900\_UCMR4\_Resample\_20181210.pdf)

(NYC\_VOC\_HAA5\_Rpt\_201812.pdf)

**Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:**

All parameters for December 2018

Mercury results from EEA

Revised IOC\_Monthly for November 2017

(NYC\_Monthly\_Alldata\_201812.xls)

(777975\_Hg\_Sample\_201812.pdf)

(NYC\_Monthly\_Alldata\_201711\_rev.xls/IOC\_Monthly\_rev)



***RAW WATER FECAL COLIFORM CONCENTRATIONS***  
***(FAD Requirement)***



# NYCDEP Division of Watershed Water Quality Operations

## Catskill/Delaware System Raw Water Fecal Coliform Compliance Report

Hawthorne Laboratory, ELAP Lab ID No. 10771  
 15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson  
 914-345-4973

**Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water** **Period: 10/16 To: 12/18**

Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
10-16	31	0	0.00	0.00
11-16	30	0	0.00	0.00
12-16	31	0	0.00	0.00
1-17	31	0	0.00	0.00
2-17	28	0	0.00	0.00
3-17	31	0	0.00	0.00
4-17	30	0	0.00	0.00
5-17	31	0	0.00	0.00
6-17	30	0	0.00	0.00
7-17	31	0	0.00	0.00
8-17	31	0	0.00	0.00
9-17	30	0	0.00	0.00
10-17	31	0	0.00	0.00
11-17	30	0	0.00	0.00
12-17	31	0	0.00	0.00
1-18	31	0	0.00	0.00
2-18	28	1	3.57	0.55
3-18	31	0	0.00	0.55
4-18	30	0	0.00	0.55
5-18	31	0	0.00	0.55
6-18	30	0	0.00	0.55
7-18	31	0	0.00	0.55
8-18	31	0	0.00	0.00
9-18	30	2	6.67	1.09
10-18	31	2	6.45	2.17
11-18	30	0	0.00	2.19
12-18	31	0	0.00	2.17

*David Robinson*

*1/3/19*

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

1/3/2019

***RAW WATER TURBIDITY***  
*(FAD Requirement)*



# NYCDEP Division of Watershed Water Quality Operations

## Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771  
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson  
914-345-4973

**Gatskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water** Period: December, 2018

Date	Turbidity (NTU)						Total Coliform (Colonies per 100 mL)	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM		
12/1/18	0.85	0.80	0.75	0.80	0.80	0.80	E12	E2
12/2/18	0.80	0.80	0.85	0.80	0.90	0.80	E16	E6
12/3/18	0.75	0.85	0.90	0.80	0.85	0.85	E16	<1
12/4/18	0.95	0.80	0.85	0.80	0.80	0.85	E40	E1
12/5/18	0.80	0.80	0.80	0.85	0.80	0.80	E28	<1
12/6/18	0.80	0.75	0.80	0.90	0.80	0.80	E14	<1
12/7/18	0.80	0.80	0.85	0.85	0.85	0.85	E6	E2
12/8/18	0.85	0.90	0.85	0.85	0.85	0.85	E18	<1
12/9/18	0.80	0.80	0.85	0.80	0.85	0.85	E18	E3
12/10/18	0.80	0.85	0.85	0.80	0.90	0.85	E26	E2
12/11/18	0.85	0.85	0.90	0.85	0.85	0.90	E2	<1
12/12/18	0.75	0.80	0.85	0.95	0.90	0.85	E2	<1
12/13/18	1.0	1.0	0.95	0.85	0.85	0.85	E6	E1
12/14/18	0.80	0.90	0.85	0.90	0.80	0.85	E6	<1
12/15/18	0.90	0.80	0.85	0.80	0.75	0.85	<2	E2
12/16/18	0.80	0.90	0.85	0.85	0.85	0.75	<2	<1
12/17/18	0.85	0.80	0.85	0.85	0.85	0.85	E4	E1
12/18/18	0.80	0.85	0.80	0.70	0.80	0.85	E6	E1
12/19/18	0.85	0.80	0.85	0.90	0.85	0.80	E18	E1
12/20/18	0.85	0.75	0.80	0.80	0.75	0.80	E4	E1
12/21/18	0.75	0.80	1.4	0.80	0.80	0.80	E8	E3
12/22/18	0.75	0.75	0.75	0.80	0.80	0.75	E6	<1
12/23/18	0.80	0.75	0.80	0.80	0.80	0.80	E8	<1
12/24/18	0.80	0.80	0.80	0.75	0.75	0.75	E36	E2
12/25/18	0.75	0.75	0.75	0.80	0.75	0.75	E8	E3
12/26/18	0.70	0.70	0.70	0.75	0.65	0.65	E4	E4
12/27/18	0.65	0.70	0.65	0.65	0.70	0.70	E14	E1
12/28/18	0.65	0.70	0.70	0.70	0.70	0.75	E4	<1
12/29/18	0.80	0.80	0.75	0.80	0.85	0.85	E10	<1
12/30/18	0.85	0.80	0.75	0.70	0.70	0.70	E10	<1
12/31/18	0.70	0.75	0.70	0.70	0.75	0.70	E14	E2

.: Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error, E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with dilution based value

1. Does a raw water turbidity M & R violation exist?  Yes  No
2. Does the turbidity reading exceed 5 NTU at any time?  Yes  No  
*If yes, check for MCL violation, and notify state by the end of the next business day.*
3. Minimum number of microbiological samples required per week: 5
4. A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

*DW Robinson*

*1/3/19*

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

1/3/2019

All results that fall within the scope of the NELAP program meet that program's requirements unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 01/03/2019 10:57 am  
Page 2 of 3



# NYCDEP Division of Watershed Water Quality Operations

## Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771  
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson  
914-345-4973

### Data Qualifiers and Additional Notes Period: December, 2018

Date/Time	Site	Analytes Affected	Qualifier
12/25/18 08:24	DEL18DT	Fecal Coliform	Bottle was cracked and leaking.
12/22/18 10:04	DEL18DT	Total Coliform	Mendo media used had expired on 12/21/18.
12/25/18 08:24	DEL18DT	Total Coliform	Bottle was cracked and leaking

### Analytical Methods

- Coliform, Fecal - SM 9222D (2006)
- Coliform, Total - SM 9222B (2006)
- Turbidity - SM 2130B (01)

***ENTRY POINT CHLORINE RESIDUAL***  
***(FAD Requirement)***

New York City Department of Environmental Protection  
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System

Tunnel No.1 (Catskill) at Shaft 3		Tunnel No.2 (Delaware) at Shaft 3A		Tunnel No.3 (Cat/Del) at Shaft 3B				
Date	MinCl_1DL	Remark 1	Date	MinCl_2DL	Remark 2	Date	MinCl_3DL	Remark 3
12/01/18	0.66		12/01/18	0.93		12/01/18	0.67	
12/02/18	0.66		12/02/18	0.95		12/02/18	0.64	
12/03/18	0.55		12/03/18	0.85		12/03/18	0.62	
12/04/18	0.61		12/04/18	0.87		12/04/18	0.65	
12/05/18	0.54		12/05/18	0.89		12/05/18	0.63	
12/06/18	0.57		12/06/18	0.95		12/06/18	0.52	
12/07/18	0.54		12/07/18	0.95		12/07/18	0.63	
12/08/18	0.66		12/08/18	0.94		12/08/18	0.66	
12/09/18	0.56		12/09/18	0.95		12/09/18	0.63	
12/10/18	0.57		12/10/18	0.94		12/10/18	0.63	
12/11/18	0.55		12/11/18	0.96		12/11/18	0.62	
12/12/18	0.64		12/12/18	0.94		12/12/18	0.59	
12/13/18	0.59		12/13/18	0.96		12/13/18	0.58	
12/14/18	0.68		12/14/18	0.96		12/14/18	0.64	
12/15/18	0.67		12/15/18	0.95		12/15/18	0.70	
12/16/18	0.60		12/16/18	0.96		12/16/18	0.73	
12/17/18	0.53		12/17/18	0.95		12/17/18	0.62	
12/18/18	0.60		12/18/18	0.91		12/18/18	0.61	
12/19/18	0.61		12/19/18	0.83		12/19/18	0.63	
12/20/18	0.59		12/20/18	0.96		12/20/18	0.60	
12/21/18	0.65		12/21/18	0.92		12/21/18	0.60	
12/22/18	0.57		12/22/18	0.87		12/22/18	0.67	
12/23/18	0.64		12/23/18	0.84		12/23/18	0.59	
12/24/18	0.66		12/24/18	0.85		12/24/18	0.64	
12/25/18	0.64		12/25/18	0.83		12/25/18	0.59	
12/26/18	0.64		12/26/18	0.87		12/26/18	0.56	
12/27/18	0.58		12/27/18	0.85		12/27/18	0.64	
12/28/18	0.50		12/28/18	0.83		12/28/18	0.66	
12/29/18	0.67		12/29/18	0.84		12/29/18	0.64	
12/30/18	0.66		12/30/18	0.89		12/30/18	0.65	
12/31/18	0.54		12/31/18	0.79		12/31/18	0.61	

Data logger daily minimum value is obtained from the minimum value of all the valid every one minute values collected in one day.

Data logger daily minimum value is obtained from the minimum value of all the valid every one minute values collected in one day.

Data logger daily minimum value is obtained from the minimum value of all the valid every one minute values collected in one day.

Legend: MinCl\_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.  
MinCl\_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.  
MinCl\_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

New York City Department of Environmental Protection  
Bureau of Water Supply


Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points

Low Service			High Service		
Date	MinCl_1SCL1	Remark 1	Date	MinCl_1SCH3	Remark 2
12/01/18	1.01		12/01/18	0.82	
12/02/18	0.99		12/02/18	0.82	
12/03/18	0.97		12/03/18	0.68	
12/04/18	0.71		12/04/18	0.68	
12/05/18	0.56		12/05/18	0.63	
12/06/18	0.72		12/06/18	0.66	
12/07/18	0.66		12/07/18	0.69	
12/08/18	0.92		12/08/18	0.66	
12/09/18	0.92		12/09/18	0.66	
12/10/18	0.80		12/10/18	0.58	
12/11/18	0.87		12/11/18	0.63	
12/12/18	0.93		12/12/18	0.67	
12/13/18	0.91		12/13/18	0.64	
12/14/18	0.85		12/14/18	0.66	
12/15/18	0.85		12/15/18	0.66	
12/16/18	0.83		12/16/18	0.65	
12/17/18	0.79		12/17/18	0.64	
12/18/18	0.93		12/18/18	0.66	
12/19/18	0.85		12/19/18	0.65	
12/20/18	0.89		12/20/18	0.64	
12/21/18	0.88		12/21/18	0.64	
12/22/18	0.86		12/22/18	0.68	
12/23/18	0.84		12/23/18	0.68	
12/24/18	0.82		12/24/18	0.63	
12/25/18	0.83		12/25/18	0.66	
12/26/18	0.80		12/26/18	0.64	
12/27/18	0.68		12/27/18	0.68	
12/28/18	0.54		12/28/18	0.54	
12/29/18	0.77		12/29/18	0.60	
12/30/18	0.83		12/30/18	0.66	
12/31/18	0.72		12/31/18	0.67	

Legend: MinCl\_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.  
MinCl\_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.  
Note: Croton water fed to High Service time period was determined by specific conductance greater than 150 uS/cm.



**New York City Department of Environmental Protection  
Bureau of Water Supply  
Croton Distribution Entry Point Residual Chlorine Continuous Monitoring Results**

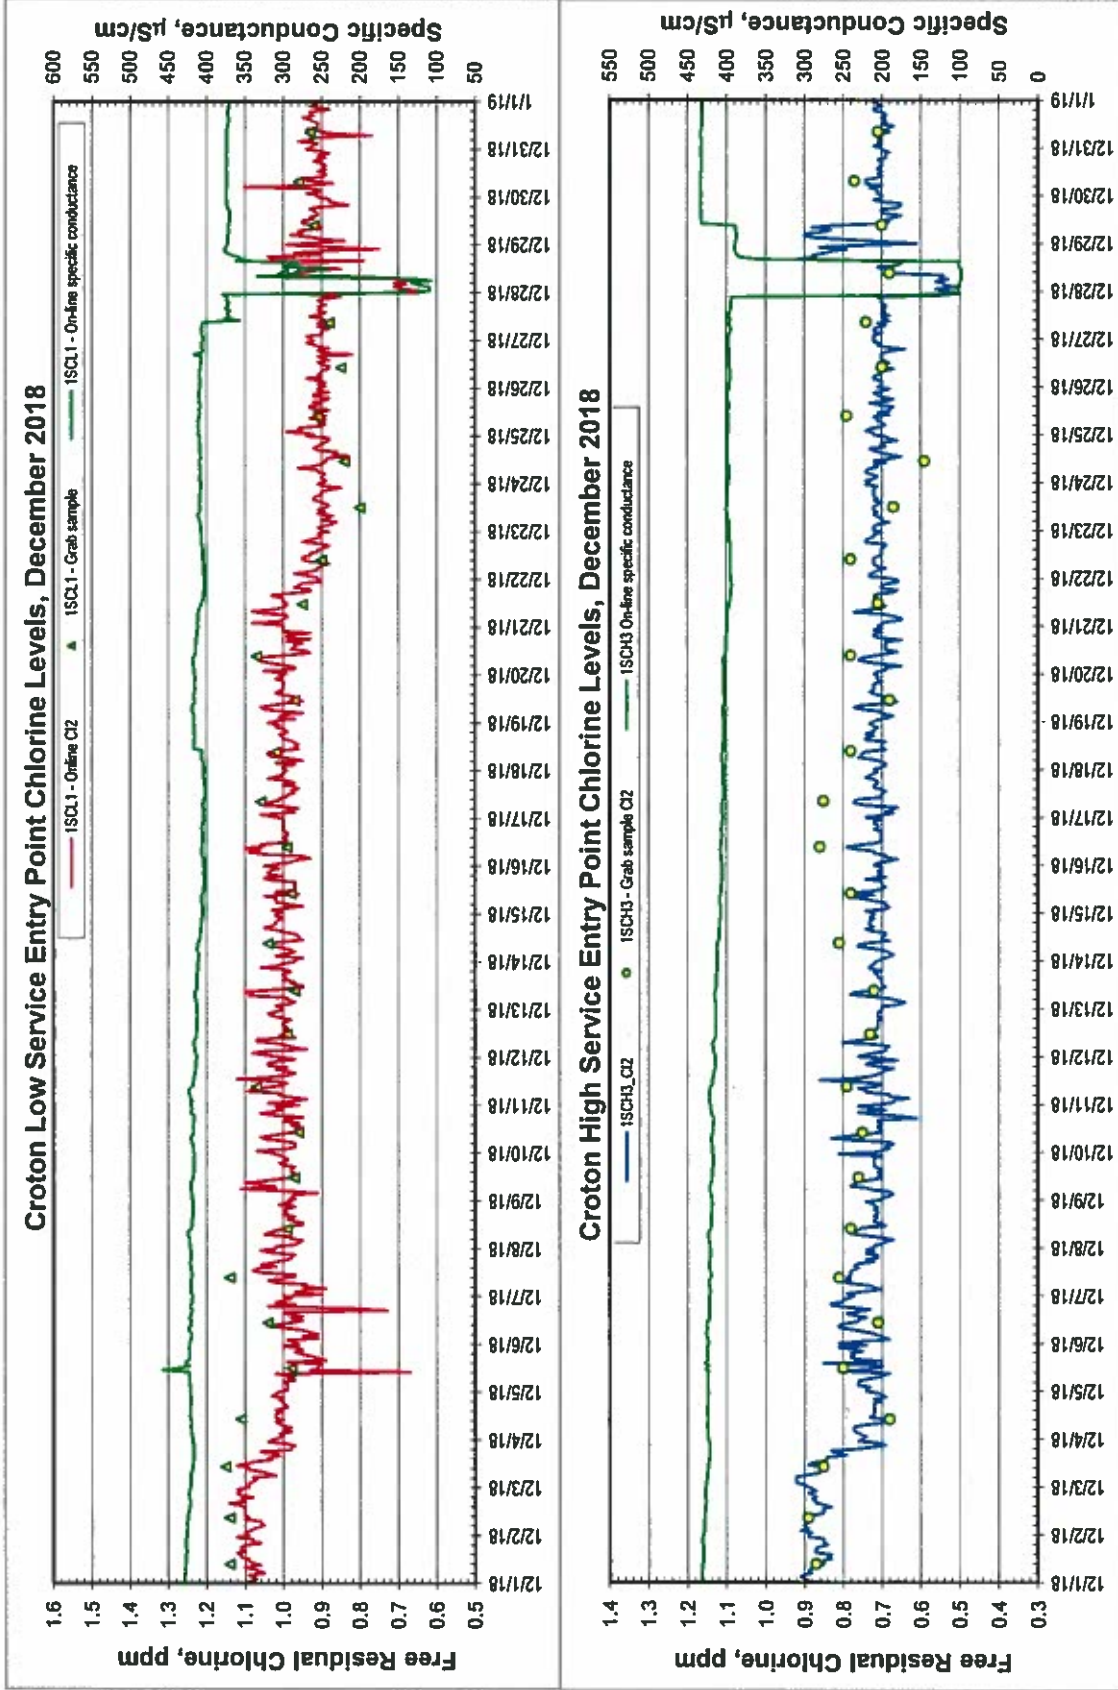


New York City Department of Environmental Protection  
Bureau of Water Supply

City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results

Chlorine Levels at City Tunnel No.1 Entry Point, December 2018



Chlorine Levels at City Tunnel No.2 Entry Point, December 2018

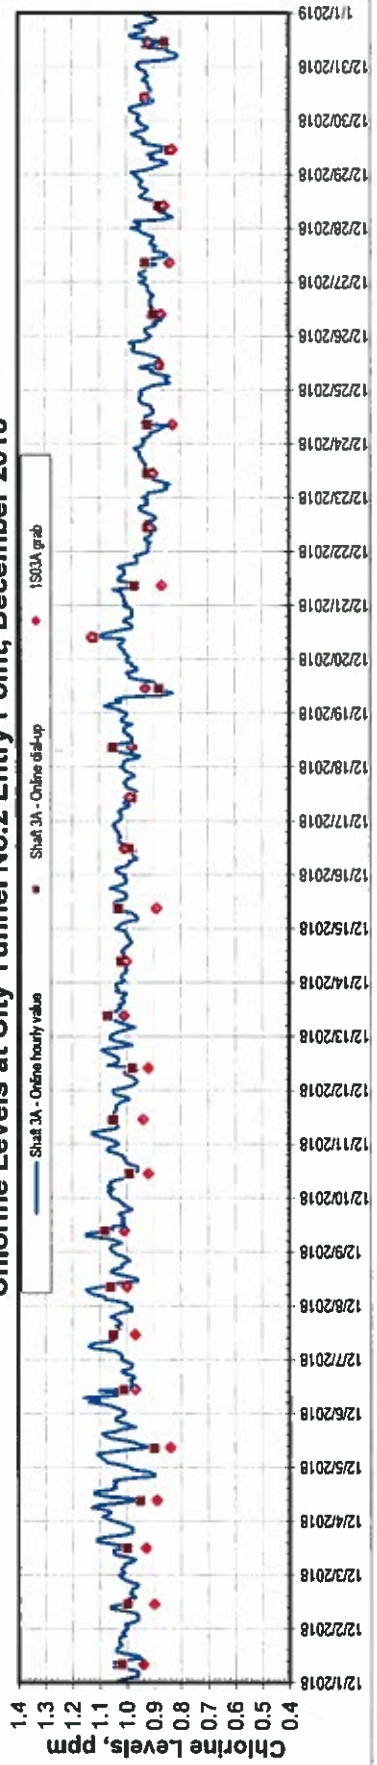

Chlorine Levels at City Tunnel No.3 Entry Point, December 2018



Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained above 0.2 ppm at all times. Since 11/4/18, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.

***DISTRIBUTION SYSTEM DISINFECTION RESIDUAL***  
***(FAD Requirement)***

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Residual Chlorine (mg/L) Distribution Samples**

**December 2018**

All Distribution Sites			
Samples	Min	Max	Average
1333	0.00	1.15	0.63

Hach DPD Method (analyte is not ELAP certified)

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	RESIDUAL CHLORINE	COMMENT
36203	12/3/18	1SCL1	Reg Stop	1.15	Max
37242	12/12/18	3ISL4	Reg Stop	0.00	Min

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

***TOTAL COLIFORM MONITORING***  
***(FAD Requirement)***

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Summary of Results for Microbiological Quality  
 Compliance Samples

12/1/2018 to 12/31/2018

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	136	136	0	0	0.0%
Brooklyn	70	200	200	0	0	0.0%
Manhattan	56	169	169	0	0	0.0%
Queens ***	79	229	229	0	0	0.0%
Staten Island	28	82	82	0	0	0.0%
Ground Water Supply ***	-	-	-	-	-	-
Total	279	816	816	0	0	0.0%

\* As determined by Colilert Quanti-Tray-18 Method (SM 9223 B).

\*\* If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.

\*\*\* There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupe Aggawel Date: 01/04/19

Director: Kember Date: 117119







REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality  
 Free Chlorine Residual and Heterotrophic Plate Count  
 Compliance Samples

12/1/2018 to 12/31/2018

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	136	136	84	0	0	-	0	0.0%
Brooklyn	70	200	200	123	0	0	-	0	0.0%
Manhattan	56	169	169	107	5	0	-	0	0.0%
Queens †	79	229	229	140	2	0	-	0	0.0%
Staten Island	28	82	82	53	6	0	-	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	-	-	-
Total	279	816	816	507	13	0	-	0	0.0%

\* Free chlorine residual is determined by Hach DPD Method (analyte is not ELAP certified).  
 \*\* Heterotrophic plate count is determined by method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result ≤ 500 CFU/mL is equivalent to a measurable FCR.  
 \*\*\* No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.

† There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: *[Signature]* Date: 01/04/19

Director: *[Signature]* Date: 1/7/19

***MICROBIOLOGICAL MONITORING***

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Coliform Monitoring Results at Sample Sites near the First Service Connection  
When Source Water Turbidity Exceeds 1.49 NTU**

**December 2018**

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform *	E.coli *

No official four-hour turbidity readings from Cat-Del source water were greater than 1.5 NTU this month.

\* As determined by Colilert Quanti-Tray-18 Method (SM 9223B). Results expressed in "MPN /100mL."

***DISTRIBUTION TURBIDITY MONITORING***

**REPORT**

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

**Turbidity (NTU) Distribution Samples**

**December 2018**

All Distribution Sites			
Samples	Min	Max	Average
1333	<0.10	1.50	0.69

Analytical Method SM 2130 B

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	TURBIDITY	COMMENT
37621	12/16/18	77550	Reg Stop	1.50	Max
36089	12/11/18	1SCH3	Reg Stop	<0.10	Min
36336	12/4/18	1SCL1	Reg Stop	<0.10	Min
36916	12/9/18	17350	Reg Stop	<0.10	Min
37233	12/12/18	33700	Reg Stop	<0.10	Min

The monthly average of all distribution samples is not to exceed 5 NTU.

***COLOR MONITORING***

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION  
 BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points

December 2018

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Catskill/Delaware 1S03 (Tunnel 1)	8	6	6	6	9	9	13	12	10	11	11	10	11	10	10	10	8	10	9	7	9	9	10	7	8	8	10	10	9	11	11
Catskill/Delaware 1S03A (Tunnel 2)	11	6	7	10	13	11	11	10	11	14	12	12	14	10	11	10	9	11	10	7	7	12	10	7	8	7	10	10	10	11	10
Catskill/Delaware 1S03B (Tunnel 3)	8	5	6	10	11	10	12	10	11	11	12	12	12	8	11	11	10	11	10	8	8	11	9	8	8	7	10	9	7	10	10
Croton System 1SCL1 (a)	4	4	4	4	4	4	4	3	4	3	4	3	3	4	4	4	4	4	3	4	4	4	4	4	4	4	3	4	4	3	4
Croton System 1SCH3 (b)	4	4	4	4	4	4	4	3	4	3	4	3	4	4	4	4	4	4	3	4	4	4	4	4	4	4	4	10	4	4	3

Analytical Method SM 2120 B. Apparent color.

The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.

(a) Croton System online as of 9/26/18 at 1SCL1.

(b) Croton water began feeding to high service on 11/19/18.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	31	6	13	9
Catskill/Delaware 1S03A (Tunnel 2)	31	6	14	10
Catskill/Delaware 1S03B (Tunnel 3)	31	5	12	10
Croton System 1SCL1 (a)	31	3	5	4
Croton System 1SCH3 (b)	31	3	10	4



Supervisor

Date 01/08/19



Director

Date 1/8/19

***FLUORIDE MONITORING***



REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points

December 2018

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Catskill/Delaware 1S03 (Tunnel 1)	0.72	0.70	0.70	0.72	0.71	0.73	0.73	0.73	0.72	0.71	0.71	0.72	0.72	0.72	0.74	0.71	0.71	0.71	0.72	0.74	0.76	0.74	0.72	0.71	0.71	0.71	0.71	0.71	0.71	0.71	0.73	0.73
Catskill/Delaware 1S03A (Tunnel 2)	0.72	0.70	0.71	0.72	0.71	0.72	0.73	0.73	0.71	0.70	0.71	0.71	0.73	0.73	0.75	0.71	0.70	0.74	0.73	0.75	0.77	0.75	0.73	0.71	0.72	0.71	0.71	0.71	0.71	0.72	0.73	0.73
Catskill/Delaware 1S03B (Tunnel 3)	0.72	0.70	0.72	0.72	0.71	0.72	0.73	0.74	0.72	0.70	0.71	0.70	0.73	0.73	0.75	0.71	0.70	0.74	0.72	0.75	0.77	0.75	0.72	0.72	0.72	0.72	0.71	0.72	0.72	0.73	0.74	
Croton System 1SCL1 (a)	0.72	0.70	0.69	0.71	0.84	0.70	0.73	0.76	0.73	0.69	0.71	0.72	0.75	0.71	0.74	0.71	0.74	0.72	0.70	0.72	0.70	0.72	0.67	0.68	0.72	0.68	0.70	0.67	0.73	0.63	0.72	
Croton System 1SCH3 (b)	0.71	0.7	0.69	0.70	0.76	0.73	0.73	0.75	0.72	0.70	0.71	0.72	0.73	0.71	0.74	0.70	0.72	0.71	0.71	0.72	0.69	0.73	0.65	0.70	0.74	0.56	0.68	0.71	0.69	0.61	0.68	

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System online as of 9/26/18 at 1SCL1.

(b) Croton water began feeding to high service on 11/19/18.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	31	0.70	0.76	0.72
Catskill/Delaware 1S03A (Tunnel 2)	31	0.70	0.77	0.72
Catskill/Delaware 1S03B (Tunnel 3)	31	0.70	0.77	0.72
Croton System 1SCL1 (a)	31	0.63	0.84	0.71
Croton System 1SCH3 (b)	31	0.56	0.76	0.70

Supervisor  Date 01/08/19

Director  Date 118119