



Vincent Sapienza, P.E.
Commissioner

Paul V. Rush, P.E.
Deputy Commissioner
Bureau of Water Supply
prush@dep.nyc.gov

59-17 Junction Boulevard
Flushing, NY 11373
T: (845) 340-7800
F: (845) 334-7175

July 10, 2019

Li Huang, P.E.
New York City Department of Health and Mental Hygiene
Environmental Sciences & Engineering
42-09 28th Street, 14th Floor CN# 56
Long Island City, NY 11101

Patrick Palmer
New York State Department of Health
Bureau of Water Supply Protection, NYC Watershed Section
Empire State Plaza, Corning Tower, Room 1198
Albany, NY 12237

Katie Lynch
United States Environmental Protection Agency
Clean Water Division - New York City Water Supply Protection Program
290 Broadway, 24th Floor
New York, New York 10007-1866

RE: Monthly Water Quality Report for June 2019

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **June 2019**. There was no well pumpage to distribution in the Groundwater System this month. Croton water fed into distribution from June 1, 2019 through June 3, 2019 at 11:11 AM. In addition to the following list of compliance reports, a disc of electronic files containing compliance and non-compliance data for this month is enclosed with this report.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
 - Summary
 - Positive Samples
 - Resamples
- Chlorine Residual Reports
 - Entry Point Online
 - Entry Point Daily Minimum
 - Heterotrophic Plate Count
 - Monthly Summary
- Distribution Turbidity Reports
 - Distribution Turbidity Report
 - Source Water > 1.49 NTU Table
- Color Entry Point Report

- Fluoride Reports
 - Fluoride Entry Point Report
 - Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

FAD REQUIREMENTS

1. *Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):*

Requirements met. The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from January 1, 2019 to June 30, 2019. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 0.00% for the Catskill/Delaware System for this time period.

2. *Raw Water Turbidity (Section 141.71(a)(2)):*

Requirements met. The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest reported turbidity value was 1.0 NTU on the Catskill/Delaware System for the month.

3. *Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):*

Requirements met. As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual value for entry point readings for the Catskill/Delaware System from sites 1S03 (Tunnel 1) was 0.56 mg/L, 1S03A (Tunnel 2) was 0.72 mg/L, and 1S03B (Tunnel 3) was 0.55 mg/L.

The Croton Filtration Plant was online and continuously feeding the Croton Low Service entry point from June 1, 2019 through June 3, 2019 at 11:11 AM. The Croton High Service entry point was offline throughout June 2019. The minimum daily free chlorine residual value for Croton entry point readings from site 1SCL1 (Low Service) was 0.61 mg/L.

4. *Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):*

Requirements met. All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.03 mg/L.

A total of 1311 distribution samples were tested for free chlorine residual this month. For all distribution sites free chlorine residual ranged from 0.03 mg/L to 1.20 mg/L, and averaged 0.59 mg/L for the month.

The second quarter of 2019 chlorine residual Running Average was 0.57 mg/L. This meets the MRDL of 4 mg/L for the quarterly running annual average of all systems samples.

5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):

Requirements met. The results for the second quarter of 2018 were included in the report dated June 7, 2019 (for the May 2019 reporting period).

6. Total Coliform Monitoring (Section 141.71(b)(5)):

Requirements met. The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 804 compliance samples were tested for total coliform during this period. HPC were all ≤ 500 CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC > 500 CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, there were three (3) samples that tested positive for total coliform. No samples tested positive for *E. coli*.

- A sample collected on 06/18/2019 from Site 41150 (sample station opposite 110-08 west side of Colonial Avenue, 12 inch main) was positive for total coliform. Repeat sampling on 6/20/2019 was coliform negative at all locations.
- A sample collected on 06/20/2019 from Site 25950 (sample station in front of 2187 Flatbush Avenue, 16 inch main) was positive for total coliform. Repeat sampling on 6/22/2019 was coliform negative at all locations.
- A sample collected on 06/25/2019 from Site 38250 (sample station in front of 309 north side of E 87th Street, 12 inch main) was positive for total coliform. Repeat sampling on 6/27/2019 was coliform negative at all locations.

OTHER WATER QUALITY MONITORING**7. Microbiological Monitoring:**

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity > 1.49 NTU, was not required this month, but all of these samples were negative for total coliform.

The analyses of 507 distribution Operational samples resulted in two (2) samples testing positive for total coliform. No *E. coli* were detected.

The analyses of 240 Pre-Finished samples resulted in three (3) samples testing positive for total coliform. No *E. coli* were detected.

The analyses of 582 Autosampler Pre-finished samples resulted in 10 samples testing positive for total coliform and two (2) were positive for *E. coli*.

8. Distribution Turbidity Monitoring:

For distribution sites turbidity ranged from 0.10 to 1.31 NTU and averaged 0.68 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

9. Color Monitoring:

The MCL of 15 units for color was met at each Catskill/Delaware and Croton entry point for the

month. Daily analyses of entry point samples (93 samples in total), produced monthly average color values of six (6) units for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), 1S03B (Tunnel 3), and four (4) units for site 1SCL1 (Croton Low Service).

10. Volatile Organic/TTHM/HAA5 Monitoring:

Monthly Results: Twenty (22) distribution and three (3) entry point samples were collected for volatile organic contaminant (VOC) analysis. All VOC samples from distribution sites and entry points were below detection. Twenty (22) TTHM distribution samples were collected ranging from 33 µg/L to 53 µg/L. Three (3) TTHM entry point samples were collected ranging from 29 µg/L to 52 µg/L. Twenty (22) HAA5 distribution samples were collected ranging from 26 µg/L to 48 µg/L. Three (3) HAA5 entry point samples were collected ranging from 31 µg/L to 41 µg/L.

11. Semivolatile and Other Organic Chemicals/parameters:

EPA Method 525.3 monitoring for 112 compounds of specified and unspecified organic parameters was conducted on June 3, 2019 at five (5) sites as resamples due to QC failures for May routine samples. All semi-volatile organic contaminant samples from these distribution sites were below detection limits.

12. Fluoride Monitoring:

Daily analyses of entry point samples (93 samples in total), produced monthly average fluoride levels of 0.72 mg/L for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), 1S03B (Tunnel 3), and 0.75 mg/L for site 1SCL1 (Croton Low Service). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

13. Other Monitoring:

Monitoring for Taste and Odor (T&O) compounds Geosmin and 2-Methylisoborneol (MIB) was conducted in June on four (4) Croton water samples at New Croton Reservoir. All results were ND, including results from May 28, 2019 sampling. Contract laboratory reports of available data are included as pdf files on the disc of electronic files enclosed with this report.

Please feel free to contact me at (845) 340-7701 if you would like to discuss any of this information in greater detail.

Sincerely,

A handwritten signature in blue ink, appearing to read "Steven C. Schindler", followed by the initials "for SS" in a cursive script.

Steven C. Schindler
Director, Water Quality

Enclosure

cc:

Mr. Andrew Brunsden, Inspector General for NYCDEP
Mr. Kenneth Kosinski, NYSDEC
Mr. David Kvinge, Westchester County Water Agency (by email only)
Mr. Huan Li, NYCDOHMH
Mr. Trevor McProud, NYCDOHMH
Mr. Andy Tse, NYSDOH (by email only)
Mr. Steven Zahn, NYSDEC – Region 2

bcc:

Electronic file:

V. Sapienza, P.E., Commissioner

K. Alderisio

A. Bader

D. Borchert

K. Cipriano

K. Czarnogorski/file

S. Freud

C. Glaser

L. Janus, Ph.D.

K. Kane

L. Lu, Ph.D.

C. McCormack

D. Mulvihill

W. Melendez, P.E.

L. Occhiuto

A. Reaves

S. Riviere

D. Robinson

P. Rush, P.E.

S. Schindler (hard copy)

D. Warne

M. Warne

V. Xu

TABLE OF CONTENTS FOR CD FILES

June 2019 Monthly Water Quality Report

Microbiological Reports:

Summary of Coliform Compliance Samples
Coliform Positive Compliance Samples
Coliform Resample for Positive Compliance Samples
Summary of Coliform Operational Samples

(NYC_Micro_Summary_Compliance_201906.xls)
(NYC_Micro_Compliance_Positives_201906.xls)
(NYC_Micro_Compliance_Resamples_201906.xls)
(NYC_Micro_Operational_201906.pdf)
(NYC_Micro_Summary_Operational_201906.xls)
(NYC_Micro_Operational_201906.pdf)
(NYC_Micro_Operational_Positives_201906.xls)
(NYC_Micro_Operational_201906.pdf)
(NYC_Micro_Operational_Resamples_201906.xls)
(NYC_EP_Coliform_For_Source_Turb_GT_149_201906.snp)
(NYC_Monthly_Alldata_201906.xls|Micro)

Coliform Positive Operational Samples

Coliform Resample for Positive Distribution Operational Samples

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU
All Microbiological Results

Free Chlorine Residual (FCR) Reports:

Entry Point FCR On-Line Monitoring Results

Daily Minimum FCR at Entry Points

(Entry_Shift_Cl2_Onln_201906_Fig.pdf)
(Colon_Entry_Point_Cl2_201906_Fig.pdf)
(Entry_Shift_Cl2_Onln_201906_Tbl.pdf)
(Colon_Entry_Point_Cl2_201906_Tbl.pdf)

FCR and Heterotrophic Plate Count (HPC) Compliance Samples
FCR and HPC of Operational Samples

(NYC_Micro_Summary_FCR_&_HPC_Compliance_201906.xls)
(NYC_Micro_Operational_201906.pdf)

Summary of FCR of Distribution Samples (Quarterly)

Summary of FCR of Distribution Samples (Monthly)

FCR of all Distribution Sites

(NYC_FCR_Quarterly_Summary_2019Q2.xls)
(NYC_FCR_Monthly_Summary_201906.xls)
(NYC_FCR_Monthly_Alldata_201906.xls)

Turbidity Reports:

Summary of Turbidity of Distribution Samples

Turbidity of all Distribution Sites

(NYC_Turbidity_Monthly_Summary_201906.xls)
(NYC_Turbidity_Monthly_Alldata_201906.xls)

Color Reports:

Color for Entry Point Samples

(Entry_Point_Color_Monthly_201906.xls)

Fluoridation Reports:

Summary of Fluoride Levels of Distribution Samples

Fluoride Daily Entry Point Report for Surface Water Systems

Fluoride of all Distribution Sites

(NYC_Fluoride_Monthly_Summary_201906.xls)
(Entry_Point_Fluoride_Monthly_201906.xls)
(NYC_Fluoride_Monthly_Alldata_201906.xls)

Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP)

Reports:

Total Trihalomethanes (TTHM) & VOC Monthly Report

Semivolatiles EPA Method 525 Report

Haloacetic Acids (HAA5) Monthly Report

(NYC_TTHM_&_VOC_Rpt_201906.xls)
(NYC_SOC_Rpt_201906_resample.xls)
(NYC_HAA5_Monthly_Rpt_201906.xls)

(807915_T&O_Sample_20190528.pdf, 808565_T&O_Sample_20190603.pdf,
809885_T&O_Sample_20190610.pdf, 811794_T&O_Sample_20190619.pdf,
812487_T&O_Sample_20190624.pdf)

Taste & Odor Sampling Reports from EEA Lab

Summary of EPA Organic Method Reports

(NYC_VOC_HAA5_Rpt_201906.pdf)

Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:

All parameters for June 2019

Mercury results from EEA LAB

(NYC_Monthly_Alldata_201906.xls)
(809239_Hg_201906.pdf)

RAW WATER FECAL COLIFORM CONCENTRATIONS
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Catskill/Delaware System Raw Water Fecal Coliform Compliance Report

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18BT) - Raw Water **Period: 04/17 To: 06/19**

Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
4-17	30	0	0.00	0.00
5-17	31	0	0.00	0.00
6-17	30	0	0.00	0.00
7-17	31	0	0.00	0.00
8-17	31	0	0.00	0.00
9-17	30	0	0.00	0.00
10-17	31	0	0.00	0.00
11-17	30	0	0.00	0.00
12-17	31	0	0.00	0.00
1-18	31	0	0.00	0.00
2-18	28	1	3.57	0.55
3-18	31	0	0.00	0.55
4-18	30	0	0.00	0.55
5-18	31	0	0.00	0.55
6-18	30	0	0.00	0.55
7-18	31	0	0.00	0.55
8-18	31	0	0.00	0.00
9-18	30	2	6.67	1.09
10-18	31	2	6.45	2.17
11-18	30	0	0.00	2.19
12-18	31	0	0.00	2.17
1-19	31	0	0.00	2.17
2-19	28	0	0.00	2.21
3-19	31	0	0.00	1.10
4-19	30	0	0.00	0.00
5-19	31	0	0.00	0.00
6-19	30	0	0.00	0.00

D. W. Robinson

7/2/19

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

7/2/2019

RAW WATER TURBIDITY
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water **Period: June, 2019**

Date	Turbidity (NTU)						Total Coliform	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM	(Colonies per 100 mL)	
6/1/19	0.80	0.80	0.80	0.75	0.85	0.85	E32	E5
6/2/19	0.80	0.85	0.75	0.70	0.75	1.0	E34	E4
6/3/19	0.85	0.75	0.80	0.80	0.75	0.85	>=E24	E2
6/4/19	0.80	0.75	0.80	0.75	0.75	0.75	E32	E2
6/5/19	0.75	0.80	0.80	0.80	0.75	0.70	LE	E1
6/6/19	0.80	0.75	0.75	0.70	0.65	0.70	E12	<1
6/7/19	0.75	0.65	0.75	0.70	0.65	0.75	E4	<1
6/8/19	0.70	0.75	0.70	0.70	0.80	0.75	E12	<1
6/9/19	0.75	0.75	0.75	0.70	0.65	0.70	E20	E1
6/10/19	0.65	0.65	0.65	0.60	0.60	0.60	E15	<1
6/11/19	0.70	0.60	0.65	0.60	0.60	0.75	E2	<1
6/12/19	0.65	0.65	0.60	0.65	0.65	0.65	E15	<1
6/13/19	0.65	0.65	0.65	0.75	0.65	0.60	E10	E2
6/14/19	0.65	0.70	0.70	0.65	0.65	0.65	<5	<1
6/15/19	0.65	0.70	0.70	0.65	0.75	0.75	E6	E1
6/16/19	0.65	0.70	0.70	0.70	0.65	0.75	E14	<1
6/17/19	0.65	0.65	0.75	0.60	0.65	0.60	E10	<1
6/18/19	0.75	0.70	0.70	0.65	0.70	0.65	E5	E6
6/19/19	0.65	0.65	0.70	0.65	0.70	0.70	E10	E1
6/20/19	0.75	0.70	0.70	0.65	0.65	0.65	E10	E2
6/21/19	0.65	0.60	0.60	0.55	0.60	0.70	E20	E1
6/22/19	0.60	0.60	0.60	0.60	0.65	0.55	E26	E4
6/23/19	0.65	0.65	0.65	0.65	0.65	0.65	E4	E1
6/24/19	0.60	0.65	0.70	0.65	0.65	0.70	E15	E1
6/25/19	0.65	0.60	0.65	0.60	0.60	0.60	E35	E2
6/26/19	0.70	0.65	0.65	0.75	0.60	0.65	E25	E1
6/27/19	0.80	0.75	0.70	0.70	0.80	0.75	E10	E1
6/28/19	0.65	0.70	0.70	0.65	0.65	0.65	E35	<1
6/29/19	0.70	0.65	0.65	0.75	0.65	0.70	E10	E1
6/30/19	0.65	0.70	0.75	0.80	0.85	0.75	E15	E1

.: Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error,
E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with
dilution based value

1. Does a raw water turbidity M & R violation exist? ☐ Yes ☒ No
2. Does the turbidity reading exceed 5 NTU at any time? ☐ Yes ☒ No
If yes, check for MCL violation, and notify state by the end of the next business day.
3. Minimum number of microbiological samples required per week: 5
4. A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

D. W. Robinson

7/2/19

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

7/2/2019

All results that fall within the scope of the NELAP program meet that program's requirements
unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 07/02/2019 12:52 pm

Page 2 of 3



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Data Qualifiers and Additional Notes

Period: June, 2019

Date/Time	Site	Analytes Affected	Qualifier
6/5/19 09:52	DEL18DT	Total Coliform	QC blank contamination. Non sheen colonies on both funnels.
6/7/19 09:27	DEL18DT	Total Coliform	The duplicate analysis was not within the control limits.
6/18/19 09:37	DEL18DT	Total Coliform	The duplicate analysis was not within the control limits.
6/10/19 09:12	DEL18DT	Total Coliform	QC blank contamination


Analytical Methods

Coliform, Fecal	-	SM 9222D (2006)
Coliform, Total	-	SM 9222B (2006)
Turbidity	-	SM 2130B (01)


ENTRY POINT CHLORINE RESIDUAL
(FAD Requirement)

New York City Department of Environmental Protection
Bureau of Water Supply
City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results


Chlorine Levels at City Tunnel No.1 Entry Point, June 2019

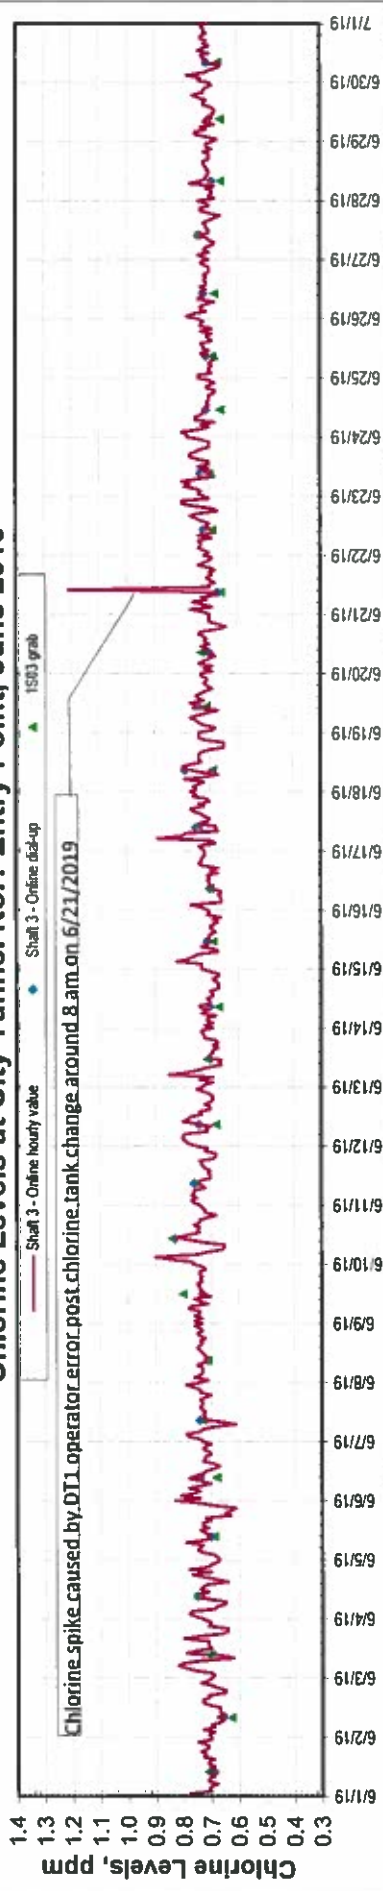

Chlorine Levels at City Tunnel No.2 Entry Point, June 2019

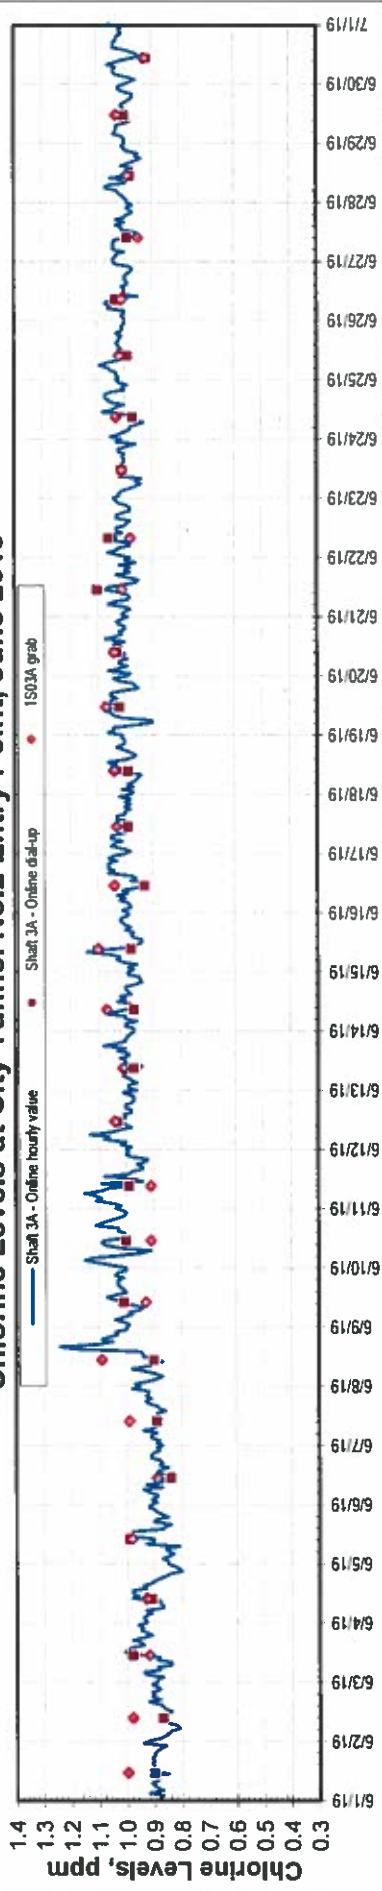

Chlorine Levels at City Tunnel No.3 Entry Point, June 2019

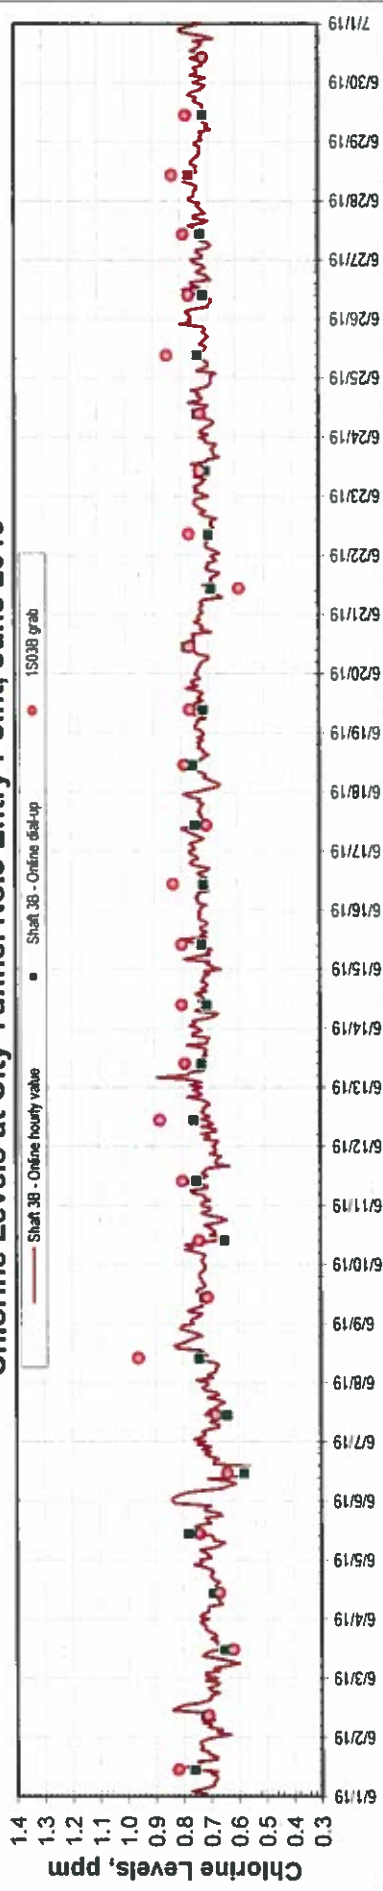

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times.
Since 3/10/19, all online readings, grab and online dial-up readings were recorded in Eastern Daylight Saving Time.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System


Tunnel No.1 (Catskill) at Shaft 3			Tunnel No.2 (Delaware) at Shaft 3A			Tunnel No.3 (Cat/Del) at Shaft 3B		
Date	MinCl_1DL	Remark 1	Date	MinCl_2DL	Remark 2	Date	MinCl_3DL	Remark 3
06/01/19	0.66		06/01/19	0.82		06/01/19	0.65	
06/02/19	0.62		06/02/19	0.80		06/02/19	0.65	
06/03/19	0.56		06/03/19	0.80		06/03/19	0.59	
06/04/19	0.61		06/04/19	0.78		06/04/19	0.65	
06/05/19	0.58		06/05/19	0.80		06/05/19	0.64	
06/06/19	0.65		06/06/19	0.72		06/06/19	0.55	
06/07/19	0.59		06/07/19	0.81		06/07/19	0.64	
06/08/19	0.66		06/08/19	0.85		06/08/19	0.65	
06/09/19	0.67		06/09/19	0.92		06/09/19	0.68	
06/10/19	0.60		06/10/19	0.85		06/10/19	0.61	
06/11/19	0.63		06/11/19	0.91		06/11/19	0.63	
06/12/19	0.63		06/12/19	0.90		06/12/19	0.64	
06/13/19	0.64		06/13/19	0.93		06/13/19	0.67	
06/14/19	0.61		06/14/19	0.90		06/14/19	0.65	
06/15/19	0.63		06/15/19	0.93		06/15/19	0.69	
06/16/19	0.64		06/16/19	0.90		06/16/19	0.68	
06/17/19	0.66		06/17/19	0.96		06/17/19	0.70	
06/18/19	0.63		06/18/19	0.93		06/18/19	0.66	
06/19/19	0.67		06/19/19	0.86		06/19/19	0.70	
06/20/19	0.61		06/20/19	0.96		06/20/19	0.67	
06/21/19	0.65		06/21/19	0.92		06/21/19	0.64	
06/22/19	0.63		06/22/19	0.96		06/22/19	0.64	
06/23/19	0.68		06/23/19	0.94		06/23/19	0.65	
06/24/19	0.65		06/24/19	0.92		06/24/19	0.66	
06/25/19	0.63		06/25/19	0.98		06/25/19	0.67	
06/26/19	0.64		06/26/19	0.95		06/26/19	0.64	
06/27/19	0.58		06/27/19	0.94		06/27/19	0.68	
06/28/19	0.65		06/28/19	0.94		06/28/19	0.71	
06/29/19	0.63		06/29/19	0.94		06/29/19	0.68	
06/30/19	0.66		06/30/19	0.89		06/30/19	0.66	

Legend: MinCl_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

MinCl_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

MinCl_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

New York City Department of Environmental Protection
Bureau of Water Supply
Croton Distribution Entry Point Residual Chlorine Continuous Monitoring Results

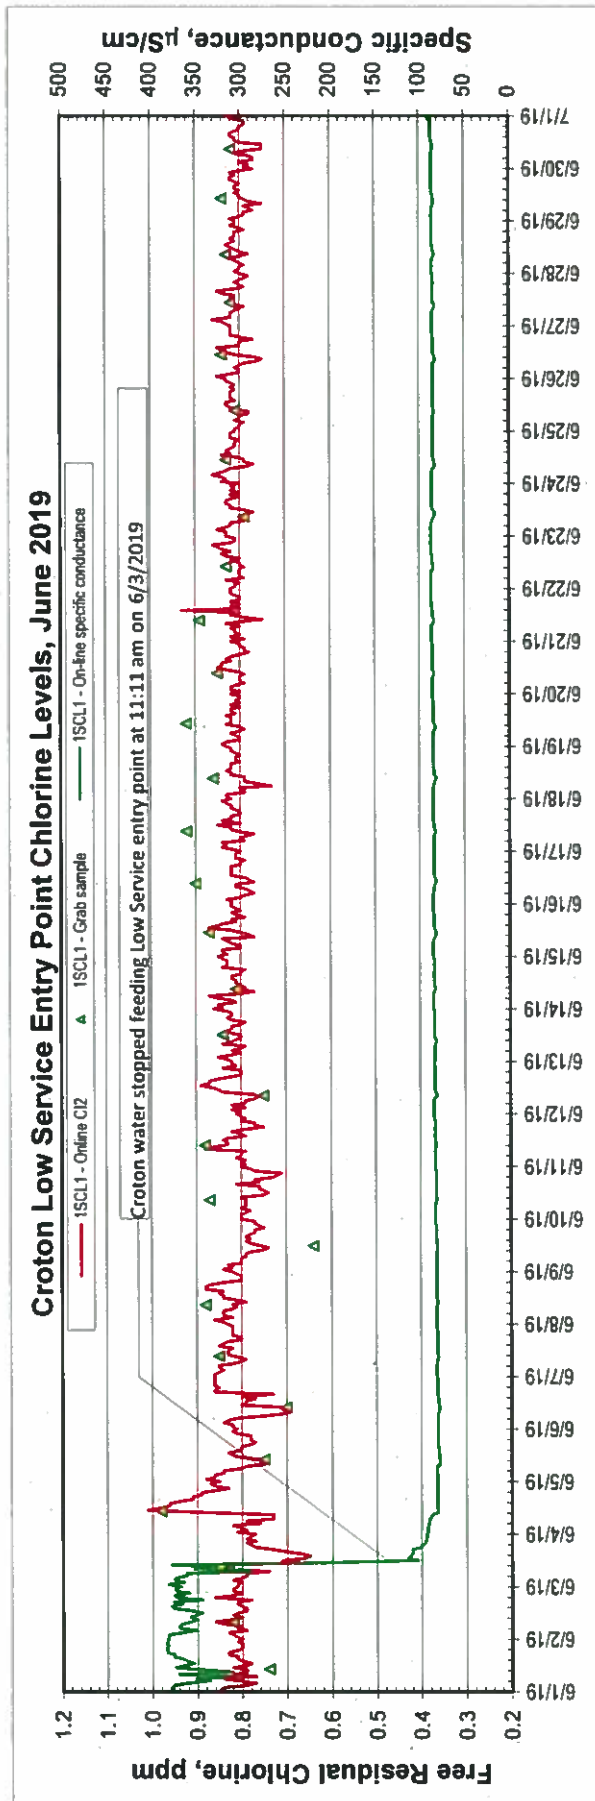

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 3/10/19, all online readings, grab and online dial-up readings were recorded in Eastern Daylight Saving Time.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points

Low Service			High Service	
Date	MinCl_1SCL1	Remark 1	Date	MinCl_1SCH3
06/01/19	0.71		06/01/19	
06/02/19	0.74		06/02/19	
06/03/19	0.61	Croton water stopped feeding Low Service entry point at 11:11am on 6/20/19	06/03/19	
06/04/19			06/04/19	
06/05/19			06/05/19	
06/06/19			06/06/19	
06/07/19			06/07/19	
06/08/19			06/08/19	
06/09/19			06/09/19	
06/10/19			06/10/19	
06/11/19			06/11/19	
06/12/19			06/12/19	
06/13/19			06/13/19	
06/14/19			06/14/19	
06/15/19			06/15/19	
06/16/19			06/16/19	
06/17/19			06/17/19	
06/18/19			06/18/19	
06/19/19			06/19/19	
06/20/19			06/20/19	
06/21/19			06/21/19	
06/22/19			06/22/19	
06/23/19			06/23/19	
06/24/19			06/24/19	
06/25/19			06/25/19	
06/26/19			06/26/19	
06/27/19			06/27/19	
06/28/19			06/28/19	
06/29/19			06/29/19	
06/30/19			06/30/19	

No Croton water.

No Croton water.

Legend: MinCl_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.

MinCl_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.

Note: Croton water fed to High Service time period was determined by specific conductance greater than 150 uS/cm.

DISTRIBUTION SYSTEM DISINFECTION RESIDUAL
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Residual Chlorine (mg/L) Distribution Samples

June 2019

All Distribution Sites			
Samples	Min	Max	Average
1311	0.03	1.20	0.59

Hach DPD Method (analyte is not ELAP certified)

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	RESIDUAL CHLORINE	COMMENT
17131	6/15/19	40200	Reg Stop	1.20	Max
15961	6/5/19	79150	Reg Stop	0.03	Mini

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Residual Chlorine (mg/L) Averages of Distribution Samples

Second Quarter 2019

Monthly Average		Quarterly Average			Running Annual Average †
		3rd Quarter of 2018	4th Quarter of 2018	1st Quarter of 2019	
Apr-19	May-19	Jun-19			
0.47	0.55	0.59	0.58	0.61	0.54
					0.57

Hach DPD Method (analyte is not ELAP certified)

† The Running Annual Average of all distribution sites is calculated four times a year (at the end of every quarter) by taking the average of the quarterly average of this quarter and the three previous quarters, and is not to exceed the MRDL of 4.0 mg/L.

TOTAL COLIFORM MONITORING
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Summary of Results for Microbiological Quality Compliance Samples 6/1/2019 to 6/30/2019

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	130	130	0	0	0.0%
Brooklyn	70	198	198	1	0	0.5%
Manhattan	57	167	167	1	0	0.6%
Queens ***	79	227	227	1	0	0.4%
Staten Island	28	82	82	0	0	0.0%
Ground Water Supply ***	-	-	-	-	-	-
Total	280	804	804	3	0	0.4%

* As determined by Colilert Quanti-Tray-18 Method (SM 9223 B).

** If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.

*** There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupe Agard Date: 07/03/19

Director: Ken B... Date: 7/9/19

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

[illegible]

• As determined by Colilert Quanti-Tray-18 Method (SM 9223 B). Results expressed in "MPN/100 mL."

.. As determined by Hach DPD Method (analyte is not ELAP certified).

Supervisor: Russ Agard Date: 07/08/19

Director: Wendy Date: 7/9/19

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

6/1/2019 to 6/30/2019

- * As determined by Colilert Quanti-Tray-18 Method (SM 9223 B). Results expressed in "MPN/100 mL."
- ** As determined by Hach DPD Method (analyte is not ELAP certified).

Director: Ken Baker Date: 7/9/19

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality Free Chlorine Residual and Heterotrophic Plate Count Compliance Samples

6/1/2019 to 6/30/2019

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	130	130	86	0	0	--	0	0.0%
Brooklyn	70	198	198	130	1	0	-	0	0.0%
Manhattan	57	167	167	117	9	0	-	0	0.0%
Queens †	79	227	227	160	29	0	-	0	0.0%
Staten Island	28	82	82	59	10	0	-	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	-	-	-
Total	280	804	804	552	49	0	-	0	0.0%

* Free chlorine residual is determined by Hach DPD Method (analyte is not ELAP certified).

** Heterotrophic plate count is determined by method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result ≤ 500 CFU/mL is equivalent to a measurable FCR.

*** No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.

† There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupe Agard Date: 07/24/19

Director: Verber Date: 7/9/19

MICROBIOLOGICAL MONITORING

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Coliform Monitoring Results at Sample Sites near the First Service Connection When Source Water Turbidity Exceeds 1.49 NTU

June 2019

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform *	E.coli *

No official four-hour turbidity readings from Cat-Del source water were greater than 1.5 NTU this month.

* As determined by Collert Quanti-Tray-18 Method (SM 9223B). Results expressed in "MPN /100mL."

DISTRIBUTION TURBIDITY MONITORING

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Turbidity (NTU) Distribution Samples

June 2019

All Distribution Sites			
Samples	Min	Max	Average
1311	0.10	1.31	0.68

Analytical Method SM 2130 B

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	TURBIDITY	COMMENT
18227	6/25/19	41900	Reg Stop	1.31	Max
15697	6/2/19	3SC26	Reg Stop	0.10	Min

The monthly average of all distribution samples is not to exceed 5 NTU.

COLOR MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points

June 2019

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
Catskill/Delaware 1S03 (Tunnel 1)	7	6	7	5	6	6	6	6	6	6	6	6	5	7	7	6	7	6	6	7	6	6	6	6	6	6	7	6	7	6
Catskill/Delaware 1S03A (Tunnel 2)	7	6	7	6	7	6	6	6	6	7	6	6	5	7	6	6	6	6	6	7	6	6	6	6	6	6	6	7	6	5
Catskill/Delaware 1S03B (Tunnel 3)	7	6	7	6	6	7	6	6	6	6	6	6	5	6	7	6	6	6	6	6	6	6	6	6	7	6	6	6	6	6
Croton System 1SCL1 (a)	4	4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Croton System 1SCH3 (a)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Analytical Method SM 2120 B. Apparent color.

The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.

(a) Croton System offline as of 6/4/19 at 1SCL1.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	30	5	7	6
Catskill/Delaware 1S03A (Tunnel 2)	30	5	7	6
Catskill/Delaware 1S03B (Tunnel 3)	30	5	7	6
Croton System 1SCL1 (a)	3	4	4	4
Croton System 1SCH3 (a)	-	-	-	-

Supervisor 

Date 07/08/19

Director 

Date 7/8/19

FLUORIDE MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points

June 2019

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
Catskill/Delaware 1S03 (Tunnel 1)	0.71	0.71	0.72	0.70	0.72	0.70	0.72	0.70	0.71	0.72	0.71	0.72	0.72	0.73	0.72	0.72	0.73	0.73	0.72	0.71	0.71	0.72	0.72	0.73	0.72	0.72	0.73	0.74	0.74	0.72
Catskill/Delaware 1S03A (Tunnel 2)	0.71	0.72	0.71	0.72	0.72	0.71	0.73	0.70	0.71	0.72	0.71	0.72	0.72	0.73	0.72	0.73	0.73	0.73	0.72	0.72	0.71	0.72	0.72	0.73	0.73	0.72	0.74	0.74	0.75	0.72
Catskill/Delaware 1S03B (Tunnel 3)	0.70	0.72	0.71	0.72	0.72	0.70	0.72	0.70	0.71	0.72	0.71	0.72	0.72	0.73	0.72	0.72	0.73	0.73	0.72	0.72	0.71	0.72	0.72	0.72	0.72	0.72	0.74	0.73	0.74	0.72
Croton System 1SCL1 (a)	0.77	0.71	0.77	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Croton System 1SCH3 (a)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System offline as of 6/4/19 at 1SCL1.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	30	0.70	0.74	0.72
Catskill/Delaware 1S03A (Tunnel 2)	30	0.70	0.75	0.72
Catskill/Delaware 1S03B (Tunnel 3)	30	0.70	0.74	0.72
Croton System 1SCL1 (a)	3	0.71	0.77	0.75
Croton System 1SCH3 (a)	-	-	-	-

Supervisor



Date

07/08/19

Director



Date

7/8/19