



Rohit T. Aggarwala
Commissioner

Paul V. Rush, P.E.
Deputy Commissioner

59-17 Junction Boulevard
Flushing, NY 11373

T: (845) 340-7800
F: (845) 334-7175
prush@dep.nyc.gov

May 10, 2022

Li Huang, P.E.
New York City Department of Health and Mental Hygiene
Environmental Sciences & Engineering
42-09 28th Street, 14th Floor CN# 56
Long Island City, NY 11101

Patrick Palmer
New York State Department of Health
Bureau of Water Supply Protection, NYC Watershed Section
Empire State Plaza, Corning Tower, Room 1198
Albany, NY 12237

Katie Lynch
United States Environmental Protection Agency
Clean Water Division - New York City Water Supply Protection Program
290 Broadway, 24th Floor
New York, New York 10007-1866

RE: Monthly Water Quality Report for April 2022

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **April 2022**. There was no well pumpage to distribution in the Groundwater System this month. Croton water was feeding into distribution from April 1 to 6, 2022. In addition to the following list of compliance reports, electronic files containing compliance and non-compliance data for this month are being emailed to you.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
 - Summary
 - Positive Samples
 - Resamples
- Chlorine Residual Reports
 - Entry Point Online
 - Entry Point Daily Minimum
 - Heterotrophic Plate Count
 - Monthly Summary
- Distribution Turbidity Reports
 - Distribution Turbidity Report
 - Source Water > 1.49 NTU Table
- Color Entry Point Report

Monthly Water Quality Report – April 2022

- Fluoride Reports
 - Fluoride Entry Point Report
 - Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

FAD REQUIREMENTS

1. Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):

Requirements met. The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from November 1, 2021 to April 30, 2022. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 0.00% for the Catskill/Delaware System for this time period.

2. Raw Water Turbidity (Section 141.71(a)(2)):

Requirements met. The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest reported turbidity value was 1.7 NTU on the Catskill/Delaware System for the month.

3. Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):

Requirements met. As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual values for Catskill/Delaware System entry points from site 1S03 (Tunnel 1) was 0.43 mg/L, 1S03A (Tunnel 2) was 0.44 mg/L, and 1S03B (Tunnel 3) was 0.52 mg/L.

The Croton Filtration Plant was online from April 1 to 6, 2022, continuously feeding the Croton Low Service and intermittently pumped to High Service. The minimum daily free chlorine residual value for Croton entry points from site 1SCL1 (Low Service) was 0.43 mg/L and from 1SCH3 (High Service) was 0.41 mg/L.

4. Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):

Requirements met. All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.01 mg/L, except for two samples that equaled 0.00 mg/L.

A total of 1253 distribution samples were tested for free chlorine residual during the month. For all monthly distribution sites free chlorine residual ranged from 0.00 to 0.80 mg/L and averaged 0.37 mg/L.

Monthly Water Quality Report – April 2022

5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):

The results for the first quarter of 2022 were included in the report dated March 9, 2022 (For the February 2022 reporting period).

6. Total Coliform Monitoring (Section 141.71(b)(5)):

Requirements met. The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 807 compliance samples were tested for total coliform during this period. HPC were all ≤ 500 CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC > 500 CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, no samples tested positive for total coliform and all samples were negative for *E. coli*.

OTHER WATER QUALITY MONITORING

7. Microbiological Monitoring:

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity > 1.49 NTU, resulted in all the samples being negative for total coliform and *E. coli*.

The analyses of 446 distribution Operational samples resulted in no samples testing positive for total coliform or *E. coli*.

The analyses of 240 Pre-Finished samples resulted in sixteen (16) samples testing positive for total coliform. No *E. coli* were detected.

The analyses of 354 Autosampler Pre-finished samples resulted in forty-seven (47) samples testing positive for total coliform. No *E. coli* were detected.

8. Distribution Turbidity Monitoring:

For distribution sites, turbidity ranged from 0.12 to 2.21 NTU and averaged 0.99 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

9. Color Monitoring:

The MCL of 15 units for color was met for the month. Daily analyses of entry point samples (150 samples in total) produced monthly average color values of 7 units for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), 1S03B (Tunnel 3), 1SCH3 (Croton High Service), and 6 units for site 1SCL1 (Croton Low Service).

10. Volatile Organic/TTHM/HAA5 Monitoring:

Monthly Results: Twenty-one (21) distribution and four (4) entry point samples were collected for volatile organic contaminant (VOC) analysis. All VOC samples from distribution sites and entry points were below detection. Twenty-one (21) TTHM distribution samples were collected and ranged from 16 $\mu\text{g/L}$ to 32 $\mu\text{g/L}$. Four (4) TTHM entry point samples were collected and ranged from 14 $\mu\text{g/L}$ to 30 $\mu\text{g/L}$. Twenty-one (21) HAA5 distribution samples were collected and ranged from 17 $\mu\text{g/L}$ to 40 $\mu\text{g/L}$. Four (4) HAA5 entry point samples were collected and ranged from 12 $\mu\text{g/L}$ to 37 $\mu\text{g/L}$.

Monthly Water Quality Report – April 2022

11. Semivolatile and Other Organic Chemicals/parameters:

EPA Method 525.3 monitoring for 112 compounds of specified and unspecified organic parameters was conducted on April 18, 2022, at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3), which represented distribution Catskill/Delaware water, and six (6) distribution points. All results were below detection.

Monitoring for Method 505 organohalide pesticides was conducted on April 11, 2022, at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), and at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3), which represented distribution Catskill/Delaware water. All results were below detection.

Quarterly monitoring for the two compounds 1,2-Dibromo-3-chloropropane and 1,2-Dibromoethane by EPA Method 524.3 SIM, determination of micro extractables, was conducted at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the Croton Low Service and High Service entry points (1SCL1 and 1SCH3) which represented distribution Catskill/Delaware water, and one (1) distribution sampling site (50250) on April 14, 2022. All results were below detection.

12. Fluoride Monitoring:

Daily analyses of entry point samples (150 samples in total) produced monthly average fluoride levels of 0.69 mg/L for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), 1S03B (Tunnel 3), 1SCL1 (Croton Low Service), and 1SCH3 (Croton High Service). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

Please feel free to contact me at (718) 595-5367 or sfreud@dep.nyc.gov if you would like to discuss any of this information in greater detail.

Sincerely,



Salome Freud
First Deputy Director of Water Quality & Innovation

Enclosure

cc:

by email

Mr. Patrick Foster, NYSDEC – Region 2
Ms. Juve Hippolyte, Inspector General for NYCDEP
Mr. Kenneth Kosinski, NYSDEC
Mr. David Kvinge, Westchester County Water Agency
Mr. Huan Li, NYCDOHMH
Ms. Millie Magraw, Westchester County Water Agency
Mr. Trevor McProud, NYCDOHMH
Mr. Andy Tse, NYSDOH

TABLE OF CONTENTS FOR DATA FILES

April 2022 Monthly Water Quality Report

Microbiological Reports:

Summary of Coliform Compliance Samples
Coliform Positive Compliance Samples
Coliform Resample for Positive Compliance Samples
Summary of Coliform Operational Samples

(NYC_Micro_Summary_Compliance_202204.xls)
(NYC_Micro_Compliance_Positives_202204.xls)
(NYC_Micro_Compliance_Resamples_202204.xls)
(NYC_Micro_Operational_202204.pdf)

Coliform Positive Operational Samples

(NYC_Micro_Summary_Operational_202204.xls)

Coliform Resample for Positive Distribution Operational Samples

(NYC_Micro_Operational_202204.pdf)

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU
All Microbiological Results

(NYC_Micro_Operational_Resamples_202204.xls)
(NYC_EP_Coliform_For_Source_Turb_GT_149_202204.wd)
(NYC_Monthly_Alldata_202204.xls\micro)

Free Chlorine Residual (FCR) Reports:

Entry Point FCR On-Line Monitoring Results

(Entry_Shaft_Ci2_Online_202204_Fig.pdf)

Daily Minimum FCR at Entry Points

(Croton_Shaft_Ci2_Online_202204_Fig.pdf)

FCR and Heterotrophic Plate Count (HPC) Compliance Samples
FCR and HPC of Operational Samples

(Entry_Shaft_Ci2_Online_202204_Tbl.pdf)
(Croton_Shaft_Ci2_Online_202204_Tbl.pdf)
(NYC_Micro_Summary_FCR_&_HPC_Compliance_202204.xls)
(NYC_Micro_Summary_FCR_&_HPC_Operational_202204.xls)

Summary of FCR of Distribution Samples (Monthly)
FCR of all Distribution Sites

(NYC_Micro_Operational_202204.pdf)
(NYC_FCR_Monthly_Summary_202204.xls)
(NYC_FCR_Monthly_Alldata_202204.xls)

Turbidity Reports:

Summary of Turbidity of Distribution Samples
Turbidity of all Distribution Sites

(NYC_Turbidity_Monthly_Summary_202204.xls)
(NYC_Turbidity_Monthly_Alldata_202204.xls)

Color Reports:

Color for Entry Point Samples

(Entry_Point_Color_Monthly_202204.xls)

Fluoridation Reports:

Summary of Fluoride Levels of Distribution Samples
Fluoride Daily Entry Point Report for Surface Water Systems
Fluoride of all Distribution Sites

(NYC_Fluoride_Monthly_Summary_202204.xls)
(Entry_Point_Fluoride_Monthly_202204.xls)
(NYC_Fluoride_Monthly_Alldata_202204.xls)

Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP) Reports:

Total Trihalomethanes (TTHM) & VOC Monthly Report
Semivolatiles of EPA Method 525 Monthly Report
Organohalide Pesticides EPA Method 505 Quarterly Report
Microextractables of EPA Method 524.3/SIM Report
Haloacetic Acids (HAA5) Monthly Report
Summary of EPA Organic Method Reports

(NYC_TTHM_&_VOC_Rpt_202204.xls)
(NYC_SOC_Rpt_202204.xls)
(NYC_505_Quarterly_Rpt_2022Q2.xls)
(NYC_524_3-SIM_Rpt_202204.xls)
(NYC_HAA5_Monthly_Rpt_202204.xls)
(NYC_VOC_HAA5_525_505_Rpt_202204.pdf)

Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:

All parameters for April 2022

(NYC_Monthly_Alldata_202204.xls)

RAW WATER FECAL COLIFORM CONCENTRATIONS
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Catskill/Delaware System Raw Water Fecal Coliform Compliance Report

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water Period: 05/20 To: 04/22

Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
5-20	31	0	0.00	0.00
6-20	30	0	0.00	0.00
7-20	31	0	0.00	0.00
8-20	31	1	3.23	0.54
9-20	30	1	3.33	1.09
10-20	31	0	0.00	1.09
11-20	30	0	0.00	1.09
12-20	31	0	0.00	1.09
1-21	31	0	0.00	1.09
2-21	28	0	0.00	0.55
3-21	31	0	0.00	0.00
4-21	30	0	0.00	0.00
5-21	31	0	0.00	0.00
6-21	30	0	0.00	0.00
7-21	31	0	0.00	0.00
8-21	31	0	0.00	0.00
9-21	30	4	13.33	2.19
10-21	31	2	6.45	3.26
11-21	30	0	0.00	3.26
12-21	31	0	0.00	3.26
1-22	31	0	0.00	3.26
2-22	28	0	0.00	3.31
3-22	31	0	0.00	1.10
4-22	30	0	0.00	0.00

1. Does the percent of fecal coliform samples with >20 colonies per 100mL over the previous 6 months exceed 10%? Yes No

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

5/4/2022

D.W. Robins

5/4/22

All results that fall within the scope of the NELAP program meet that program's requirements unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 05/04/2022 2:58 pm

RAW WATER TURBIDITY
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water Period: April, 2022

Date	Turbidity (NTU)						Total Coliform (Colonies per 100 mL)	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM		
4/1/22	0.80	0.80	1.0	0.76	0.91	1.0	<2	<1
4/2/22	0.86	0.76	0.82	1.1	0.86	0.76	E2	E1
4/3/22	0.85	0.74	0.74	0.72	0.76	0.72	E2	<1
4/4/22	0.81	0.91	0.76	0.78	0.82	0.69	E6	<1
4/5/22	0.71	0.75	0.80	0.77	0.75	0.73	E2	<1
4/6/22	0.73	0.72	0.77	0.75	0.74	0.82	E8	<1
4/7/22	0.85	0.92	0.99	1.0	1.2	1.2	E6	<1
4/8/22	1.4	1.2	1.1	0.84	0.79	0.79	E12	E1
4/9/22	0.70	0.79	1.0	0.77	0.80	0.84	E8	E3
4/10/22	0.90	0.90	0.95	0.83	0.84	0.83	E16	E2
4/11/22	0.81	0.79	0.82	0.80	0.87	0.85	E20	<1
4/12/22	0.82	0.80	0.82	0.70	0.75	0.71	E8	E1
4/13/22	0.85	0.79	1.0	0.86	1.0	0.89	E6	E1
4/14/22	1.1	1.1	1.0	1.2	1.1	1.3	E2	<1
4/15/22	1.4	1.4	1.4	1.3	1.4	1.2	E10	E1
4/16/22	1.2	1.4	1.3	1.3	1.2	1.3	E6	<1
4/17/22	1.3	1.2	1.3	1.2	1.1	1.2	E14	<1
4/18/22	1.3	1.3	1.2	1.3	1.3	1.3	E8	E3
4/19/22	1.7	1.7	1.5	1.0	0.99	1.1	E6	E1
4/20/22	1.1	1.2	1.1	1.0	0.94	0.98	E14	E4
4/21/22	1.0	1.1	1.2	1.1	1.1	1.1	E12	<1
4/22/22	1.1	1.2	1.1	1.2	1.1	1.1	E12	<1
4/23/22	1.3	1.4	1.1	1.1	1.1	1.2	E10	E1
4/24/22	1.0	1.1	1.1	1.5	1.0	0.99	E20	E5
4/25/22	1.2	1.5	1.2	1.0	1.0	1.1	E14	<1
4/26/22	1.2	1.1	1.1	0.95	0.97	1.0	<2	<1
4/27/22	1.0	1.0	1.0	1.0	1.0	1.0	E4	<1
4/28/22	0.98	1.2	1.1	1.4	1.3	1.3	E2	<1
4/29/22	1.2	1.0	1.0	1.1	1.0	1.1	E4	<1
4/30/22	1.0	1.1	1.0	1.0	1.0	1.1	E2	E1

: Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error, E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with dilution based value

1. Does a raw water turbidity M & R violation exist? Yes No
2. Does the turbidity reading exceed 5 NTU at any time? Yes No
If yes, check for MCL violation, and notify state by the end of the next business day.
3. Minimum number of microbiological samples required per week: 5
4. A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

5/4/2022

D. W. Robinson

5/4/22

All results that fall within the scope of the NELAP program meet that program's requirements unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 05/04/2022 2:57 pm



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Data Qualifiers and Additional Notes	Period: April 2022
---	---------------------------

Date/Time	Site	Analytes Affected	Qualifier
4/3/22 11:56	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed the following day.
4/3/22 15:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed the following day.
4/3/22 19:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed the following day.
4/3/22 23:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed the following day.
4/4/22 03:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed the following day.
4/4/22 07:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed the following day.
4/20/22 11:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed.
4/20/22 15:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed.
4/20/22 19:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed.
4/20/22 23:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed.
4/21/22 03:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed.
4/21/22 07:55	DEL18DT	Turbidity	Analytical procedure error. Samples reanalyzed.


Analytical Methods

- Coliform, Fecal - SM 9222D (2015)
- Coliform, Total - SM 9222B (2015)
- Turbidity - Mitchell Method M5271 (Rev. 1.1)


ENTRY POINT CHLORINE RESIDUAL
(FAD Requirement)

New York City Department of Environmental Protection
 Bureau of Water Supply
City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results


Chlorine Levels at City Tunnel No.1 Entry Point, April 2022

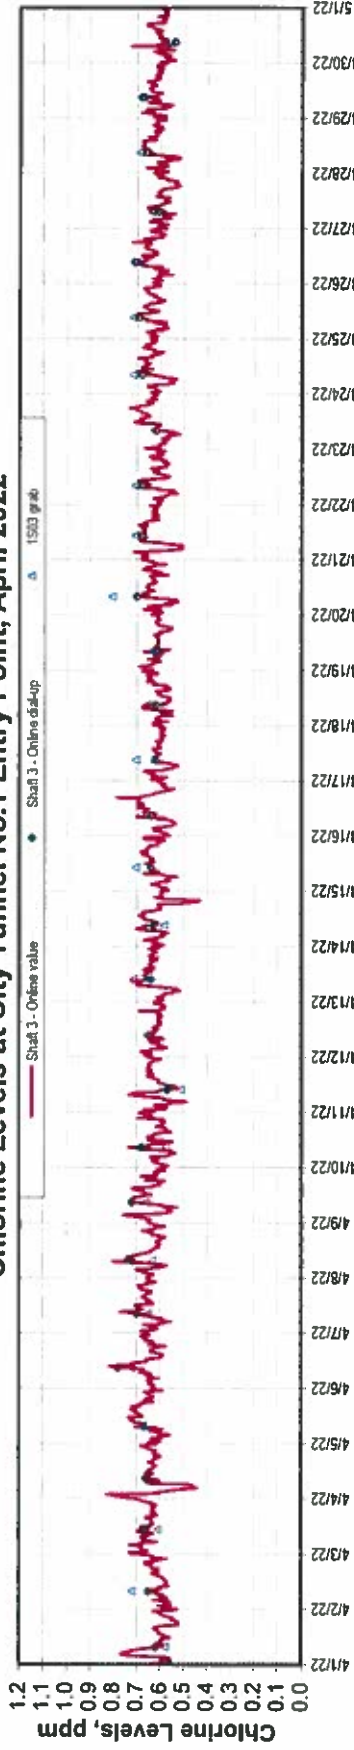

Chlorine Levels at City Tunnel No.2 Entry Point, April 2022

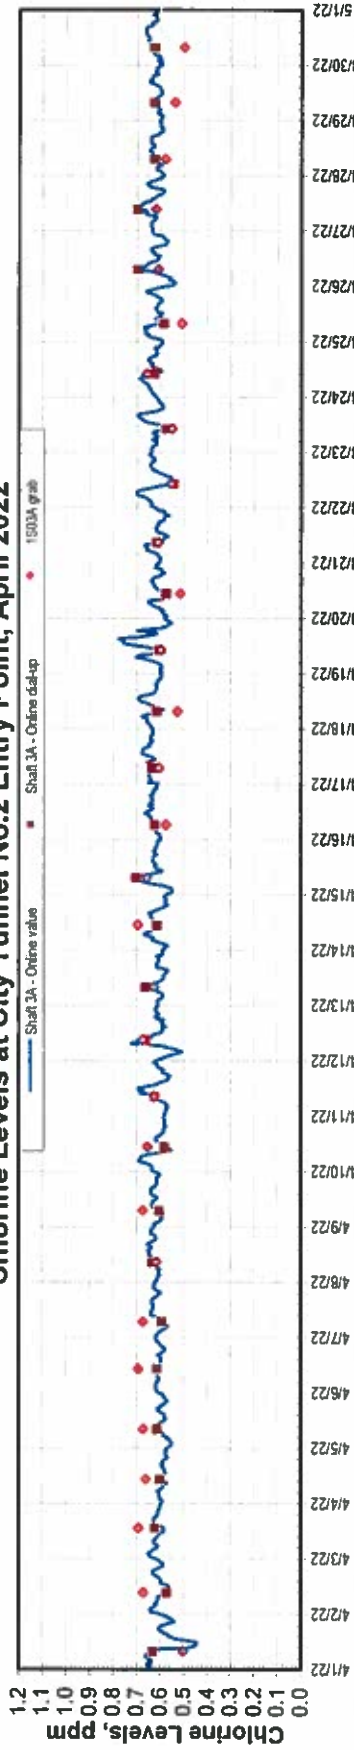

Chlorine Levels at City Tunnel No.3 Entry Point, April 2022

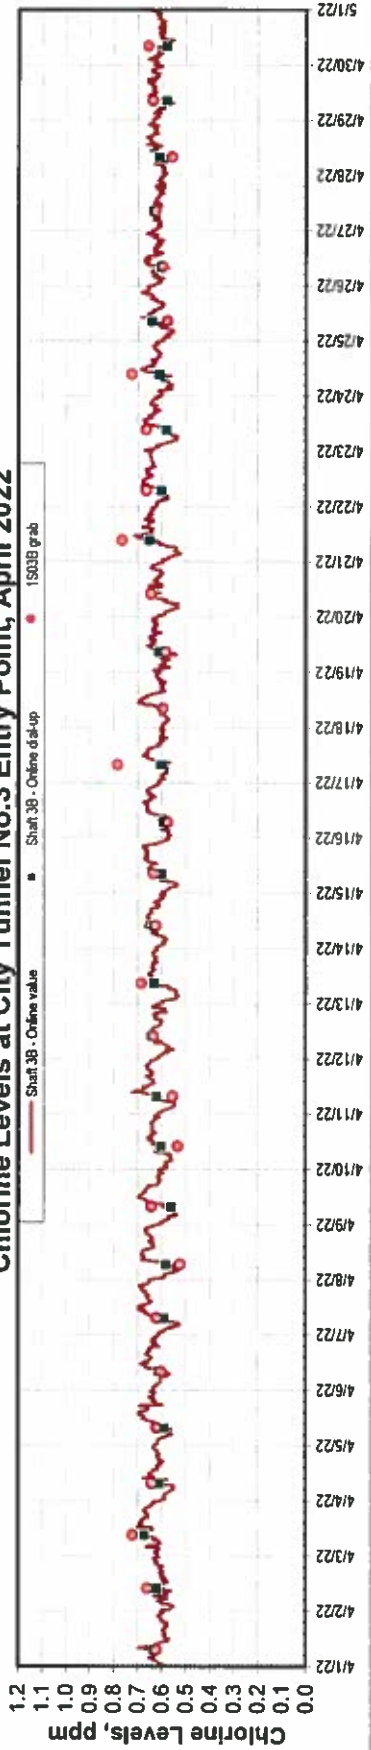

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 1/17/21, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System


Tunnel No.1 (Catskill) at Shaft 3			Tunnel No.2 (Delaware) at Shaft 3A			Tunnel No.3 (Cat/Del) at Shaft 3B		
Date	MinCl_1DL	Remark 1	Date	MinCl_2DL	Remark 2	Date	MinCl_3DL	Remark 3
04/01/22	0.51		04/01/22	0.44		04/01/22	0.57	
04/02/22	0.54		04/02/22	0.55		04/02/22	0.55	
04/03/22	0.61		04/03/22	0.58		04/03/22	0.60	
04/04/22	0.44		04/04/22	0.57		04/04/22	0.54	
04/05/22	0.55		04/05/22	0.55		04/05/22	0.55	
04/06/22	0.58		04/06/22	0.58		04/06/22	0.56	
04/07/22	0.55		04/07/22	0.57		04/07/22	0.52	
04/08/22	0.56		04/08/22	0.59		04/08/22	0.52	
04/09/22	0.52		04/09/22	0.58		04/09/22	0.53	
04/10/22	0.53		04/10/22	0.55		04/10/22	0.55	
04/11/22	0.48		04/11/22	0.55		04/11/22	0.54	
04/12/22	0.56		04/12/22	0.50		04/12/22	0.54	
04/13/22	0.51		04/13/22	0.56		04/13/22	0.52	
04/14/22	0.43		04/14/22	0.57		04/14/22	0.57	
04/15/22	0.52		04/15/22	0.54		04/15/22	0.53	
04/16/22	0.53		04/16/22	0.59		04/16/22	0.56	
04/17/22	0.52		04/17/22	0.60		04/17/22	0.56	
04/18/22	0.54		04/18/22	0.58		04/18/22	0.57	
04/19/22	0.54		04/19/22	0.54		04/19/22	0.54	
04/20/22	0.52		04/20/22	0.56		04/20/22	0.53	
04/21/22	0.49		04/21/22	0.55		04/21/22	0.52	
04/22/22	0.52		04/22/22	0.52		04/22/22	0.57	
04/23/22	0.50		04/23/22	0.56		04/23/22	0.53	
04/24/22	0.52		04/24/22	0.58		04/24/22	0.55	
04/25/22	0.56		04/25/22	0.56		04/25/22	0.54	
04/26/22	0.54		04/26/22	0.53		04/26/22	0.56	
04/27/22	0.51		04/27/22	0.57		04/27/22	0.58	
04/28/22	0.51		04/28/22	0.57		04/28/22	0.57	
04/29/22	0.53		04/29/22	0.58		04/29/22	0.54	
04/30/22	0.51		04/30/22	0.58		04/30/22	0.55	

Legend: MinCl_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

MinCl_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

MinCl_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

New York City Department of Environmental Protection
Bureau of Water Supply
Croton Distribution Entry Point Residual Chlorine Continuous Monitoring Results

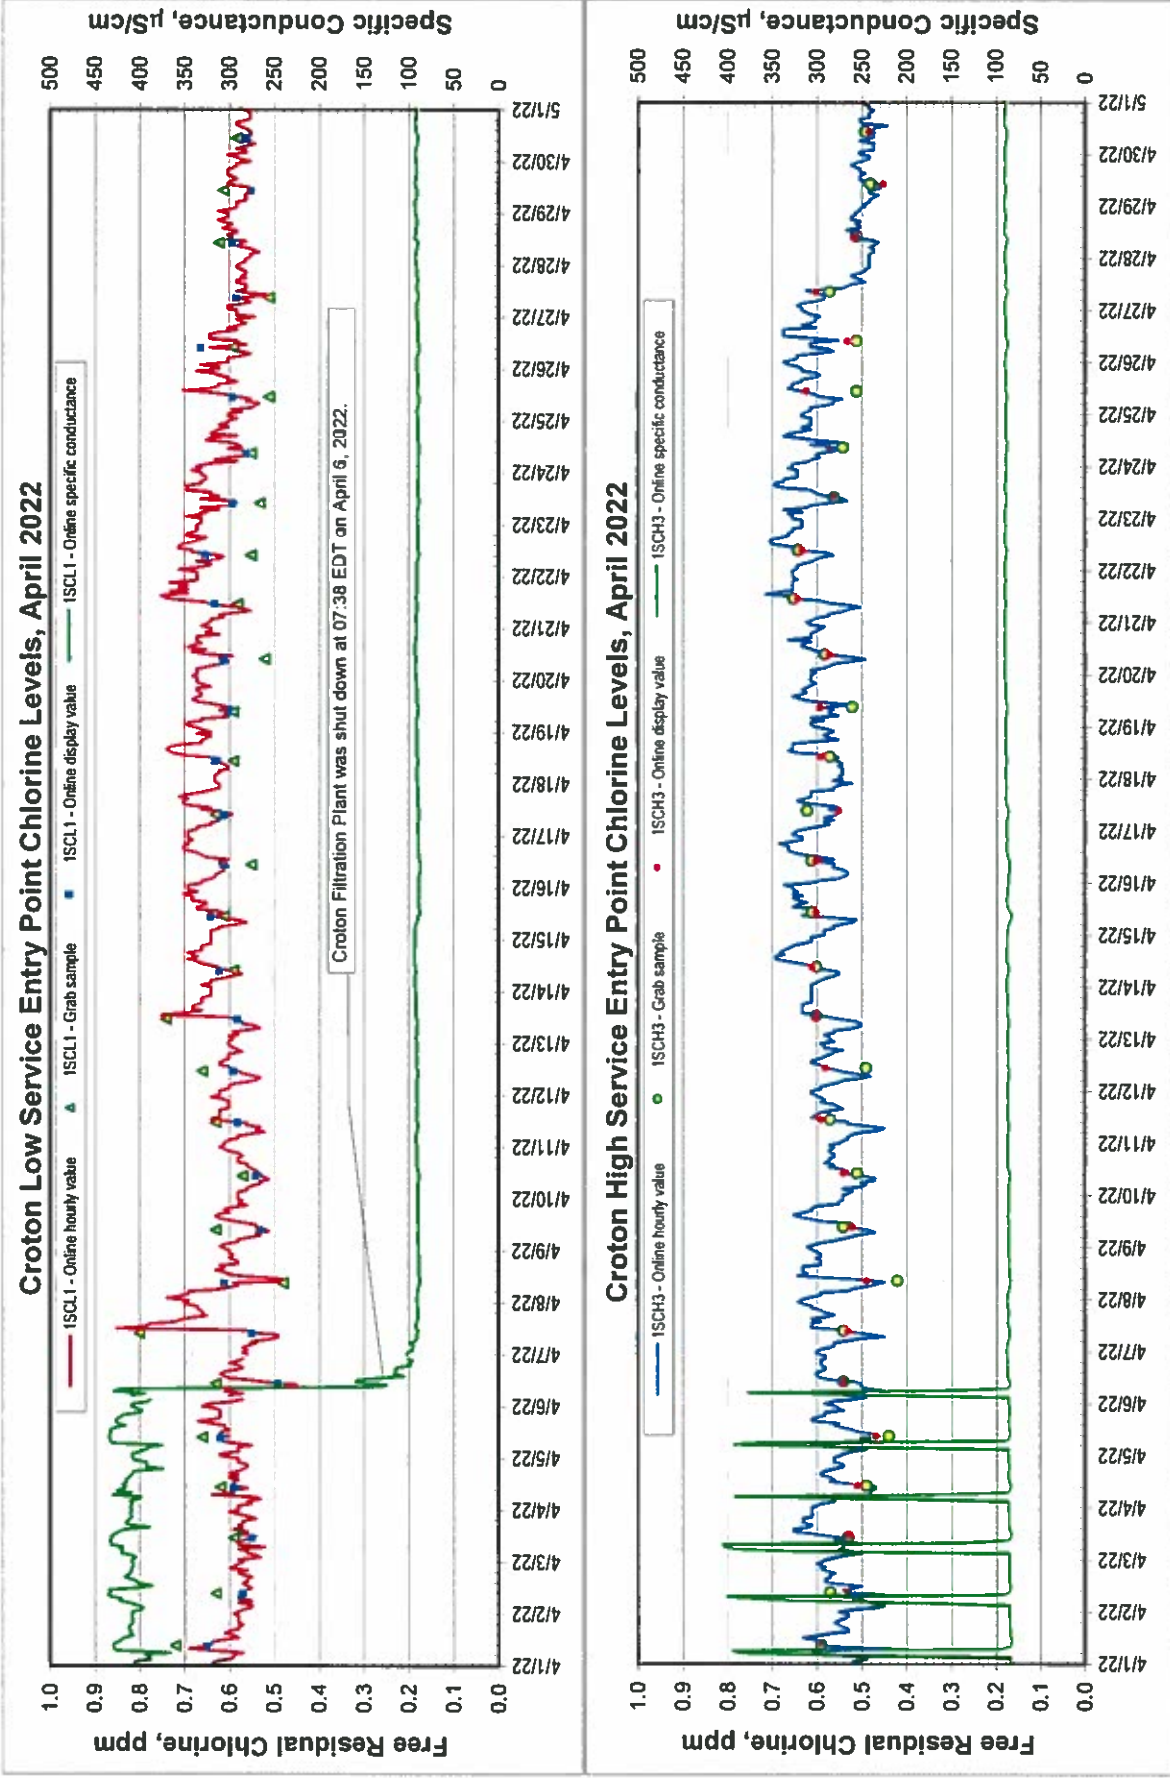

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points

Low Service			High Service		
Date	MinCl_1SCL1	Remark 1	Date	MinCl_1SCH3	Remark 2
04/01/22	0.55		04/01/22	0.45	
04/02/22	0.53		04/02/22	0.41	
04/03/22	0.51		04/03/22	0.43	
04/04/22	0.52		04/04/22	0.48	
04/05/22	0.52		04/05/22	0.44	
04/06/22	0.43	Croton Filtration Plant was shut down at 07:38 EDT on April 6, 2022.	04/06/22	0.43	Croton Filtration Plant was shut down at 07:38 EDT on April 6, 2022.
04/07/22			04/07/22		
04/08/22			04/08/22		
04/09/22			04/09/22		
04/10/22			04/10/22		
04/11/22			04/11/22		
04/12/22			04/12/22		
04/13/22			04/13/22		
04/14/22			04/14/22		
04/15/22			04/15/22		
04/16/22			04/16/22		
04/17/22			04/17/22		
04/18/22		No Croton water	04/18/22		No Croton water
04/19/22			04/19/22		
04/20/22			04/20/22		
04/21/22			04/21/22		
04/22/22			04/22/22		
04/23/22			04/23/22		
04/24/22			04/24/22		
04/25/22			04/25/22		
04/26/22			04/26/22		
04/27/22			04/27/22		
04/28/22			04/28/22		
04/29/22			04/29/22		
04/30/22			04/30/22		

Legend: MinCl_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.
MinCl_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.
Note: Croton water fed to High Service time period was determined by specific conductance greater than 150 µS/cm.

DISTRIBUTION SYSTEM DISINFECTION RESIDUAL
(FAD Requirement)

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

Residual Chlorine (mg/L) Distribution Samples

April 2022

All Distribution Sites			
Samples	Min	Max	Average
1253	0.00	0.80	0.37

Analytical Method SM 4500-Cl⁻ G (analyte is not ELAP certified)

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	RESIDUAL CHLORINE	COMMENT
10696	4/7/2022	1SCL1	Reg Stop	0.80	Max
12058	4/20/2022	1S03	Sub	0.80	Max
12459	4/25/2022	56200	Reg Stop	0.00	Min
12949	4/30/2022	51250	Reg Stop	0.00	Min

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

TOTAL COLIFORM MONITORING
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Summary of Results for Microbiological Quality
 Compliance Samples

4/1/2022 to 4/30/2022

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	133	133	0	0	0.0%
Brooklyn	70	199	199	0	0	0.0%
Manhattan	57	164	164	0	0	0.0%
Queens ***	79	229	229	0	0	0.0%
Staten Island	29	82	82	0	0	0.0%
Ground Water Supply ***	-	-	-	-	-	-
Total	281	807	807	0	0	0.0%

* As determined by Colilert Quanti-Tray-18 Method (SM 9223 B).

** If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.

*** There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: *[Signature]* Date: 05/12/22

Director: *[Signature]* Date: 5/6/2022

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality
 Free Chlorine Residual and Heterotrophic Plate Count
 Compliance Samples

4/1/2022 to 4/30/2022

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 CFU/mL ***	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 CFU/mL ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	133	133	96	6	0	--	0	0.0%
Brooklyn	70	199	199	148	25	0	--	0	0.0%
Manhattan	57	164	164	123	20	0	--	0	0.0%
Queens †	79	229	229	182	80	0	--	0	0.0%
Staten Island	29	82	82	76	50	1	<1	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	--	-	-
Total	281	807	807	625	181	1	<1	0	0.0%

* Free chlorine residual is determined by Method SM 4500-Cl₂ G (analyte is not ELAP certified).
 ** Heterotrophic plate count is determined by Method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result ≤ 500 CFU/mL is equivalent to a measurable FCR.
 *** No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.

† There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupe Agard Date: 05/03/22

Director: [Signature] Date: 5/16/2022

MICROBIOLOGICAL MONITORING

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Coliform Monitoring Results at Sample Sites near the First Service Connection
When Source Water Turbidity Exceeds 1.49 NTU

April 2022

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform) (MPN /100 mL) *	E.coli (MPN /100 mL) *
4/18/2022	DEL 18	4/19/2022	12250	<1	<1
4/19/2022	DEL 18	4/20/2022	16450	<1	<1
4/24/2022	DEL 18	4/25/2022	11550	<1	<1
4/25/2022	DEL 18	4/26/2022	13050	<1	<1

* As determined by Collert Quanti-Tray-18 Method (SM 9223B).

DISTRIBUTION TURBIDITY MONITORING

REPORT

**NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)**

Turbidity (NTU) Distribution Samples

April 2022

All Distribution Sites			
Samples	Min	Max	Average
1253	0.12	2.21	0.99

Analytical Method HM 10258

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	TURBIDITY	COMMENT
10084	4/1/2022	36350	Reg Stop	0.12	Min
11945	4/19/2022	42850	Reg Stop	2.21	Max

The monthly average of all distribution samples is not to exceed 5 NTU.

COLOR MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION
 BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points

April 2022

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
Catskill/Delaware 1S03 (Tunnel 1)	7	6	6	7	7	7	6	6	7	7	6	7	7	6	7	7	7	6	6	6	8	5	6	6	7	6	7	6	7	6
Catskill/Delaware 1S03A (Tunnel 2)	7	7	7	6	7	6	7	7	7	7	6	6	7	6	6	7	8	7	6	7	8	6	7	7	7	6	7	6	7	7
Catskill/Delaware 1S03B (Tunnel 3)	6	7	7	6	7	6	7	6	6	7	6	7	7	7	6	7	8	7	7	7	7	6	6	6	6	6	7	6	7	7
Croton System 1SCL1 (a)	4	3	4	4	4	6	7	6	6	7	6	6	6	6	7	7	9	7	7	7	7	6	6	7	7	6	7	6	7	6
Croton System 1SCH3 (b)	6	6	7	6	7	6	7	7	7	7	6	6	6	7	6	7	7	7	7	7	8	7	6	6	7	7	6	7	6	7

Analytical Method SM 2120 B. Apparent color.
 The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.
 (a) Croton System online as of 10/27/2020 at 1SCL1.
 (b) Croton System online as of 9/10/2021 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	30	5	8	7
Catskill/Delaware 1S03A (Tunnel 2)	30	6	8	7
Catskill/Delaware 1S03B (Tunnel 3)	30	6	8	7
Croton System 1SCL1 (a)	30	3	9	6
Croton System 1SCH3 (b)	30	6	8	7

Supervisor  Date 05/04/22
 Asst. Lab Director  Director Date 5/9/2022

FLUORIDE MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points
April 2022

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
Catskill/Delaware 1S03 (Tunnel 1)	0.71	0.66	0.67	0.68	0.69	0.70	0.69	0.69	0.72	0.69	0.67	0.69	0.70	0.69	0.70	0.69	0.68	0.68	0.68	0.67	0.68	0.69	0.71	0.70	0.70	0.69	0.71	0.69	0.69	0.71
Catskill/Delaware 1S03A (Tunnel 2)	0.71	0.64	0.68	0.70	0.70	0.71	0.71	0.70	0.68	0.66	0.70	0.70	0.71	0.70	0.69	0.69	0.67	0.68	0.68	0.69	0.68	0.71	0.72	0.70	0.70	0.71	0.70	0.70	0.69	0.70
Catskill/Delaware 1S03B (Tunnel 3)	0.71	0.67	0.68	0.69	0.70	0.70	0.71	0.70	0.67	0.67	0.70	0.71	0.72	0.69	0.70	0.66	0.66	0.69	0.68	0.67	0.68	0.71	0.71	0.70	0.70	0.71	0.71	0.70	0.69	0.70
Croton System 1SCL1 (a)	0.68	0.68	0.68	0.67	0.68	0.71	0.71	0.70	0.70	0.65	0.71	0.71	0.71	0.70	0.69	0.70	0.67	0.68	0.69	0.68	0.67	0.71	0.72	0.70	0.70	0.71	0.71	0.69	0.69	0.71
Croton System 1SCH3 (b)	0.71	0.68	0.65	0.69	0.71	0.70	0.72	0.70	0.69	0.65	0.68	0.70	0.71	0.70	0.70	0.67	0.67	0.68	0.68	0.68	0.68	0.71	0.72	0.69	0.70	0.72	0.70	0.69	0.69	0.70

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System online as of 10/27/2020 at 1SCL1.

(b) Croton System online as of 9/10/2021 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	30	0.66	0.72	0.69
Catskill/Delaware 1S03A (Tunnel 2)	30	0.64	0.72	0.69
Catskill/Delaware 1S03B (Tunnel 3)	30	0.66	0.72	0.69
Croton System 1SCL1 (a)	30	0.65	0.72	0.69
Croton System 1SCH3 (b)	30	0.65	0.72	0.69

Supervisor  Date 05/04/2022
 Asst. Lab Director  Director Date 5/9/2022