



*Vincent Sapienza, P.E.
Commissioner*

Paul V. Rush, P.E.
Deputy Commissioner
Bureau of Water Supply
prush@dep.nyc.gov

59-17 Junction Boulevard
Flushing, NY 11373
T: (845) 340-7800
F: (845) 334-7175

March 10, 2021

Li Huang, P.E.
New York City Department of Health and Mental Hygiene
Environmental Sciences & Engineering
42-09 28th Street, 14th Floor CN# 56
Long Island City, NY 11101

Patrick Palmer
New York State Department of Health
Bureau of Water Supply Protection, NYC Watershed Section
Empire State Plaza, Corning Tower, Room 1198
Albany, NY 12237

Katie Lynch
United States Environmental Protection Agency
Clean Water Division - New York City Water Supply Protection Program
290 Broadway, 24th Floor
New York, New York 10007-1866

RE: Monthly Water Quality Report for February 2021

Dear Ms. Huang, Mr. Palmer and Ms. Lynch:

Enclosed, please find the New York City Water Quality report for the month of **February 2021**. There was no well pumpage to distribution in the Groundwater System this month. Croton water was feeding into distribution for the month of February. In addition to the following list of compliance reports, electronic files containing compliance and non-compliance data for this month are being emailed to you.

- Raw Water Fecal Coliform Report
- Raw Water Turbidity Report
- Distribution Microbiological Compliance Reports
 - Summary
 - Positive Samples
 - Resamples
- Chlorine Residual Reports
 - Entry Point Online
 - Entry Point Daily Minimum
 - Heterotrophic Plate Count
 - Monthly Summary
- Distribution Turbidity Reports
 - Distribution Turbidity Report
 - Source Water > 1.49 NTU Table
- Color Entry Point Report

Monthly Water Quality Report – February 2021

- Fluoride Reports
 - Fluoride Entry Point Report
 - Distribution Fluoride Report
- Quarterly Disinfection By-products Report

The reports are summarized as follows:

FAD REQUIREMENTS

1. Raw Water Fecal Coliform Concentrations (Section 141.71(a)(1)):

Requirements met. The Delaware Aqueduct effluent from Kensico Reservoir exhibited fecal coliform concentrations in water prior to disinfection at levels less than or equal to 20 CFU/100 mL in at least 90% of the samples collected in the six-month period from September 1, 2020 to February 28, 2021. The six month running percentage of samples collected with fecal coliform concentrations >20 CFU/100 mL was 0.55% for the Catskill/Delaware System for this time period.

2. Raw Water Turbidity (Section 141.71(a)(2)):

Requirements met. The raw water leaving Kensico Reservoir via the Delaware Aqueduct in compliance samples collected at DEL18DT, just prior to disinfection, exhibited turbidity levels less than or equal to 5 NTU on an ongoing basis during the month. The highest reported turbidity value was 0.95 NTU on the Catskill/Delaware System for the month.

3. Entry Point Chlorine Residual (Section 141.71(b)(1)(iii) and 141.72(a)(3)):

Requirements met. As required, continuous monitoring for free chlorine residual was maintained at the distribution entry points throughout the month and at no time did the concentration fall below 0.2 mg/L for more than four hours. The minimum daily free chlorine residual value for entry point readings for the Catskill/Delaware System from sites 1S03 (Tunnel 1) was 0.55 mg/L, 1S03A (Tunnel 2) was 0.66 mg/L, and 1S03B (Tunnel 3) was 0.57 mg/L.

The Croton Filtration Plant was online and continuously feeding the Croton Low Service for the month of February. The Croton High Service entry point was online until February 18, 2021 at 3:11 PM. When the High Service pump is off, distribution Tunnel 3 water intermittently was back feeding through the High Service tunnel to the Low Service entry point. The minimum daily free chlorine residual value for Croton entry point reading from site 1SCL1 (Low Service) was 0.56 mg/L and from site 1SCH3 (High Service) was 0.45 mg/L.

4. Distribution System Disinfection Residuals (Section 141.71(b)(1)(iv) and 141.72(a)(4)):

Requirements met. All free chlorine residuals measured at compliance sites within the distribution system during the month were greater than or equal to 0.15 mg/L.

A total of 1189 distribution samples were tested for free chlorine residual this month. For all monthly distribution sites free chlorine residual ranged from 0.15 to 1.00 mg/L, and averaged 0.60 mg/L.

5. Trihalomethane Monitoring / HAA5 Monitoring (Section 141.71(b)(6)):

Requirements met. The System's TTHM System-Wide Running Average (RAA) for the first quarter of 2021 was 39 µg/L, and the Locational Running Annual Averages (LRAA) ranged from 31 µg/L to 48 µg/L. These values meet the MCL of 80 µg/L for RAA and LRAA. TTHM quarterly results averaged 25 µg/L.

The System's HAA5 RAA for the first quarter of 2021 was 42 µg/L, and the LRAA ranged from 28 µg/L to 50 µg/L. These values meet the MCL of 60 µg/L for RAA and LRAA. HAA5 quarterly results averaged 39 µg/L.

6. Total Coliform Monitoring (Section 141.71(b)(5)):

Requirements met. The results of monthly coliform monitoring performed in the distribution system are enclosed. A total of 749 compliance samples were tested for total coliform during this period. HPC were all ≤500 CFU/mL, equivalent to a measurable free chlorine residual. Zero percent of the samples had an undetectable free chlorine residual or HPC >500 CFU/mL. This meets the requirements that a free chlorine residual be maintained at representative points in the distribution system, and that no more than 5% of the free chlorine residual samples be undetectable in any two months. During the month, two (2) samples tested positive for total coliform, and all samples were negative for *E. coli*.

- A sample collected on 2/23/2021 from Site 33950 (sample station, 104th Street, second sample station east of 3rd Ave, Manhattan) was positive for total coliform. Resampling on 2/25/2021 was coliform negative at all locations.
- A sample collected on 2/25/2021 from Site 33250 (sample station in front of 925 West End Ave, Manhattan) was positive for total coliform. Resampling on 2/27/2021 was coliform negative at all locations.

OTHER WATER QUALITY MONITORING

7. Microbiological Monitoring:

Coliform monitoring at distribution sites near first service connections, in response to source water having a turbidity >1.49 NTU, was not required this month, but all of these samples were negative for total coliform and *E. coli*.

The analyses of 440 distribution Operational samples resulted in no samples testing positive for total coliform and no *E. coli* were detected.

The analyses of 224 Pre-Finished samples resulted in no samples testing positive for total coliform and no *E. coli* were detected.

The analyses of 440 Autosampler Pre-finished samples resulted in one (1) sample testing positive for total coliform. No *E. coli* were detected.

8. Distribution Turbidity Monitoring:

For distribution sites, turbidity ranged from <0.10 to 3.84 NTU and averaged 0.66 NTU for the month. This meets the MCL of 5 NTU for the monthly average of all distribution samples.

9. Color Monitoring:

The MCL of 15 units for color was met for the month. Daily analyses of entry point samples (130 samples in total), produced monthly average color values of 6 units for site 1S03 (Tunnel 1), 7 units for sites 1S03A (Tunnel 2) and 1S03B (Tunnel 3), and 4 units for sites 1SCL1 (Croton Low Service) and 1SCH3 (Croton High Service).

10. Volatile Organic/TTHM/HAA5 Monitoring:

Monthly Results: Twenty-one (21) distribution and five (5) entry point samples were collected for volatile organic contaminant (VOC) analysis. All VOC samples from distribution sites and entry points were below detection. Twenty-one (21) TTHM distribution samples were collected ranging from 9.3 µg/L to 35 µg/L. Five (5) TTHM entry point samples were collected ranging from 4.3 µg/L to 24 µg/L. Twenty-one (21) HAA5 distribution samples were collected ranging from 11 µg/L to 50 µg/L. Five (5) HAA5 entry point samples were collected ranging from 9.4 µg/L to 44 µg/L.

11. Semivolatile and Other Organic Chemicals/parameters:

EPA Method 525.3 monitoring for 112 compounds of specified and unspecified organic parameters was conducted on February 8, 2021 at the three (3) Catskill/Delaware entry points (1S07, 1S03A, and 1S03B), at the Croton Low Service entry point (1SCL1) and Croton High Service entry point (1SCH3) which represented distribution Catskill/Delaware water, and six (6) distribution points. All semi-volatile organic contaminant samples were below detection limits.

12. Fluoride Monitoring:

Daily analyses of entry point samples (130 samples in total), produced monthly average fluoride levels of 0.71 mg/L for sites 1S03 (Tunnel 1), 1S03A (Tunnel 2), and 1S03B (Tunnel 3), 0.76 mg/L for site 1SCL1 (Croton Low Service), and 0.78 mg/L for site 1SCH3 (Croton High Service). The fluoride levels at the entry points did not exceed the MCL of 2.2 mg/L at any time during the month.

13. Other Monitoring:

Second quarter monitoring for perfluorooctane sulfonate (PFOS), perfluorooctanic acid (PFOA), and 1,4-Dioxane for the Catskill/Delaware System entry point sites 1S03 (Tunnel 1), 1S03A (Tunnel 2) and 1S03B (Tunnel 3), and the Croton entry point site 1SCL1 (Low Service) was conducted on February 4, 2021. All results were ND. Contract laboratory data reports are included as electronic files with this report.

Monitoring for Taste and Odor (T&O) compounds was conducted in February on 38 samples from New Croton Reservoir, Jerome Park Reservoir, and the Croton Filtration Plant. Results for 2,4,6-Trichloroanisole (TCA), 2-isopropyl-3-methoxy pyrazine (IPMP) and 2-isobutyl-3-methoxy pyrazine (IBMP) were ND, for Geosmin they ranged from ND to 3.5 ng/L, and for 2-Methylisoborneol (MIB) they ranged from 9.5 to 48 ng/L. Contract laboratory reports of available data are included as pdf files on the electronic files enclosed with this report.

Please feel free to contact me at (718) 595-5367 or sfreud@dep.nyc.gov if you would like to discuss any of this information in greater detail.

Monthly Water Quality Report – February 2021

Sincerely,



Salome Freud

Deputy Director of Water Quality and Innovation

Enclosure

cc:

by email

Mr. Andrew Brunsden, Inspector General for NYCDEP

Mr. Kenneth Kosinski, NYSDEC

Mr. David Kvinge, Westchester County Water Agency

Mr. Huan Li, NYCDOHMH

Ms. Millie Magraw, Westchester County Water Agency

Mr. Trevor McProud, NYCDOHMH

Mr. Andy Tse, NYSDOH

Mr. Steven Zahn, NYSDEC – Region 2

TABLE OF CONTENTS FOR DATA FILES

February 2021 Monthly Water Quality Report

Microbiological Reports:

Summary of Coliform Compliance Samples
Coliform Positive Compliance Samples
Coliform Resample for Positive Compliance Samples
Summary of Coliform Operational Samples

(NYC_Micro_Summary_Compliance_202102.xls)
(NYC_Micro_Compliance_Positives_202102.xls)
(NYC_Micro_Compliance_Resamples_202102.xls)
(NYC_Micro_Operational_202102.pdf)
(NYC_Micro_Summary_Operational_202102.xls)
(NYC_Micro_Operational_202102.pdf)
(NYC_Micro_Operational_Positives_202102.xls)
(NYC_Micro_Operational_202102.pdf)
(NYC_Micro_Operational_Resamples_202102.xls)
(NYC_EP_Coliform_For_Source_Turb_GT_149_202102.snp)
(NYC_Monthly_Alldata_202102.xls|Micro)

Coliform Positive Operational Samples

Coliform Resample for Positive Distribution Operational Samples

Distribution Coliform Monitoring when Source Water Turbidity exceeds 1.49 NTU
All Microbiological Results

Free Chlorine Residual (FCR) Reports:

Entry Point FCR On-Line Monitoring Results

Daily Minimum FCR at Entry Points

FCR and Heterotrophic Plate Count (HPC) Compliance Samples

FCR and HPC of Operational Samples

Summary of FCR of Distribution Samples (Monthly)

FCR of all Distribution Sites

(Entry_Shift_C12_Online_202102_Fig.pdf)
(Croton_Entry_Shift_C12_Online_202102_Fig.pdf)
(Entry_Shift_C12_Online_202102_Tbl.pdf)
(Croton_Entry_Shift_C12_Online_202102_Tbl.pdf)
(NYC_Micro_Summary_FCR_&_HPC_Compliance_202102.xls)
(NYC_Micro_Operational_202102.pdf)
(NYC_FCR_Monthly_Summary_202102.xls)
(NYC_FCR_Monthly_Alldata_202102.xls)

Turbidity Reports:

Summary of Turbidity of Distribution Samples
Turbidity of all Distribution Sites

(NYC_Turbidity_Monthly_Summary_202102.xls)
(NYC_Turbidity_Monthly_Alldata_202102.xls)

Color Reports:

Color for Entry Point Samples

(Entry_Point_Color_Monthly_202102.xls)

Fluoridation Reports:

Summary of Fluoride Levels of Distribution Samples
Fluoride Daily Entry Point Report for Surface Water Systems
Fluoride of all Distribution Sites

(NYC_Fluoride_Monthly_Summary_202102.xls)
(Entry_Point_Fluoride_Monthly_202102.xls)
(NYC_Fluoride_Monthly_Alldata_202102.xls)

Volatile Organic Contaminant (VOC) and Disinfection By-products (DBP)

Reports:

Total Trihalomethanes (TTHM) & VOC Monthly Report
Semivolatiles of EPA Method 525 Monthly Report
Summary of EPA DBP Quarterly Report
Halocetic Acids (HAA5) Monthly Report

(NYC_TTHM_&_VOC_Rpt_202102.xls)
(NYC_SOC_Rpt_202102.xls)
(NYC_DBP_Quarterly_Rpt_2021Q1.xls)
(NYC_HAA5_Monthly_Rpt_202102.xls)
(917227_T&O_Sample_20210202.pdf, 917612_T&O_Sample_20210208.pdf,
917616_T&O_Sample_20210208.pdf, 917630_T&O_Sample_20210202.pdf,
919239_T&O_Sample_20210216.pdf, 919242_T&O_Sample_20210216.pdf,
920117_T&O_Sample_20210222.pdf, 921144_T&O_Sample_20210222.pdf)
(917261_PFC_1,4Dioxane_Sample_20210204.pdf,
917272_PFC_1,4Dioxane_Sample_20210204.pdf,
917290_PFC_1,4Dioxane_Sample_20210204.pdf,
917265_PFC_1,4Dioxane_Sample_20210204.pdf)
(NYC_VOC_HAA5_525_Rpt_202102.pdf)

Taste & Odor Sampling Reports from EEA Lab

Perfluorodecanoic acid (PFC) & 1,4Dioxane Sampling Reports from EEA Lab

Summary of EPA Organic Method Reports

Inorganic (IOC), Specified Organic (SOC), Metals Monitoring:

All parameters for February 2021

(NYC_Monthly_Alldata_202102.xls)

RAW WATER FECAL COLIFORM CONCENTRATIONS
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Catskill/Delaware System Raw Water Fecal Coliform Compliance Report

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water Period: 12/18 To: 02/21

Date	Number of Fecal Coliform Samples Examined per Month	Number of Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL	Percent of Monthly Fecal Coliform Samples with >20 colonies per 100 mL for Previous Six Months
12-18	31	0	0.00	0.00
1-19	31	0	0.00	0.00
2-19	28	0	0.00	0.00
3-19	31	0	0.00	0.00
4-19	30	0	0.00	0.00
5-19	31	0	0.00	0.00
6-19	30	0	0.00	0.00
7-19	31	0	0.00	0.00
8-19	31	0	0.00	0.00
9-19	30	0	0.00	0.00
10-19	31	0	0.00	0.00
11-19	30	0	0.00	0.00
12-19	31	0	0.00	0.00
1-20	31	0	0.00	0.00
2-20	29	0	0.00	0.00
3-20	31	0	0.00	0.00
4-20	30	0	0.00	0.00
5-20	31	0	0.00	0.00
6-20	30	0	0.00	0.00
7-20	31	0	0.00	0.00
8-20	31	1	3.23	0.54
9-20	30	1	3.33	1.09
10-20	31	0	0.00	1.09
11-20	30	0	0.00	1.09
12-20	31	0	0.00	1.09
1-21	31	0	0.00	1.09
2-21	28	0	0.00	0.55

D.W. Robinson

3/4/21

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

3/4/2021

RAW WATER TURBIDITY
(FAD Requirement)



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Catskill/Delaware System

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Catskill/Delaware Public Water System at Shaft 18 (DEL18DT) - Raw Water

Period: February, 2021

Date	Turbidity (NTU)						Total Coliform	Fecal Coliform
	12 AM	4 AM	8 AM	12 PM	4 PM	8 PM	(Colonies per 100 mL)	
2/1/21	0.85	0.85	0.85	0.90	0.85	0.95	E8	E1
2/2/21	0.90	0.90	0.85	0.85	0.85	0.85	E22	E1
2/3/21	0.80	0.80	0.85	0.70	0.75	0.75	E4	E1
2/4/21	0.80	0.80	0.80	0.80	0.85	0.85	E24	E2
2/5/21	0.85	0.85	0.85	0.80	0.75	0.80	E4	E3
2/6/21	0.85	0.75	0.80	0.75	0.80	0.85	E2	E1
2/7/21	0.80	0.75	0.80	0.80	0.80	0.85	E2	E1
2/8/21	0.75	0.75	0.80	0.80	0.85	0.80	E10	E1
2/9/21	0.85	0.80	0.85	0.75	0.75	0.75	E24	E1
2/10/21	0.75	0.75	0.75	0.75	0.75	0.80	E22	E4
2/11/21	0.80	0.80	0.80	0.75	0.75	0.85	E8	E3
2/12/21	0.80	0.80	0.75	0.80	0.75	0.80	E4	E3
2/13/21	0.80	0.75	0.80	0.75	0.75	0.70	E12	E6
2/14/21	0.75	0.75	0.75	0.75	0.75	0.70	E10	E7
2/15/21	0.70	0.75	0.75	0.75	0.75	0.80	E2	E3
2/16/21	0.75	0.75	0.75	0.75	0.75	0.75	E18	E4
2/17/21	0.75	0.75	0.75	0.75	0.70	0.75	E10	E6
2/18/21	0.80	0.85	0.80	0.70	0.75	0.75	E8	E4
2/19/21	0.75	0.70	0.75	0.75	0.75	0.70	E4	E1
2/20/21	0.75	0.75	0.70	0.80	0.75	0.70	E4	E3
2/21/21	0.75	0.75	0.75	0.80	0.75	0.80	E10	E1
2/22/21	0.80	0.80	0.75	0.75	0.80	0.85	E8	E3
2/23/21	0.80	0.75	0.75	0.70	0.70	0.70	E2	E1
2/24/21	0.70	0.70	0.70	0.75	0.70	0.75	E2	<1
2/25/21	0.70	0.70	0.65	0.65	0.65	0.65	E5	E3
2/26/21	0.65	0.60	0.65	0.70	0.70	0.65	E4	E3
2/27/21	0.65	0.65	0.65	0.60	0.60	0.65	E2	<1
2/28/21	0.60	0.60	0.60	0.60	0.65	0.60	E4	E2

.: Aqueduct Shutdown, CONF: Confluent Growth (+ indicates positive coliform growth), LE: Lab Error, FE: Field Error,
E: estimated count based on non-ideal plate, >=: plate count may be biased low based on heavy growth, >: observed count replaced with
dilution based value

1. Does a raw water turbidity M & R violation exist? ☐ Yes ☒ No
2. Does the turbidity reading exceed 5 NTU at any time? ☐ Yes ☒ No
If yes, check for MCL violation, and notify state by the end of the next business day.
3. Minimum number of microbiological samples required per week: 5
4. A daily microbiological sample is required every day the raw water turbidity exceeds 1 NTU.

Additional Comments:

D.W. Robins

3/4/21

Reported by: David Robinson, Deputy Chief, Hawthorne Water Quality Operations

3/4/2021

All results that fall within the scope of the NELAP program meet that program's requirements unless stated in the qualifiers addendum printed at the end of this report.

Report Printed on 03/04/2021 12:11 pm
Page 2 of 3



NYCDEP Division of Watershed Water Quality Operations

Water Systems Operation Report - Qualifiers and Methods Addendum

Hawthorne Laboratory, ELAP Lab ID No. 10771
15 Skyline Drive, Hawthorne, NY 10532

Deputy Chief: David Robinson
914-345-4973

Data Qualifiers and Additional Notes

Period: February 2021

Date/Time	Site	Analytes Affected	Qualifier
-----------	------	-------------------	-----------

Analytical Methods

Coliform, Fecal	-	SM 9222D (2006)
Coliform, Total	-	SM 9222B (2006)
Turbidity	-	SM 2130B (01)

ENTRY POINT CHLORINE RESIDUAL
(FAD Requirement)

New York City Department of Environmental Protection
Bureau of Water Supply


Daily Minimum Chlorine Readings Recorded at Tunnel Entry Shafts for Catskill/Delaware System

Tunnel No.1 (Catskill) at Shaft 3			Tunnel No.2 (Delaware) at Shaft 3A			Tunnel No.3 (Cat/Del) at Shaft 3B		
Date	MinCl_1DL	Remark 1	Date	MinCl_2DL	Remark 2	Date	MinCl_3DL	Remark 3
02/01/21	0.65		02/01/21	0.76		02/01/21	0.68	
02/02/21	0.62		02/02/21	0.77		02/02/21	0.68	
02/03/21	0.63		02/03/21	0.76		02/03/21	0.68	
02/04/21	0.61		02/04/21	0.76		02/04/21	0.68	
02/05/21	0.62		02/05/21	0.77		02/05/21	0.65	
02/06/21	0.61		02/06/21	0.75		02/06/21	0.63	
02/07/21	0.63		02/07/21	0.75		02/07/21	0.65	
02/08/21	0.64		02/08/21	0.66		02/08/21	0.67	
02/09/21	0.62		02/09/21	0.79		02/09/21	0.65	
02/10/21	0.64		02/10/21	0.79		02/10/21	0.67	
02/11/21	0.61		02/11/21	0.77		02/11/21	0.66	
02/12/21	0.63		02/12/21	0.74		02/12/21	0.65	
02/13/21	0.63		02/13/21	0.80		02/13/21	0.64	
02/14/21	0.55		02/14/21	0.77		02/14/21	0.65	
02/15/21	0.64		02/15/21	0.69		02/15/21	0.64	
02/16/21	0.57		02/16/21	0.78		02/16/21	0.68	
02/17/21	0.66		02/17/21	0.76		02/17/21	0.66	
02/18/21	0.63		02/18/21	0.74		02/18/21	0.66	
02/19/21	0.63		02/19/21	0.75		02/19/21	0.71	
02/20/21	0.63		02/20/21	0.75		02/20/21	0.65	
02/21/21	0.65		02/21/21	0.75		02/21/21	0.66	
02/22/21	0.66		02/22/21	0.72		02/22/21	0.68	
02/23/21	0.64		02/23/21	0.76		02/23/21	0.70	
02/24/21	0.61		02/24/21	0.74		02/24/21	0.67	
02/25/21	0.63		02/25/21	0.76		02/25/21	0.64	
02/26/21	0.64		02/26/21	0.76		02/26/21	0.57	
02/27/21	0.64		02/27/21	0.74		02/27/21	0.66	
02/28/21	0.68		02/28/21	0.77		02/28/21	0.69	


Legend: MinCl_1DL: Shaft 3's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.
MinCl_2DL: Shaft 3A's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.
MinCl_3DL: Shaft 3B's minimum chlorine level measured at the shaft and recorded at the location via data logger, in ppm.

New York City Department of Environmental Protection
Bureau of Water Supply
City Tunnel Entry Point Residual Chlorine Continuous Monitoring Results


Chlorine Levels at City Tunnel No.1 Entry Point, February 2021

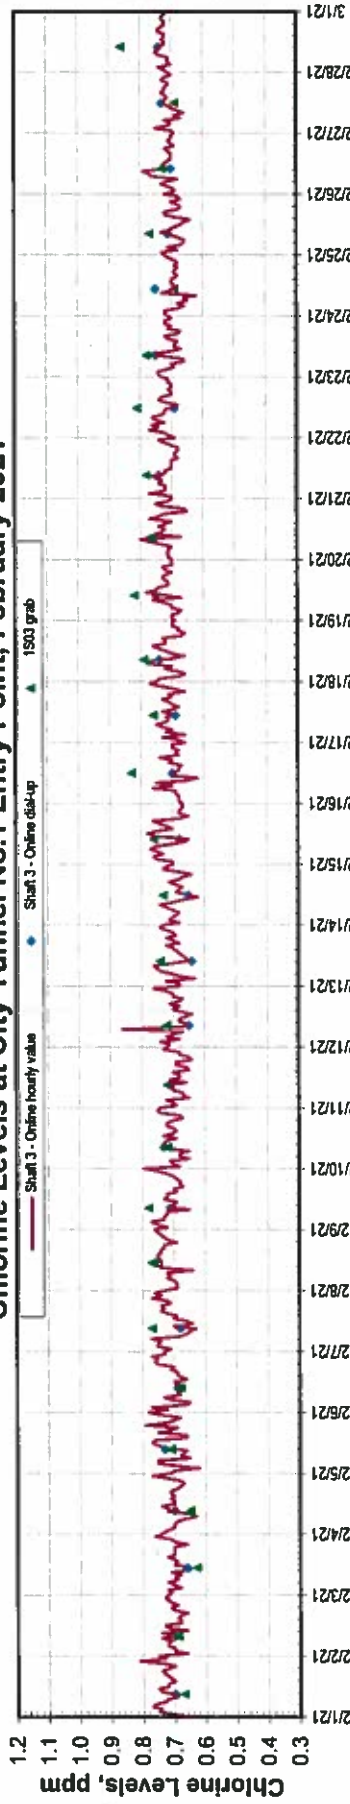

Chlorine Levels at City Tunnel No.2 Entry Point, February 2021

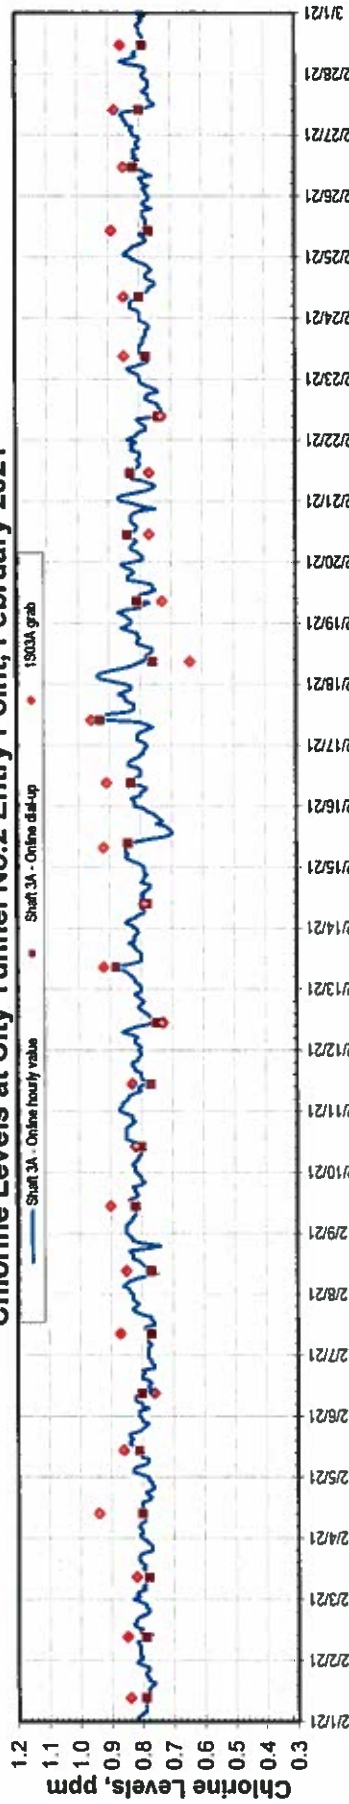

Chlorine Levels at City Tunnel No.3 Entry Point, February 2021

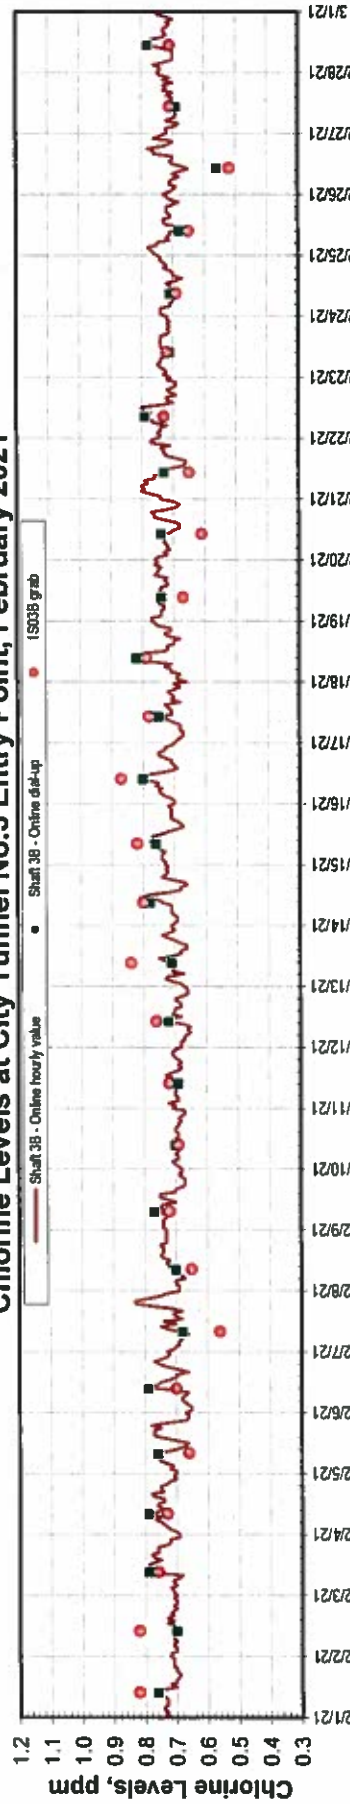

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 11/1/20, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.

New York City Department of Environmental Protection
Bureau of Water Supply

Daily Minimum Chlorine Readings Recorded at Croton Distribution Entry Points



Low Service			High Service		
Date	MinCl_1SCL1	Remark 1	Date	MinCl_1SCH3	Remark 2
02/01/21	0.63		02/01/21	0.49	
02/02/21	0.59		02/02/21	0.48	
02/03/21	0.61		02/03/21	0.45	
02/04/21	0.66		02/04/21	0.49	
02/05/21	0.65		02/05/21	0.52	
02/06/21	0.68		02/06/21	0.58	
02/07/21	0.67		02/07/21	0.59	
02/08/21	0.62		02/08/21	0.55	
02/09/21	0.63		02/09/21	0.54	
02/10/21	0.59		02/10/21	0.53	
02/11/21	0.63		02/11/21	0.55	
02/12/21	0.64		02/12/21	0.56	
02/13/21	0.63		02/13/21	0.56	
02/14/21	0.58		02/14/21	0.55	
02/15/21	0.58		02/15/21	0.56	
02/16/21	0.62		02/16/21	0.57	
02/17/21	0.58		02/17/21	0.57	
02/18/21	0.61		02/18/21	0.53	Croton water stopped feeding High Service entry point at 15:11 EST on 2/18/2021
02/19/21	0.56		02/19/21		No Croton water.
02/20/21	0.62		02/20/21		
02/21/21	0.62		02/21/21		
02/22/21	0.63		02/22/21		
02/23/21	0.64		02/23/21		
02/24/21	0.62		02/24/21		
02/25/21	0.59		02/25/21		
02/26/21	0.62		02/26/21		
02/27/21	0.62		02/27/21		
02/28/21	0.63		02/28/21		

Legend: MinCl_1SCL1: 1SCL1's minimum chlorine level measured and recorded at the location via data logger, in ppm.

MinCl_1SCH3: 1SCH3's minimum chlorine level measured and recorded at the location via data logger, in ppm.

Note: Croton water fed to High Service time period was determined by specific conductance greater than 150 μ S/cm.

New York City Department of Environmental Protection
Bureau of Water Supply
Croton Distribution Entry Point Residual Chlorine Continuous Monitoring Results

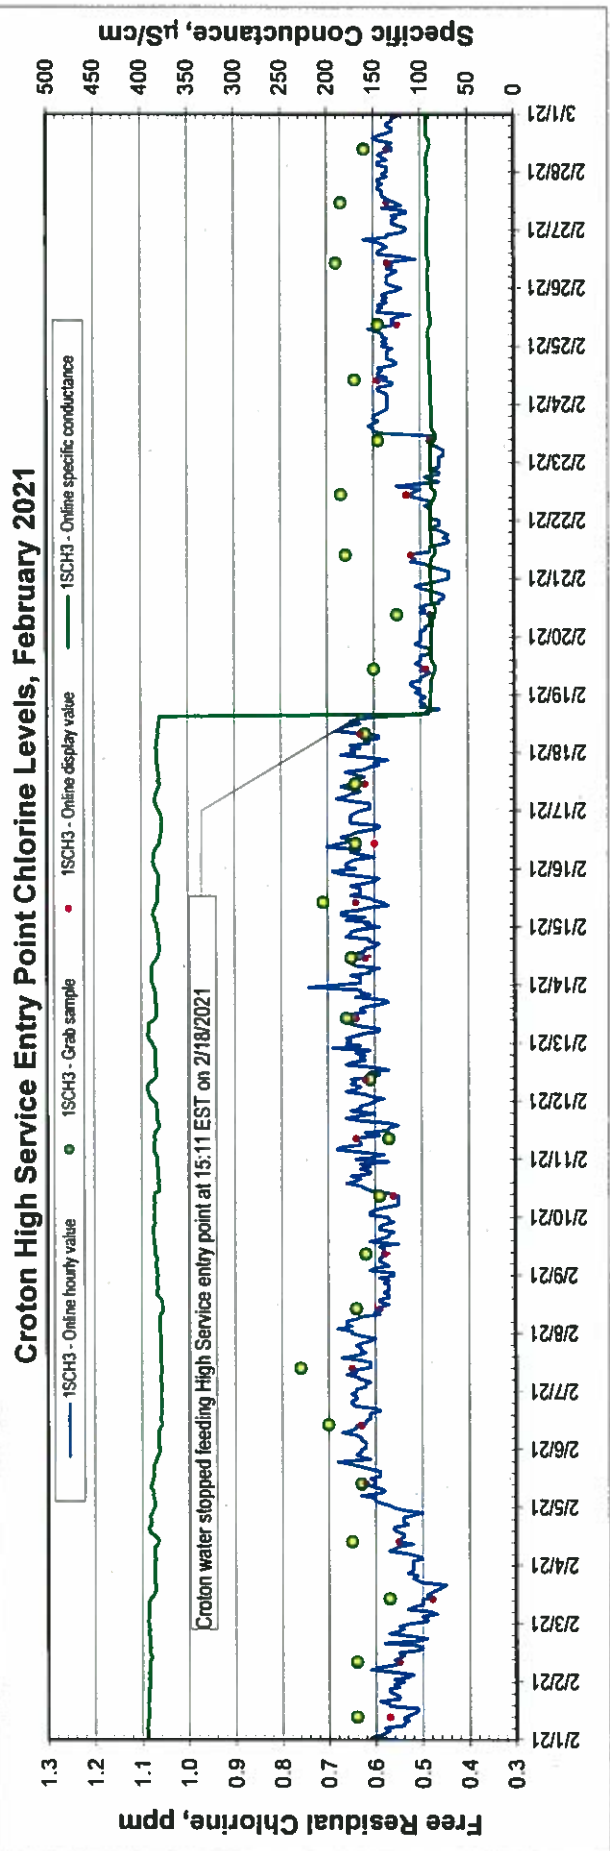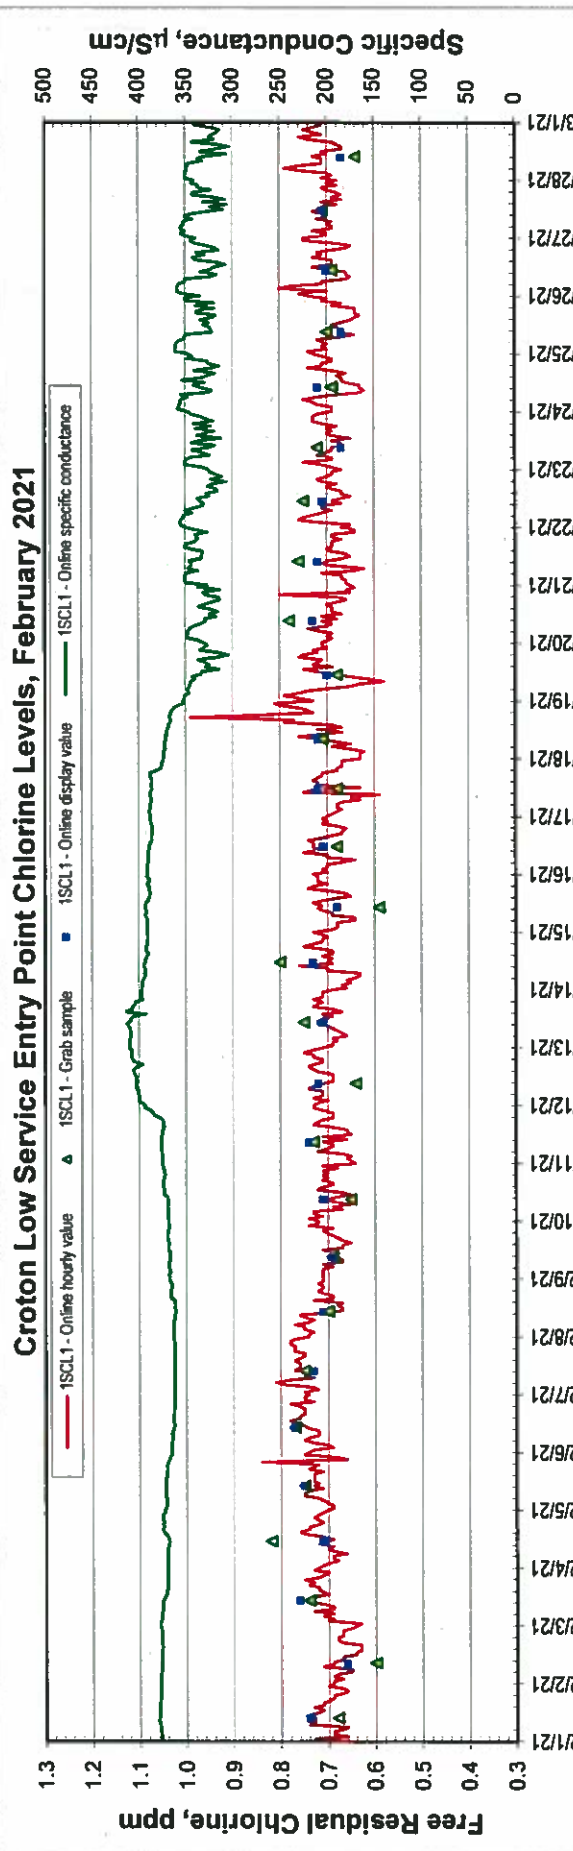

Note: Continuous monitoring of free chlorine residual (FCR) at distribution entry points was maintained. FCR was maintained at or above 0.2 ppm at all times. Since 11/1/20, all online readings, grab and online dial-up readings were recorded in Eastern Standard Time.

DISTRIBUTION SYSTEM DISINFECTION RESIDUAL
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Residual Chlorine (mg/L) Distribution Samples

February 2021

All Distribution Sites			
Samples	Min	Max	Average
1189	0.15	1.00	0.60

Hach DPD Method (analyte is not ELAP certified)

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	RESIDUAL CHLORINE	COMMENT
4583	2/9/21	59350	Reg Stop	1.00	Max
5911	2/22/21	77750	Reg Stop	0.15	Min

A FCR is to be maintained at representative points in the distribution system and no more than 5% of the samples can be undetectable in any two months.

VOLATILE ORGANIC / THM / HAA MONITORING
(FAD Requirement)

REPORT

NYC DEPT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)
SUMMARY OF DISINFECTION BY-PRODUCTS ANALYSES (µg/L)

FIRST QUARTER, 2021

Site	Location	Sample Date	TTHM (µg/L) ^(a)				HAA5 (µg/L) ^(b)			
			Analysis Date	Result	LRAA	OEL	Analysis Date	Result	LRAA	OEL
15150	SS - IFO 1420 E/S Grand Concourse, 1st SS S/O E 171st St, 12"	2/2/21	2/3/21	16	36	29	2/4/21	27	41	31
18650	SS - N/S Dewey Ave, BTW Quincy & Swinton Aves, 12"	2/2/21	2/3/21	23	31	29	2/4/21	41	40	40
23450	SS - N/S Jefferson Avenue, 2nd SS W/O Lewis Avenue, 20"	2/2/21	2/3/21	23	37	33	2/6/21	42	39	39
24350	SS - W/S Brighton 11th Street, 2nd SS S/O Cass Place, 12"	2/2/21	2/3/21	26	37	36	2/4/21	47	46	44
31750	SS - IFO 427 N/S W 26th St, 2nd SS W/O 9th Ave, 12"	2/2/21	2/4/21	18	38	31	2/4/21	20	31	23
31850	SS - IFO 82 S/S Warren St, 2nd SS E/O Greenwich St, 12"	2/2/21	2/3/21	30	40	37	2/5/21	49	48	47
32350	SS - IFO 116 E/S Ave C, 2nd SS N/O E 7th St, 12"	2/2/21	2/3/21	18	39	33	2/4/21	20	34	24
33450	SS - IFO 135 N/S W 112th St, 2nd SS W/O St Nicholas Ave, 12"	2/2/21	2/4/21	13	35	27	2/6/21	12	33	21
33950	SS - N/S E 104th Street, 2nd SS E/O 3rd Avenue, 12"	2/2/21	2/4/21	14	35	29	2/6/21	13	28	20
37950	SS - IFO 325 N/S E 12th Street, 2nd SS E/O 2nd Ave, 12"	2/2/21	2/3/21	30	46	42	2/5/21	50	44	43
38250	SS - IFO 309 N/S E 87th St, 2nd SS W/O 1st Ave, 12"	2/2/21	2/4/21	26	42	37	2/6/21	40	50	43
39650	SS - IFO 229 N/S E 49th St, 2nd SS W/O 2nd Ave, 12"	2/2/21	2/4/21	28	43	39	2/6/21	47	50	47
44350	SS - IFO 21-55 N/S 34th Ave, 1st SS W/O 24th St, 12"	2/2/21	2/3/21	28	45	41	2/6/21	47	49	45
45250	SS - E/S Beach 58th St, 2nd SS N/O Beach Channel Drive, 12"	2/2/21	2/3/21	31	38	35	2/3/21	49	48	49
50250	SS - IFO 937 N/S Victory Blvd, 2nd SS E/O Cheshire Ave, 20"	2/2/21	2/3/21	26	33	31	2/5/21	49	48	48
50750	SS - E/S Woodhull Ave, 1st SS S/O Alboune Ave, 8"	2/2/21	2/3/21	35	43	42	2/6/21	49	40	41
50850	SS - IFO 512 W/S Arlene St, 1st SS N/O Dawson Ct, 12"	2/2/21	2/3/21	31	38	36	2/6/21	47	45	46
52050	SS - IFO 218 W/S Nicholas Ave, 1st SS S/O Charles Ave, 12"	2/2/21	2/3/21	28	42	39	2/6/21	45	48	48
58650	SS - IFO 510 W/S Main St, 2nd SS S/O Hylan Blvd, 12"	2/2/21	2/3/21	33	48	47	2/6/21	50	41	42
77650	SS - W/S 207th St, OPP 110-52 E/S 207th St, 6"	2/2/21	2/3/21	23	32	30	2/4/21	40	41	41
			TTHM		QUARTERLY MINIMUM		12		HAA5	
					QUARTERLY MAXIMUM		50			
					QUARTERLY AVERAGE		39			
					SYSTEM-WIDE RAA		42			

^(a) : analyzed by EPA Method 524.3

^(b) : analyzed by EPA Method 552.3

LRAA: The Localized Running Annual Average (LRAA) is calculated by taking the value of this quarter and the three previous consecutive quarters.

RAA: The System-wide Running Annual Average (RAA) is calculated by taking the average of the Quarterly Average of this quarter and the three previous consecutive quarters.

OEL: The Operational Evaluation Level (OEL) is calculated by averaging 2 times this quarter's value and the two previous consecutive quarters.

Both the LRAA and the System-wide RAA is not to exceed 80 µg/L for TTHM and 60 µg/L for HAA5.

TOTAL COLIFORM MONITORING
(FAD Requirement)

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Summary of Results for Microbiological Quality Compliance Samples

2/1/2021 to 2/28/2021

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested	Number of Samples with Positive Coliform *	Number of Samples with Positive E. coli *	Percent of Samples with Positive Coliform **
Bronx	46	122	122	0	0	0.0%
Brooklyn	70	181	181	0	0	0.0%
Manhattan	57	160	160	2	0	1.3%
Queens ***	79	207	207	0	0	0.0%
Staten Island	29	79	79	0	0	0.0%
Ground Water Supply ***	-	-	-	-	-	-
Total	281	749	749	2	0	0.3%

* As determined by Colliert Quanti-Tray-18 Method (SM 9223 B).

** If more than 5.0 % of all monthly TCR compliance samples are positive for total coliform, a Level I Assessment must be conducted.

*** There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Rupa Aggarwal Date: 03/02/21

Director: [Signature] Date: 3/6/2021

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB #10770; USEPA #NY01351

2/1/2021 to 2/28/2021

[illegible]

• As determined by Colilert Quanti-Tray-18 Method (SM 9223 B). Results expressed in "MPN/100 mL."

** As determined by Hach DPD Method (analyte is not ELAP certified).

Supervisor: Rupe Aggarwal Date: 03/03/21

Director: _____

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality Resamples for Positive Compliance Samples

2/1/2021 to 2/28/2021

[illegible]

* As determined by Colilert Quanti-Tray-18 Method (SM 9223 B). Results expressed in "MPN/100 mL."

*** As determined by Hach DPD Method (analyte is not ELAP certified).

Supervisor: Rupert Agnew Date: 03/03/21

Director: 

Date: 3/6/2021

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Results for Microbiological Quality Free Chlorine Residual and Heterotrophic Plate Count Compliance Samples

2/1/2021 to 2/31/2022

Location	Number of Sampling Points	Number of Samples Collected	Number of Samples Tested (Free Chlorine Residual)	Number of Samples Tested (Heterotrophic Plate Count)	Number of Samples with Free Chlorine Residual *		Range of Heterotrophic Plate Count (CFU/mL) for Free Chlorine Residual of 0.00 mg/L **	Number of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 CFU/mL	Percent of Samples with Free Chlorine Residual of 0.00 mg/L and HPC > 500 CFU/mL ***
					< 0.20 mg/L	0.00 mg/L			
Bronx	46	122	122	82	0	0	--	0	0.0%
Brooklyn	70	181	181	121	0	0	--	0	0.0%
Manhattan	57	160	160	110	0	0	--	0	0.0%
Queens †	79	207	207	141	2	0	--	0	0.0%
Staten Island	29	79	79	56	0	0	--	0	0.0%
Ground Water Supply †	-	-	-	-	-	-	--	-	-
Total	281	749	749	510	2	0	--	0	0.0%

- * Free chlorine residual is determined by Hach DPD Method (analyte is not ELAP certified).
- ** Heterotrophic plate count is determined by method SM 9215 B, PCA medium, 35°C, 48hrs. HPC result ≤ 500 CFU/mL is equivalent to a measurable FCR.
- *** No more than 5 % of FCR samples shall be undetectable in any 2 consecutive months.

t. There was no groundwater sample this month because no well was in operation to distribution.

Supervisor: Ryder Agard Date: 03/08/21

Director: [Signature] Date: 3/8/2021

MICROBIOLOGICAL MONITORING

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Coliform Monitoring Results at Sample Sites near the First Service Connection When Source Water Turbidity Exceeds 1.49 NTU

February 2021

Source water		Distribution site near first service connection			
Date Turb>1.49 NTU	System	Sample Date	Sample Site	Coliform *	E.coli *

No official four-hour turbidity readings from Cat-Del source water were greater than 1.5 NTU this month.

* As determined by Colilert Quanti-Tray-18 Method (SM 9223B). Results expressed in "MPN /100mL."

DISTRIBUTION TURBIDITY MONITORING

REPORT

NEW YORK CITY DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY, DISTRIBUTION LAB (NYSDOH ELAP #10770; USEPA #NY01351)

Turbidity (NTU) Distribution Samples

February 2021

All Distribution Sites			
Samples	Min	Max	Average
1189	<0.10	3.84	0.66

Analytical Method SM 2130 B

SAMPLE NUMBER	SAMPLE DATE	SAMPLE SITE	LOCATION TYPE	TURBIDITY	COMMENT
4583	2/9/21	59350	Reg Stop	3.84	Max
3632	2/1/21	1SCH3	Reg Stop	<0.10	Min
5338	2/16/21	1SCH3	Reg Stop	<0.10	Min

The monthly average of all distribution samples is not to exceed 5 NTU.

COLOR MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Color (U) for Distribution Entry Points February 2021

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
Catskill/Delaware 1S03 (Tunnel 1)	7	6	6	6	6	6	6	7	6	6	6	6	6	6	7	6	7	6	6	7	6	7	6	6	7	7	7	7
Catskill/Delaware 1S03A (Tunnel 2)	6	6	6	6	7	7	7	7	7	7	7	7	7	6	7	7	7	7	6	8	6	7	7	7	7	8	6	7
Catskill/Delaware 1S03B (Tunnel 3)	7	6	6	6	6	7	6	7	7	6	6	6	6	6	7	6	7	6	6	7	6	7	7	7	7	7	7	7
Croton System 1SCL1 (a)	4	3	4	4	4	4	4	3	4	3	4	4	4	4	4	4	3	4	4	3	4	4	4	4	4	3	4	4
Croton System 1SCH3 (b)	4	4	4	4	4	3	4	4	4	4	4	4	4	4	4	4	3	4	-	-	-	-	-	-	-	-	-	-

Analytical Method SM 2120 B. Apparent color.

The average of two consecutive samples from the same site is not to exceed the MCL of 15 color units.

(a) Croton System online as of 10/27/20 at 1SCL1.

(b) Croton System offline as of 2/19/21 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	28	6	7	6
Catskill/Delaware 1S03A (Tunnel 2)	28	6	8	7
Catskill/Delaware 1S03B (Tunnel 3)	28	6	7	7
Croton System 1SCL1 (a)	28	3	4	4
Croton System 1SCH3 (b)	18	3	4	4

Supervisor *[Signature]*

Date 03/04/2021

Director *[Signature]*

Date 3/4/2021

FLUORIDE MONITORING

REPORT

NYC DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF WATER SUPPLY DISTRIBUTION LABORATORY (NYSDOH ELAP #10770; USEPA #NY01351)

Fluoride (mg/L) for Distribution Entry Points

February 2021

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
Catskill/Delaware 1S03 (Tunnel 1)	0.70	0.72	0.71	0.72	0.67	0.70	0.73	0.73	0.71	0.72	0.72	0.73	0.73	0.72	0.72	0.69	0.72	0.73	0.71	0.69	0.69	0.70	0.72	0.70	0.68	0.70	0.70	0.71
Catskill/Delaware 1S03A (Tunnel 2)	0.71	0.72	0.71	0.69	0.67	0.70	0.74	0.75	0.71	0.72	0.72	0.74	0.73	0.72	0.71	0.69	0.70	0.73	0.71	0.68	0.68	0.70	0.71	0.71	0.69	0.70	0.74	0.72
Catskill/Delaware 1S03B (Tunnel 3)	0.70	0.72	0.71	0.72	0.67	0.71	0.73	0.73	0.71	0.72	0.73	0.73	0.74	0.72	0.72	0.69	0.71	0.73	0.71	0.68	0.68	0.71	0.71	0.70	0.69	0.70	0.73	0.72
Croton System 1SCL1 (a)	0.73	0.73	0.77	0.79	0.72	0.75	0.76	0.79	0.74	0.76	0.72	0.75	0.75	0.72	0.72	0.71	0.74	0.75	0.80	0.79	0.81	0.80	0.80	0.77	0.78	0.78	0.76	0.79
Croton System 1SCH3 (b)	0.79	0.86	0.77	0.78	0.72	0.75	0.77	0.78	0.72	0.75	0.80	0.81	0.80	0.79	0.78	0.75	0.79	0.80	-	-	-	-	-	-	-	-	-	-

Analytical Method SM 4500 FC (97)

The average of two consecutive samples from the same distribution entry point site is not to exceed the MCL of 2.2 ppm.

(a) Croton System online as of 10/27/20 at 1SCL1.

(b) Croton System offline as of 2/19/21 at 1SCH3.

Entry Point	Samples	Minimum	Maximum	Average
Catskill/Delaware 1S03 (Tunnel 1)	28	0.67	0.73	0.71
Catskill/Delaware 1S03A (Tunnel 2)	28	0.67	0.75	0.71
Catskill/Delaware 1S03B (Tunnel 3)	28	0.67	0.74	0.71
Croton System 1SCL1 (a)	28	0.71	0.81	0.76
Croton System 1SCH3 (b)	18	0.72	0.86	0.78

Supervisor

[Signature]

Date

03/04/2021

Director

[Signature]

Date

3/4/2021